

Real-Time Water Quality Report

Grieg NL Nurseries Ltd Monitoring Well

Deployment Period:
March 24, 2021 to June 16, 2021



Government of Newfoundland & Labrador
Department of Environment & Climate Change
Water Resources Management Division

Prepared by:

Tara Clinton
Environmental Scientist
Water Resources Management Division
Department of Environment & Climate Change
4th Floor, Confederation Building, West Block
St. John's NL A1B 4J6
Ph. No.: (709) 729 - 5925
Fax No.: (709) 729 - 0320
taracClinton@gov.nl.ca

General

The Water Resources Management Division (WRMD) in partnership with Grieg NL Nurseries Ltd, maintain a real-time water quality groundwater monitoring station. The station is located near the Marystown YMCA and Track and Field Complex.

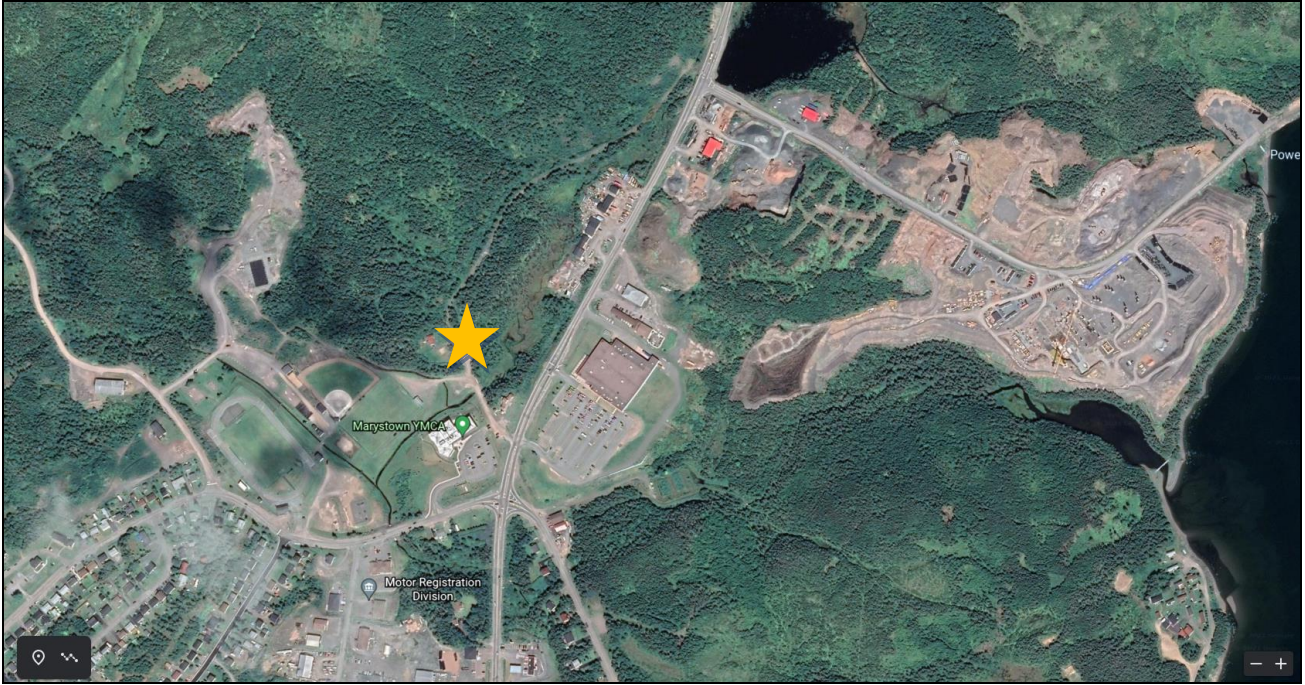


Figure 1: Location of Real-Time Groundwater Well



Figure 2: Hut Structure for groundwater well



Figure 3. View standing in front of well looking toward main road in Marystown, NL



Figure 4: Well Casing in the hut



Figure 5: View looking into well

Quality Assurance and Quality Control

WRMD staff (Environment & Climate Change (ECC)) are responsible for maintenance of the real-time water quality monitoring equipment, as well as recording and managing the water quality data. Tara Clinton is ECC's main contact regarding the instrumentation or the functionality of the monitoring well operation. Tara is responsible for maintaining and calibrating the water quality instrument, as well as grooming, analyzing and reporting on water quality data recorded at the station.

Grab samples are collected at the beginning of each deployment period to compare against the initial in-situ logged data. Grab samples compliment the real-time data and provide an extra source of water quality data for comparisons when monitoring changes over time at the station (Table 1).

It should be noted that the temperature sensor on any sonde is the most important. All other parameters can be divided into subgroups of: temperature dependent, temperature compensated and temperature independent. Due to the temperature sensor's location on the sonde, the entire sonde must be at a constant temperature before the temperature sensor will stabilize. The values may take some time to climb to the appropriate reading.

Concerns or Issues during the Deployment Period

Real time water monitoring well equipment was installed in the back-up production well in November 2020, which was to be used only when the main well went offline. However, after installation of the real-time instrument, it was determined that water will be drawn from the well regularly, requiring the water quality instrument to be removed each time pumping is occurring. The removal of the instrument and the pumping of the water will disrupt the data set.

This groundwater well shares its aquifer with the main pumping well for the hatchery and variations in the water parameters could be a result of pumping from either well.

Table 1: Comparison of the In-Situ instrument vs. Grab Sample Results

Parameter of Comparison	In-Situ Instrument	Grab Sample Result
pH (pH units)	7.52	8.12
Specific Conductivity ($\mu\text{S}/\text{cm}$)	282.9	321

Grieg Monitoring Well

Water Temperature

Water temperature ranged from 7.16°C to 7.37°C during the deployment period (Figure 6). The average water temperature across the deployment is 7.28°C.

Grieg’s monitoring station is a groundwater well. Generally, water temperatures remain fairly consistent throughout deployments in groundwater. This is evident during this deployment as the trend line indicates on the graph in red.

The small dips in water temperature are likely a result of the change in the water column during the pumping processes.

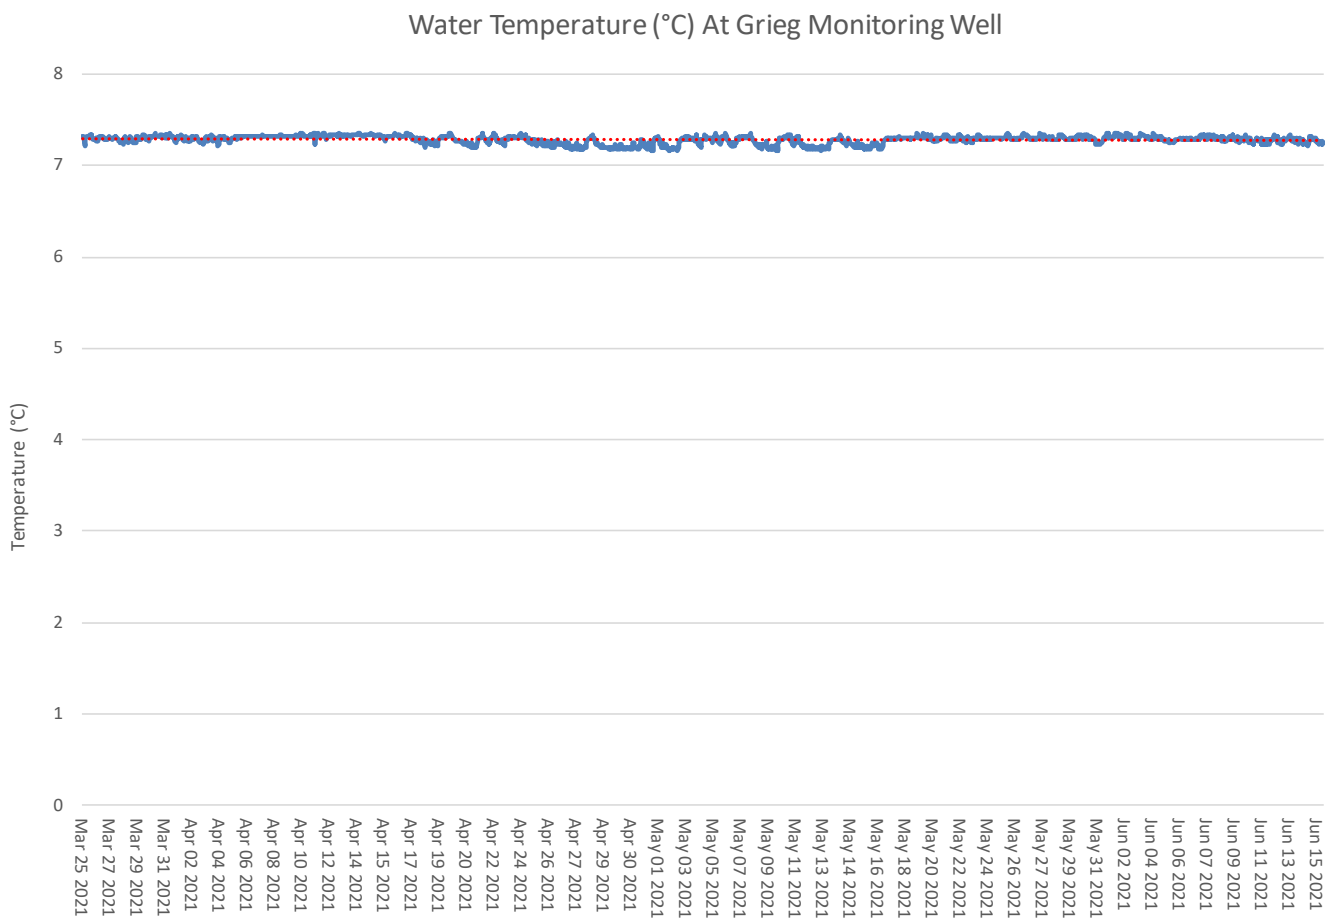


Figure 6: Water temperature (°C) values

pH

Throughout the deployment period, pH values ranged between 7.52 pH units and 7.93 pH units. The pH data remained consistent for the duration of the deployment, with a median of 7.72 pH units.

Small changes in pH were likely the result of pumping within the aquifer. As the well refills and the level adjusts, there will be movement in the pH levels for a short period of time (Figure 7).

Comparison of the grab sample data for pH indicated that the pH in the grab sample of 8.12 pH, was slightly higher than what was recorded in-situ at 7.52 pH (Table 1). To obtain the grab sample, the well was pumped to remove the stagnant water in the casing before the sample was taken. The in-situ reading was recorded after the pumping of the well had stopped and the water column allowed to settle.

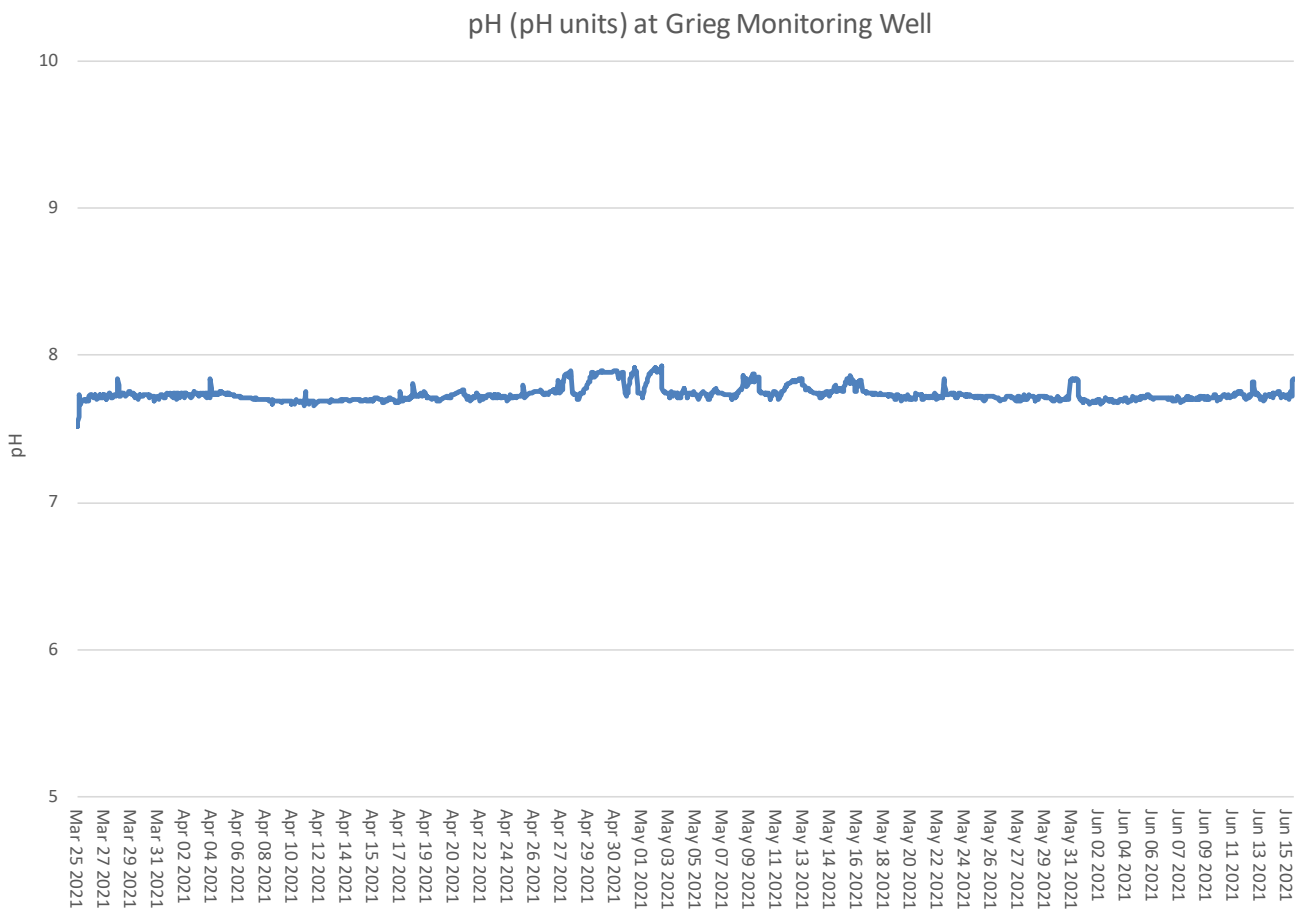


Figure 7: pH (pH units) values

Specific Conductivity & Total Dissolved Solids (TDS)

The specific conductivity probe measures the presence of diluted salts and inorganic materials in a water source. During the deployment, conductivity levels were within 264.8 $\mu\text{S}/\text{cm}$ and 318.4 $\mu\text{S}/\text{cm}$ (Figure 8). The higher spikes in conductivity may be due to pumping within the aquifer. Pumping can disrupt the diluted salts and inorganic materials that are present in the ground water for a short period.

TDS data is derived from the specific conductivity data. The water quality instrument is programmed to calculate an estimated TDS value from a conductivity value. TDS data will mirror the movement of the specific conductivity data, however the TDS is calculated in g/L (Figure 9). For the deployment period, TDS ranged within 0.17 g/L to 0.21 g/L.

Due to minimal or no influence from an outside source, the conductivity in the groundwater well is low. The spikes in specific conductivity are likely a result of pumping and associated disturbance of the aquifer.

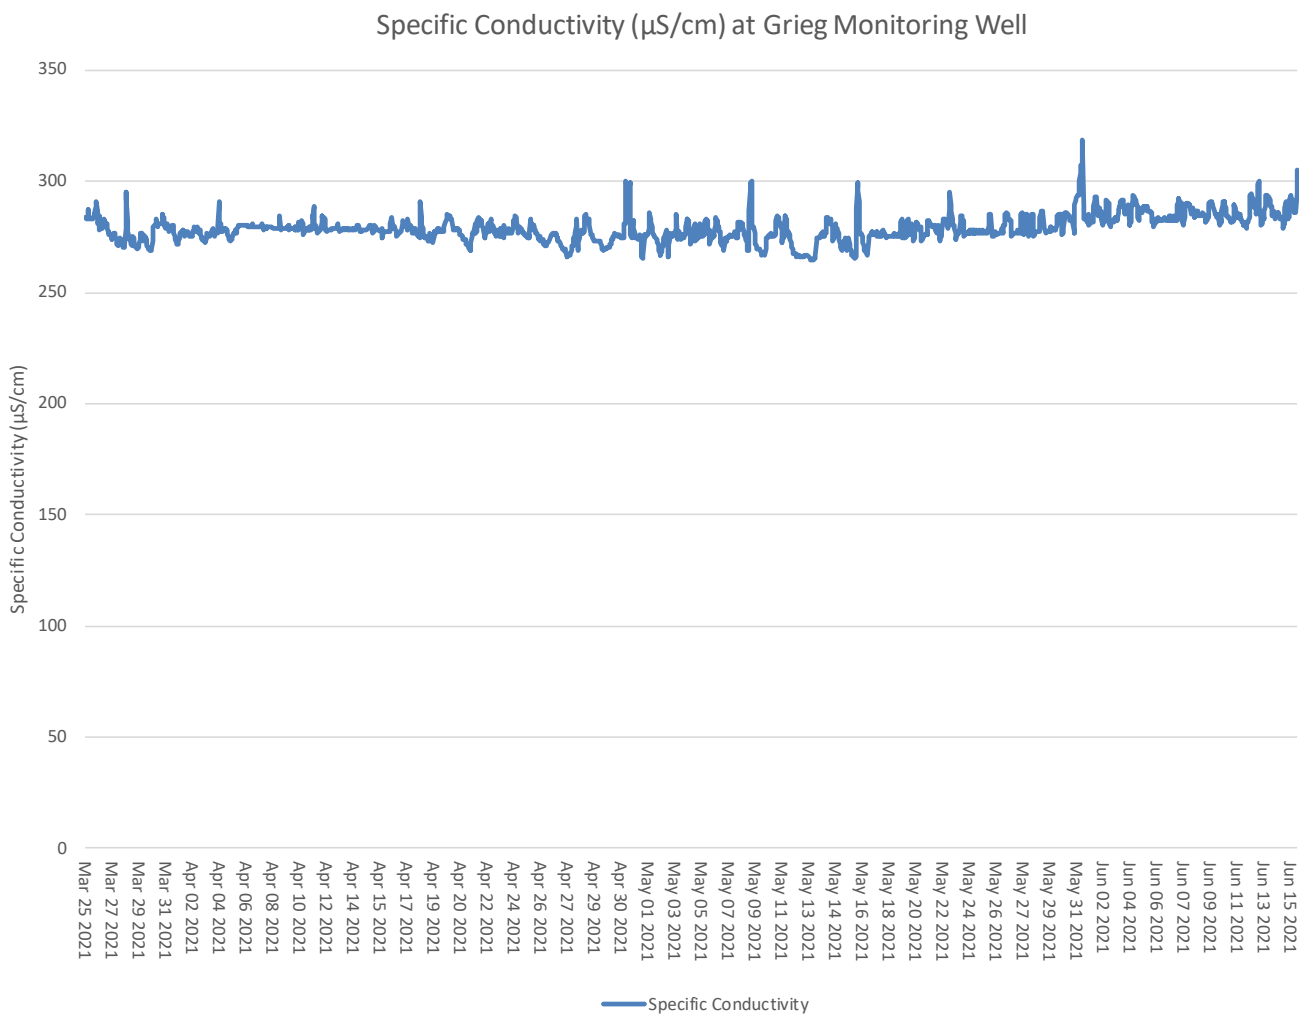


Figure 8: Specific conductivity ($\mu\text{S}/\text{cm}$) values

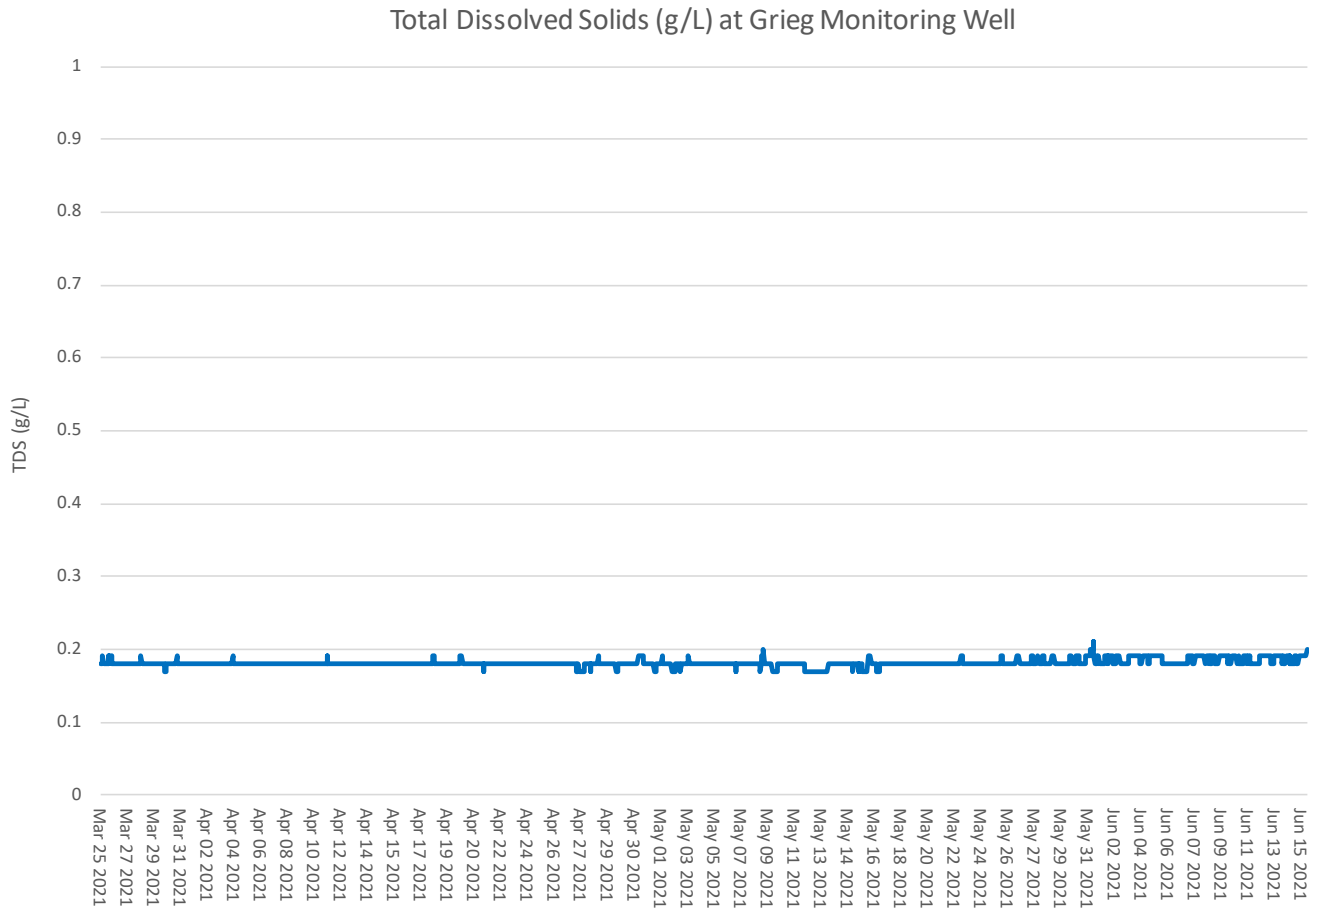


Figure 9: Total Dissolved Solids (TDS)

Oxidation-Reduction Potential (ORP)

ORP levels during the deployment ranged within -65.5 mV to 364.5 mV (Figure 10). The dataset had a median of 317.2 mV. It would be expected for the ORP to fluctuate in a ground water well that is frequently disturbed with pumping.

Oxidation-Reduction Potential is used to determine the oxidizing-reduction potential of the groundwater. The 'redox potential' of the groundwater can indicate the presence of agents that may contaminate groundwater. ORP is individual and specific to each water body and gathering background data is essential in understanding what the changes in the data represent.

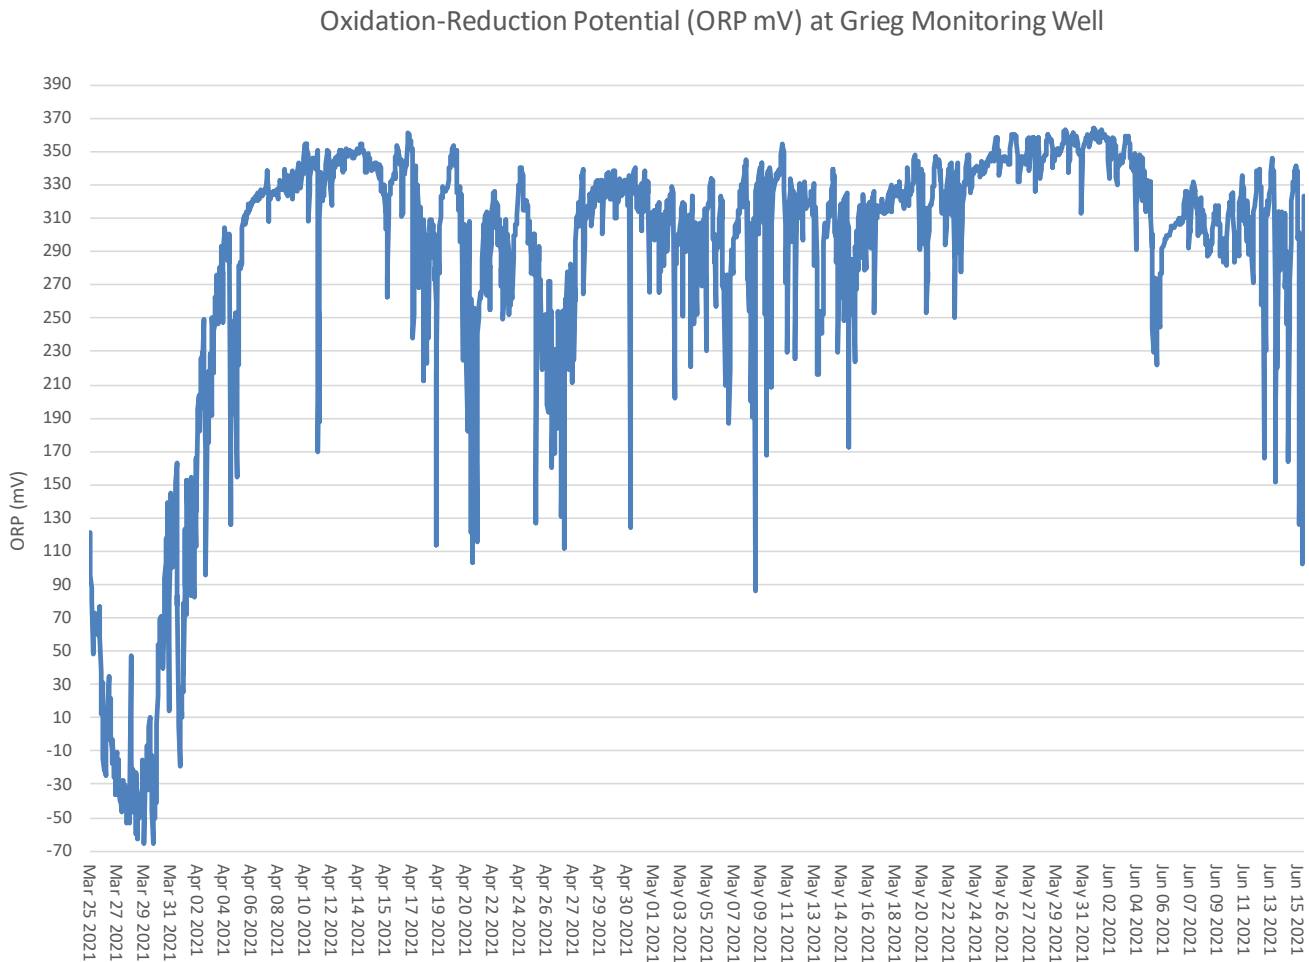


Figure 10: ORP values (mV)

Water Elevation

Water Elevation at the monitoring well, ranged within 13.51 m to 33.82 m. The data set had a median of 32.67 m.

Generally, water elevation within a groundwater well is consistent. However, this well and it's aquifer are frequently disturbed by pumping. This causes fluctuations in water elevation. As shown below on figure 11, water elevation dips periodically throughout the deployment.

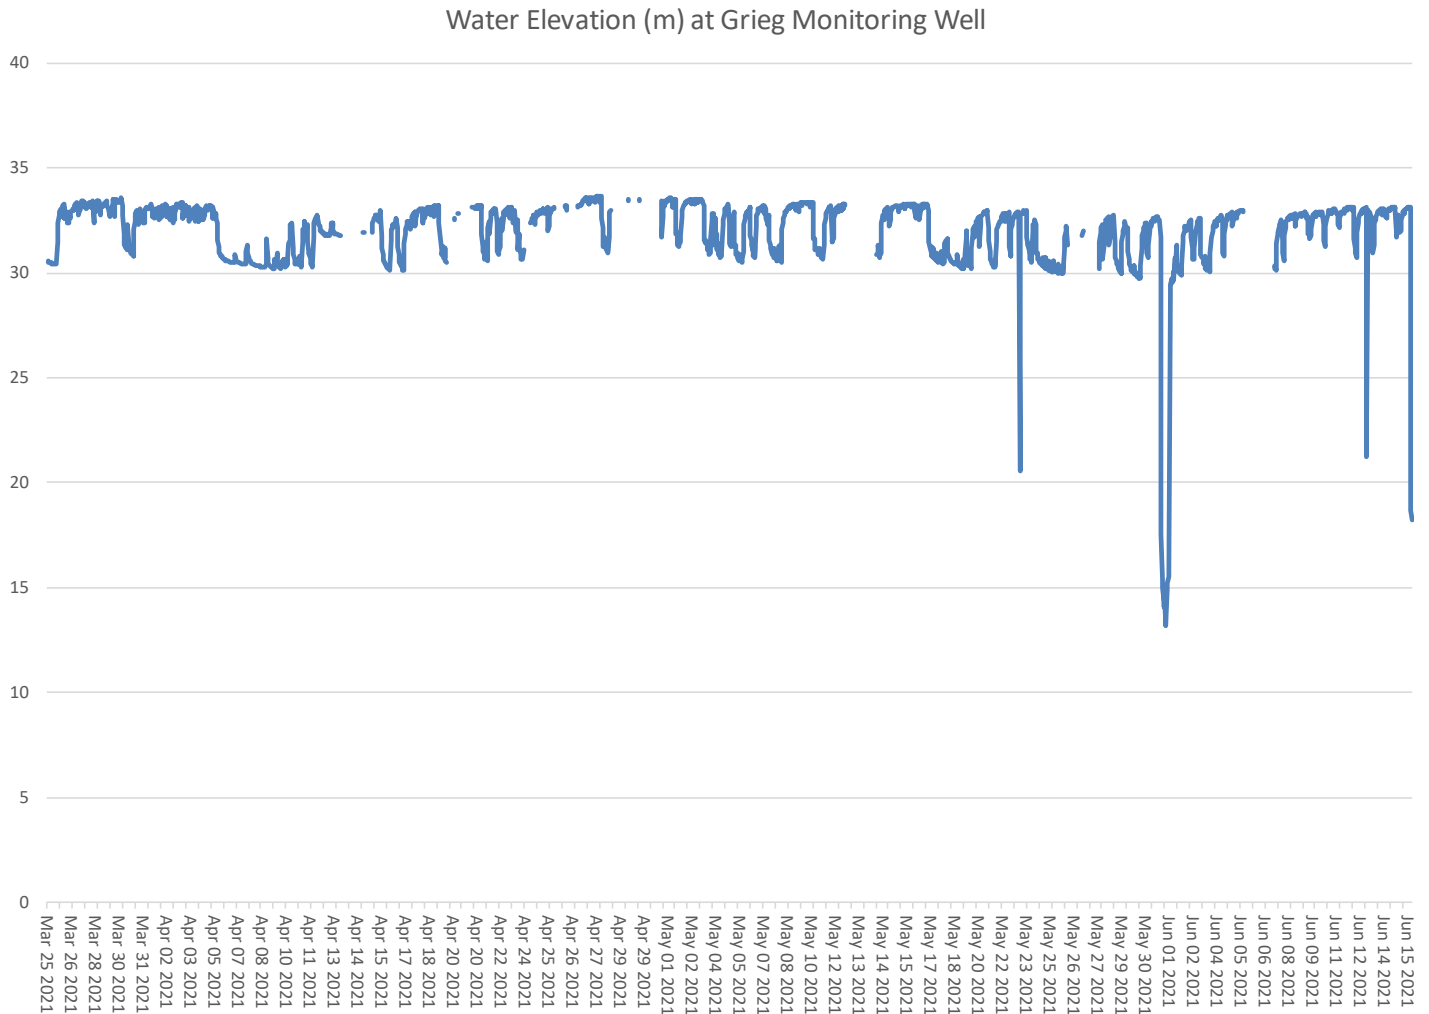


Figure 11: Water Elevation (m)

Appendix I

Water Quality Statistics of Grieg Groundwater Well

Deployment period March 24 to June 16, 2021

Parameter	Min	Max	Median	Mean
Water Temperature (°C)	7.16	7.37	7.30	7.28
pH (pH units)	7.52	7.93	7.72	7.73
Specific Conductivity (µS/cm)	264.8	318.4	278.3	278.9
Total Dissolved Solids (g/L)	0.17	0.21	0.18	0.18
ORP (mV)	-65.5	364.5	317.2	285.43
Water Elevation (m)	13.51	33.82	32.67	32.15