

**User Manual for
Province of Newfoundland & Labrador
Full Cost Accounting Tool**

Purpose of this Manual

This manual is intended to serve as a guide to assist users as they complete the Cost Accounting Tool. Screen shots of the cost accounting tool have been included to clarify how the tool should be filled out and to assist with interpreting the generated results.

Description of the Full Cost Accounting Assessment Tool

The purpose of the Full Cost Accounting Assessment Tool is to help owners of public drinking water systems in the Province of Newfoundland and Labrador to predict the costs of operating their systems to establish water taxes that will adequately fund proper operation. The second part of the Full Cost Accounting Assessment Tool is for communities that are considering upgrades to their treatment system. The Full Cost Accounting Assessment Tool will generate a water tax based on predicted capital and annual operation and maintenance costs. The sole purpose of the Full Cost Accounting Assessment Tool is to provide information for establishing water taxes. It should not be used to estimate capital budgets. Non-Operating costs such as depreciation and debt servicing, which are typically costs included in full-cost accounting for water systems, have not been included in the calculations. Provincial or Federal sales or services taxes have also not been included. The Full Cost Accounting Assessment Tool is set-up to determine the amount of revenue that is needed to cover the operating costs by detailing the typical operating costs for a water system on a break even basis.

General Instructions

Complete the tool by filling out data in each of the relevant tabs. The tool includes two parts: Part 1 is an analysis of the existing operation and maintenance costs and water taxes, Part 2 is an analysis of future upgrade costs for communities that are considering upgrades to their water treatment system(s).

Buttons have been placed throughout the tool to assist with navigation from one tab to the next, as well as to access pages containing additional information.

Data entry cells are have white fill and a black outline. This tool also uses drop-down menus and selector options buttons.

Where prompted, enter the most recent available information. For communities with more than one water supply system, the tool may be completed separately for each system, or it can be completed for all systems at once. However, if completing the tool for more than one system, make sure to add the values for all systems before entering in the data entry cells.

Limitations

A number of assumptions were used in developing this tool, which should be considered when evaluating and interpreting the results. Many of the assumptions are listed below.

This program relies on conceptual cost curves to predict capital and operation and maintenance costs based on user entered data. The cost data is based on 2017 costs and is inflated using 3% inflation rate for subsequent years.

The cost curves were developed based on data from water supply systems constructed in Newfoundland and Labrador and information supplied by various vendors. The curves were calculated based on many assumptions and allowances. The program is intended only to help communities establish water taxes.

Cost predictions generated by the program do not include depreciation. The tool does not consider existing non-operating expenses such as debt servicing..

All cost predictions are provided in Canadian dollars. Cost opinions DO NOT include applicable taxes.

The cost predictions generated through this tool do not include special costs for land acquisition, permit costs, legal fees, or site specific costs.

Actual capital costs and operation and maintenance costs for system upgrades may vary substantially from those calculated by this program. It is recommended that a site specific engineering study should be completed to establish costs used for capital budgeting.

Step-by-Step Instructions

Title Page

The user must enter the community name, the region where the community is located, and the date. This information is required. The date is used as a benchmark for inflating costs and the geographic region is used to adjust capital and operation and maintenance costs, which vary depending on the location within the Province.

After entering the information, click “Begin”.

Province of Newfoundland & Labrador
Full Cost Accounting Assessment Tool - DRAFT
To Achieve Complete Cost Recovery of Drinking Water Supply System Operation & Maintenance

Community: Enter community name here.

Geographic Region: Select geographic region here. If unsure, select based on the closest Town to your community.

Date: Enter month Enter day Year: Enter the year

After entering all information, select “Begin”

Table of Contents

The Table of Contents page is provided for information to the user. Click “Next Page” to proceed to the Description of Tool page, or click “Previous Page” to return to the Title page.

Description of Tool

The Description of Tool page is provided for information to the user. Click “Next Page” to proceed to the Instructions page, or click “Previous Page” to return to the Table of Contents.

Instructions

The Instructions page is provided for information to the user. Click “Next Page” to proceed to the Assumptions page, or click “Previous Page” to return to the Description of Tool page.

Assumptions


The Assumptions page is provided for information to the user. Click “Next Page” to proceed to the Start page, or click “Previous Page” to return to the Instructions page.

Start Page

On this page, the user has the option of selecting whether to use Part 1 of the Tool or Part 2 of the Tool.

Part 1 is the analysis of existing costs and water rates. Under this section, users will enter existing operation and maintenance costs and revenue data. The tool will evaluate the existing costs and will provide a recommended water tax to fund the operation of the water supply system.

Part 2 is for communities that are evaluating capital upgrade options. The community can select a type of treatment system to construct, and the tool will provide a range of potential capital and operation and maintenance costs. The tool will then generate a water tax to fund the capital and operation and maintenance costs of the proposed system.

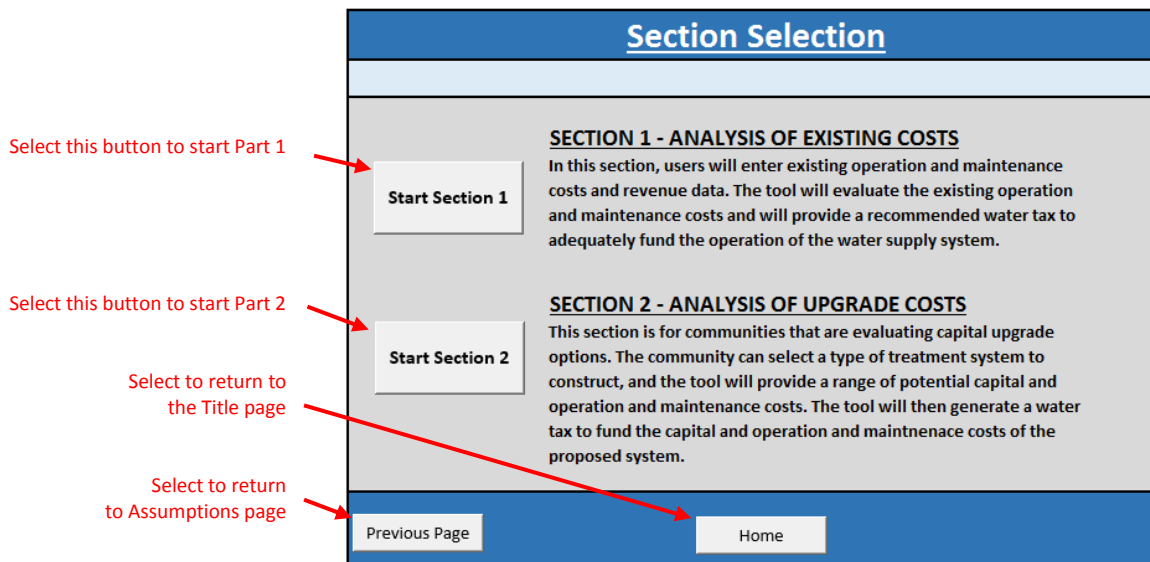

Part 1 – Analysis of Existing Costs

Community Data

On this page, enter the name of the supply system, whether the source is a surface water or ground water, the community's population, and flow data, if it is available. If completing the tool for multiple systems that are operated by the community, enter the total population served by the water supplies.

The screenshot shows a web form titled 'PART 1 Community Data'. It is divided into sections: 'General', 'Population', and 'Existing System Flows'. Red arrows point to specific fields with explanatory text:

- Arrow to 'System:' field: 'Enter the name of the system or water supply' (points to 'Miller's Pond').
- Arrow to 'Type of Water Supply:' field: 'Select whether the source water is groundwater or surface water' (points to 'Surface Water').
- Arrow to 'Population' section: 'Enter the population serviced by the water supply system(s)' (points to the '481' entry).
- Arrow to 'Existing System Flows' section: 'If flow records are available, enter the data here. Otherwise, the values will be assumed based on population.' (points to the flow data table).
- Arrow to 'Previous Page' button: 'Select to return to Start page'.
- Arrow to 'Next Page' button: 'Select to proceed to the "Existing System" page.'

The 'Existing System Flows' section contains a table for flow data and a 'Per Capita Consumption' table.

	Value	Units			Per Capita Consumption
Average Flow/Water Use:	93	usgpm	507	m3/d	1054 L/p/d
Maximum Day Flow:	144	usgpm	785	m3/d	1632 L/p/d
Peak Hour Flow:		<Units>			

At the bottom of the form, there are 'Previous Page' and 'Next Page' buttons, and a version number '1.1'.

Description of terms:

- Average Flow/Water Use:
 - Represents the typical volume of water sent to the distribution system on a daily basis.
- Maximum Day Flow:
 - Represents the maximum amount of water sent to the distribution system in a 24 hour period during a calendar year.
- Peak Hour Flow:
 - Represents the maximum amount of water sent to the distribution system in a one hour period during the calendar year.

The user must select the type of flow units to use when entering the flow data. The options include US gallons per minute (USgpm), imperial gallons per minute (igpm), and cubic meters per day (m3/d). The cost accounting tool then converts the flows to cubic meters per day.

If the user does not know the value for average flow, maximum day flow, or peak hour flow, leave the field blank, and the cost accounting tool will estimate the unknown flow data based on the community population.

Description of Existing System

On this page, the user will enter information about the water supply system. The cost accounting tool then uses this information along with the information entered on the Community Data page to calculate the recommended investments that the community should put towards the water system.

PART 1

Description of Existing Water Supply System

Existing Treatment & Disinfection Systems

Select the disinfection system(s) operated at the facility:

- ☐ Sodium Hypochlorite (liquid chlorine)
- ☒ Chlorine Gas
- ☐ Onsite Sodium Hypochlorite Generation (Mixed Oxidants)
- ☐ Calcium Hypochlorite (chlorine powder)
- ☐ UV Disinfection

Existing Treatment & Disinfection Systems

If the treatment process includes pH adjustment, select the chemical that is used:

- ☐ None
- ☒ Soda Ash
- ☐ Lime
- ☐ Caustic Soda

If applicable, select the treatment processes that are provided at the existing facility:

- ☐ Inline Filtration (for particle removal)
- ☐ Iron / Manganese Removal
- ☐ Arsenic Removal
- ☐ Membrane Treatment
- ☐ Conventional WTP
- ☐ PWDU

Does the existing water distribution system include chlorine booster stations?

No
Yes, with sodium hypochlorite
Yes, with chlorine gas

If chlorine boosting is included, what fraction of the distribution system receives water that has been boosted with chlorine?

0%
10%
20%
30%

Existing Pumping Systems

Does the existing water supply system include any of the following pumping systems:

- ☐ Ground water pumping
- ☐ Low lift pumping (pumping from surface water source to treatment building)
- ☒ High lift pumping (pumping from treatment building to distribution system)
- ☐ Distribution System Pressure Booster Pumping

If distribution system booster pumping is provided, approximately what fraction of the distribution system is fed from the booster pumping station?

0%
10%
20%
30%

Previous Page Next Page

1.2

Select the type of disinfection process(es) at the water treatment facility.

If chemicals are used to adjust the distribution system pH, select the type of chemical that is applied.

Select the types of treatment processes that are operated at the treatment facility.

Select "Yes" if there is a facility located within the distribution system that is used to add additional chlorine. These are often found at locations downstream of treated water storage tanks.

If the community has booster pumps within the system, enter the approximate fraction of the community that is downstream of the pumping station.

On this page, the user must select the type of chemical disinfectant that is used, as well as if a UV disinfection system is operated.

There are also option buttons to select if the facility employs any types of water treatment. For facilities that practice pH adjustment, the operator should select the type of chemical that is used. The options

include Soda Ash, Lime, and Caustic Soda. Treatment systems could include inline filtration, membrane treatment, iron and/or manganese removal, conventional water treatment (coagulation, flocculation, clarification, and filtration), arsenic removal, and potable water dispensing units.

For communities that have chlorine booster stations within the distribution system, select the type of chlorine chemical that is used at the booster station, as well as the approximate fraction of the community that is downstream from the booster station.

Users should select any of the types of pumps that are included within their water supply system. The types of pumps listed include: ground water pumping, low lift pumping, high lift pumping, and distribution system pumping. Groundwater pumping is only used in groundwater systems. Low lift pumping would be selected in surface water systems where water is pumped from the source to the treatment plant. High lift pumping is considered the pumping from the treatment facility to the distribution system. In many systems, pumping stations are located within the distribution system. For distribution system pumping stations, the user must enter the approximate fraction of the community (by population) that is downstream of the pump station.

Existing Expenditures

On this page, the user will enter information about the community's expenditures for operating the water supply system.

Enter the expenditures as they relate to the source of supply, pumping and power, disinfection and treatment, transmission and distribution, and administration. While many smaller communities do not break-down expenses into categories, the user should attempt to do this, in order to obtain the most accurate results from the Cost Accounting Tool.

Items that are covered in each of the categories are described in detail below.

Source of Supply:

Items covered under this category relate to the maintenance of the surface watershed for surface water supplies and the recharge area for groundwater supplies. These may include:

Wages and Benefits – This expense item is the estimated cost for staff to maintain the watershed or groundwater recharge area. Staff time could relate to cleaning of intake screens for surface water, tree cutting, garbage collection, placement and maintenance of signage, fencing and responding to public concerns to name a few items. Benefits relate to overheads including matching contributions for income tax, CPP, EI, health plans and vacations are included.

Maintenance of Source of Supply Surface Watersheds including Travel – This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the surface watershed. This item might include replacing intake screen, materials for maintenance of the intake screens, gravel, stone or concrete for dam and/or intake maintenance, signage, gravel for roads and travel to the undertake work to name a few.

Maintenance of Source of Supply Groundwater Recharge Areas including Travel - This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the

groundwater recharge area. This item might include drilling new supply and/or monitoring wells, cleaning screens on existing wells, wellhead maintenance, signage, gravel for roads, fencing and travel to undertake work to name a few.

Professional Services – This expense item relates to the hiring of outside consultants to undertake works that require professional input relating to the Source of Supply.

Other – This category is included such that the Operator/Supervisor can add other items that are unique to the location.

Power and Pumping:

Items covered under this category relate to the operation and maintenance of all pumping equipment associated with the water system including supply pumps for surface water, supply/well pumps for groundwater and booster pumps to boost water pressure in the distribution network. These may include:

Wages and Benefits – This expense item is the estimated cost for staff to operate and maintain all the pumping equipment in the system. Staff time could relate to routine checking of pump operation, routine cleaning and lubrication, and pressure checks to ensure the pumps are operating as per the requirements of the system. Benefits relate to overheads including matching contributions for income tax, CPP, EI, health plans and vacations are included.

Maintenance of Pumps and Controls including Travel - This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the pumping equipment including pump controls. This item might include routine maintenance of pumps, monitoring of electrical power consumption, monitoring of pump outputs if flow meters are installed, inspection of pump control panels and travel to undertake work to name a few.

Electricity – This expense is to cover the cost of supplying electricity to the pumping equipment including electricity for space heating if required.

Fuel for Generators and Building Heat – This expense is to cover the cost of fuel for generators, diesel/gasoline powered backup pumps and heating oil/propane for building heat.

Professional Services – This expense item relates to the hiring of outside consultants to undertake works that require professional input relating to pumping requirements in the system.

Other – This category is included such that the Operator/Supervisor can add other items that are unique to the location.

Water Treatment:

Items covered under this category relate to the operation and maintenance of the water treatment equipment associated with water system including operation and maintenance of water treatment plants and chlorination systems. These may include:

Wages and Benefits – This expense item is the estimated cost for staff to operate and maintain the water treatment equipment. Staff time could relate to regular checking of treatment plant

operation, adjustment of the treatment processes including chemical feed rates, routine testing to verify treatment requirements and performance, and routine chlorine residual testing as per the requirements of the regulators. Benefits relate to overheads including matching contributions for income tax, CPP, EI, health plans and vacations are included.

Maintenance of Pump Station Structures including Travel – This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the pump station structures. This item might include routine maintenance on the structures including repair of damage caused by vandalism and/or storms and travel to undertake required works to name a few.

Electricity and Fuel – This expense is to cover the cost of supplying electricity to the water treatment system including electricity and/or heating oil/propane for space heating if required.

Chemicals – This expense is to cover the cost of all chemicals used in the water treatment process.

Maintenance of Treatment Plant Equipment - This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the water treatment equipment. This item might include routine maintenance/replacement of chemical feed pumps, monitoring of electrical power consumption, monitoring of treatment plant production and backwash volumes, monitoring of turbidity and chlorine residual values to name a few.

Maintenance of Pump Station Structures – This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the water treatment plant structures. This item might include routine maintenance on the structures including repair of damage caused by vandalism and/or storms and travel to undertake work to name a few.

Maintenance of Computer Controls and SCADA– This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the computer systems in the water treatment plant including SCADA systems.

Materials and Supplies – This expense is to cover the cost of routine materials and supplies that are required for the operation of the Water Treatment Plant.

Sludge Handling and Disposal – This expense is to cover the cost of sludge handling at the Water Treatment Plant including short term storage, transportation (if required) and long term disposal.

Water Testing – This expense is to cover the cost of routine water testing as required for the operation by the Regulators of the Water Treatment Plant.

Vehicle Expense Including Vehicles and Operating Costs – This expense is to cover the cost of providing vehicles including operating costs that are required for the operation of the Water Treatment Plant. If dedicated vehicles are not required this expense item should be used for any travel expenses associated with the Water Treatment Plant.

Professional Services – This expense item relates to the hiring of outside consultants to undertake works that require professional input relating to pumping requirements in the system.

Other – This category is included such that the Operator/Supervisor can add other items that are unique to the location

Transmission and Distribution:

Items covered under this category relate to the operation and maintenance of all the water transmission and distribution system including the operation and maintenance of reservoirs/storage tanks, customer services/laterals and fire hydrants (if installed). These may include:

Wages and Benefits – This expense item is the estimated cost for staff to maintain and operate the water distribution network. Staff time could relate to locating and repairing leaks in distribution pipes including service laterals, routine maintenance of pressure reducing valves, maintenance and repair of reservoirs/storage tanks and any hydrants that may be installed in the water system. Benefits relate to overheads including matching contributions for income tax, CPP, EI, health plans and vacations are included.

Maintenance of Water Mains including Valves– This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining the water transmission and distribution pipes including valves. This item might include routine maintenance such as valve exercising and watermain flushing, location and repair of leaks, any outside contractors who provide backhoes/excavators and/or other equipment to name a few.

Maintenance of Service Laterals to the Property Boundary – This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining and repairing service laterals to customer properties including location of shut off valves on water mains and curb shut off valves at the property boundary and any outside contractors who provide backhoes/excavators and/or other equipment.

Maintenance of Water Reservoirs and Storage Tanks – This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining and repairing all water reservoirs and storage tanks in the water distribution system. This item might include routine inspection for leaks, repairs to structures, and maintenance of altitude valves and any outside contractors who provide backhoes/excavators and/or other equipment to name a few.

Maintenance of Hydrants including Hydrant Valves – This expense item relates to expenses, other than Wages and Benefits, that pertain to maintaining hydrants (if installed) in the distribution system. This item might include routine maintenance such as painting, leak repairs, exercising hydrant valves and any outside contractors who provide backhoes/excavators and/or other equipment to name a few.

Cell Phones and Dedicated Communication Lines – This expense is to cover the cost of providing cell phones and any dedicated communication lines that may exist in the water distribution system.

Supplies/Materials/Tools and Equipment – This expense is to cover the cost of routine supplies, materials, tools and equipment that are required for the operation of the water distribution system.

Leak Detection – This expense is to cover the cost of leak detection services provided by outside service providers.

Vehicle Expense Including Vehicles and Operating Costs – This expense is to cover the cost of providing vehicles including operating costs that are required for the operation and maintenance of the distribution system. If dedicated vehicles are not required this expense item should be used for any travel expenses associated with the water distribution system.

Professional Services – This expense item relates to the hiring of outside consultants to undertake works that require professional input relating to pumping requirements in the system.

Other – This category is included such that the Operator/Supervisor can add other items that are unique to the location

Administration and General:

Items covered under this category relate the overall administration of the water system including customer service, billing, annual audits and the provision of insurance.

Wages and Benefits – This expense item is the estimated cost for staff to administer the water system. Staff time could relate to receiving and directing phone calls, preparation of bills for the water service, collection of bills, annual audit and provision of insurance. Benefits relate to overheads including matching contributions for income tax, CPP, EI, health plans and vacations are included.

Administrative Office/Phones/Billing/Supplies - This expense item relates to expenses, other than Wages and Benefits, that pertain to operating the administration office. This item might include office space, office supplies, postage, computer allowance including software, phones, billing and miscellaneous office supplies to name a few.

Allowance for Doubtful Accounts – This expense is to cover the cost of doubtful accounts or bills that have been issued and payment is doubtful.

Rents/Building Operation/Maintenance – This expense is to cover the cost of any building, or part of a building that are provided for the operation of the water system.

Liability and Facility Insurance – This expense is to cover the cost of any insurance required for the operation of the water system.

Regulatory/Legal/Auditor – This expense is to cover the cost of any regulatory requirements such as water rights, legal advice and audit services required by the water system.

Professional Services – This expense item relates to the hiring of outside consultants to undertake works that require professional input relating to pumping requirements in the system.

Other – This category is included such that the Operator/Supervisor can add other items that are unique to the location.

Existing Revenue

On this page, enter all sources of revenue related to the water supply system. For communities that have Water and Sewer Taxes, the revenue generated that goes towards the sewer system should be removed from the amount. This can be approximated in the tool by selecting the approximate percentage of Water and Sewer taxes that is invested in sewer operation and maintenance.

PART 1	
<u>Existing Revenue</u>	
Revenue	
<u>Water Taxes</u>	
Enter the number of customers that pay Water Taxes:	<input type="text" value="260"/>
Enter the annual water rate/water tax charged to each customer:	<input type="text" value="\$180"/>
<u>Water and Sewer Taxes</u>	
Enter the number of customers that pay Water & Sewer Taxes:	<input type="text"/>
Enter the annual Water & Sewer Tax rate charged to each customer:	<input type="text"/>
Select the approximate percentage of the tax that funds <u>sewer</u> operations:	<input type="text"/>
<u>Other Sources of Revenue</u>	
If industrial/commercial customers are charged a different rate:	
- Enter the number of commercial/industrial customers charged at this rate	<input type="text"/>
- Enter the rate charged to each industrial/commercial customer	<input type="text"/>
Enter the total revenue generated from any other sources:	<input type="text"/>
Total Revenue <input type="text" value="\$46,800"/>	
Previous Page	Next Page

1.4


Part 1 Results

This page displays the results of the analysis of the community's existing operation and maintenance budget. The page is divided into three sections. The first section examines the existing balance, comparing the current total revenue with total expenditures. For system achieving full cost recovery, the balance should be zero.

In the second section, the tool compares the actual expenditures entered by the user with a recommended value that is calculated by the Tool based on the user inputs. The recommended investment includes the costs for operating a preventive maintenance program and includes labour costs.

The third section compares the existing water tax rate with the amount that should be charged to customers to fund existing water supply system operation and maintenance. It also provides a recommended tax that would allow full cost recovery if the community were to increase water supply system related expenditures to the recommended investment level.

It should be noted that the Minimum Tax to Fund Recommended Investment may be substantially higher than the community's current tax. This does not mean that it should be disregarded because it is excessive, but instead is intended to indicate that the amount being spent on the system should be increased in order to provide a more reliable and safe water supply. Community representatives should evaluate where additional money could be spent to improve operations.

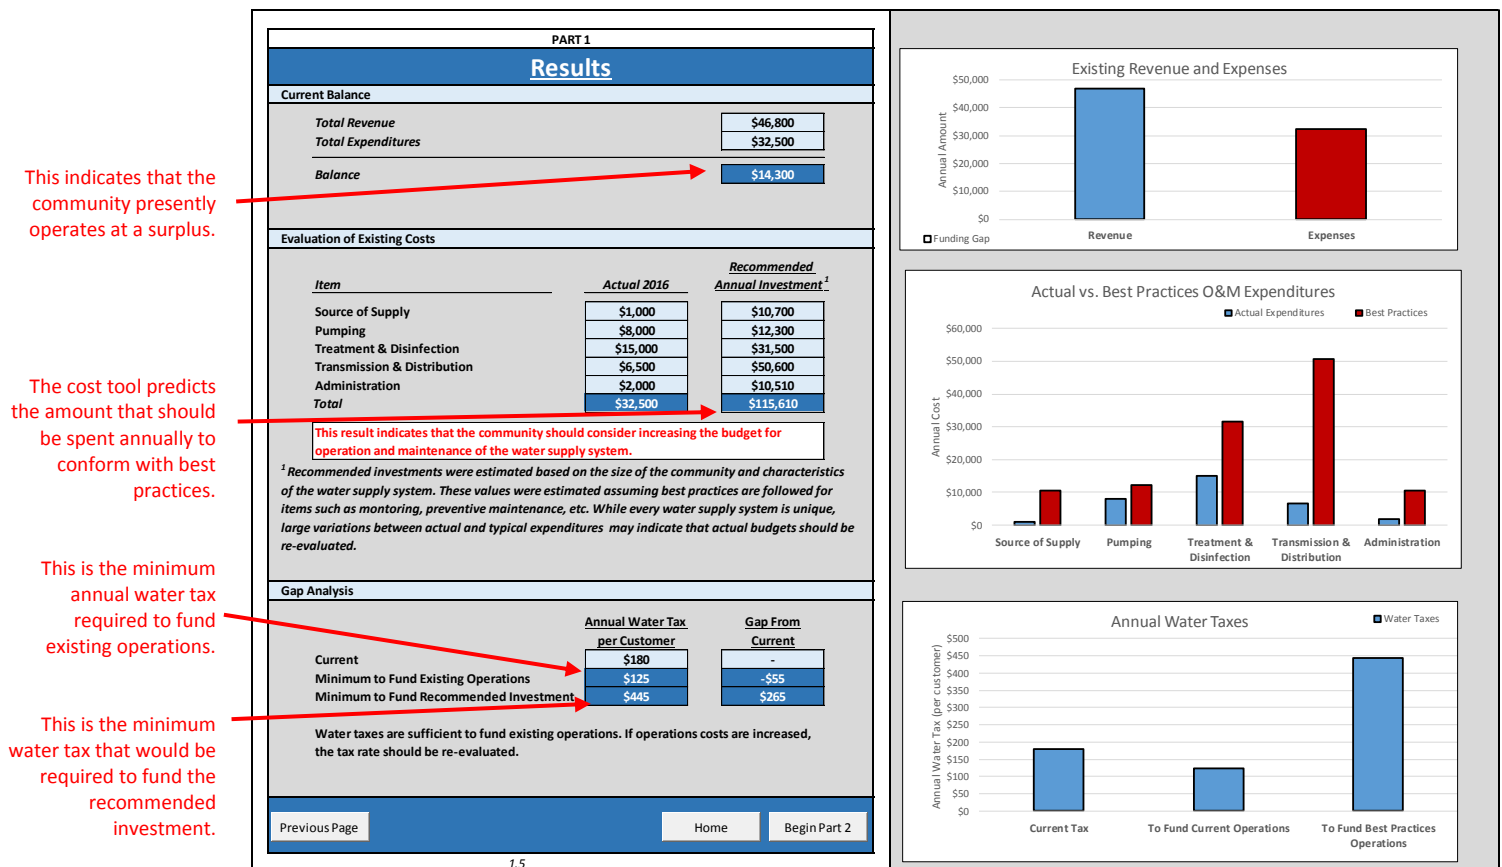

Part 2 – Analysis of Upgrade Costs

This section of the Full Cost Accounting Assessment Tool is for communities that are considering upgrades to their water supply system. Enter information to describe the proposed upgrades as well as the existing components that will remain in operation. From the information, the Tool will use cost ratings curves to generate an opinion of capital and operation and maintenance costs. The Full Cost Accounting Assessment Tool will then calculate a water tax that would allow the community to achieve full cost recovery.

If a cost estimate for an upgrade has already been developed by an engineer or other qualified professional, this value should be entered in the Upgrade Costspace, as such costs are considered to be more accurate than the costs predicted by the tool.

Costs predicted by the Full Cost Accounting Assessment Tool do not include: Provincial or Federal sales or service taxes, depreciation, or existing non-operating expenses such as debt servicing.

If a particular type of upgrade is not included in the tool, the user should enter the value manually on the upgrade costs page. Operation and maintenance costs for items entered manually will not be captured by the Full Cost Accounting Assessment Tool, and therefore, the user should keep this in mind when evaluating the recommended future water tax result.

Design Parameters

The user should enter information about the community size and the typical water consumption in the community. If flow data is not known, then the population data will be used by the Tool to estimate typical water flows. Because of leaks, industrial demands, and other unforeseen sources of consumption, actual flows may be significantly larger than those estimated by the Tool. Therefore, it is best to enter real flow data where it is available.

The user is then prompted to enter the design life for the facility and select an annual population growth rate. These two parameters are used to predict a future population for which the treatment facility must be capable of servicing. The user has the option of entering recent census data into a table for the Tool to suggest a

Part 2

Design Parameters for Upgrades

Design Parameters for Proposed Facility

Enter the number of people who will be serviced by the new system. If flow data is available, enter it in the fields below and select the correct flow units. If flows are not known, leave the fields blank and flows will be estimated by assuming per capita consumption of 340 L/p/d.

	Value	Units	Flow (m3/d)	Per Capita Use (L/p/d)
Population Served	570			
Average Flow	93	usgpm	507	889
Maximum Day Flow	144	usgpm	785	1377
Peak Flow		<Units>		

Select the design life (in years) for the new facility: ☐ 15 ☐ 20 ☒ 25 ☐ 30

The new treatment facility will need to have capacity to service the existing population, as well as the population at the end of the system's service life. Enter population data from the most recent three censuses below in order to determine population growth rate:

Census Year	Population
2016	481
2011	570
2006	

The census data indicates that the population of the community has declined by approximately -3.1% per year.

Select an Annual Population Growth Rate (%) for the system's service life:

-2.00%

-1.75%

-1.50%

-1.25%

-1.00%

-0.75%

Based on the data above, the design parameters are as follows:

	Current		Year 2042	
Population:	570		443	
Avg. Day Flow:	507 m3/d	889 L/p/d	507 m3/d	889 L/p/d
Max. Day Flow:	785 m3/d	1377 L/p/d	785 m3/d	1377 L/p/d
Peak Hour Flow:	1394 m3/d		1394 m3/d	

Previous Page

Next Page

2.2

15

growth rate.

At the bottom of the page, the Tool lists the current and future design parameters, which include flows and population.

Proposed WTP

On this page, the user enters all information about the water treatment facility, including the existing equipment that will continue to be used after the upgrades, as well as the new components that will be added. The user must also select whether a new building will be required to hold any processes. In some cases a new building may be constructed for a new treatment process, and existing equipment may be moved into that building. In other cases, new equipment might be installed within an existing space within the treatment building. It is up to the user to identify how the new system will be configured.

The first box is related to disinfection system. The user must select the type of chlorine disinfection system that will be included after the community has completed the upgrades. The user must also select whether this will be a new disinfection system or an existing one.

The second box is for additional treatment processes, such as UV disinfection, pH adjustment, and filtration. The user must select whether the equipment will be new, existing, or not included. Click the “Description of Treatment Systems” for additional information about the treatment processes. Information is also listed below:

- *pH Adjustment – Chemicals are added to increase pH in the distribution system for controlling corrosion.*
- *Inline pressure filtration – Uses media in vessels to reduce turbidity and remove particles from the drinking water.*
- *Iron or Manganese removal – For communities that have elevated concentrations of iron or manganese in their raw water. In Newfoundland and Labrador, the MAC for iron is 0.3 mg/L and the MAC for manganese is 0.05 mg/L.*
- *Arsenic Removal – For communities that have elevated concentrations of arsenic in their raw water. In Newfoundland and Labrador, the MAC for arsenic is 0.01 mg/L.*
- *Membrane Filtration – This is a physical treatment process that uses membranes to remove turbidity, particles, and organics. May reduce disinfection by-products and colour in the water.*
- *Conventional WTP – Is a chemical based process for removing turbidity, particles and organics from the raw water. Can be used to reduce disinfection by-products and colour in the water.*
- *Potable Water Dispensing Units (PWDUs) – suitable alternatives for smaller communities. The units include treatment, disinfection, and dispensing systems. Members of the community collect water for potable use from the units. Other non-potable uses are met through traditional distribution systems.*

Upgrades: Description of Proposed Treatment

Proposed Disinfection System

What type of chemical disinfection system will be used?

- ☐ Sodium Hypochlorite (liquid chlorine)
☒ Chlorine Gas
☐ Onsite Generated Sodium Hypochlorite (Mixed oxidants)
☐ Calcium Hypochlorite

Description of Disinfection Systems

Will existing disinfection equipment be used or will new equipment be purchased?

- ☐ New
☒ Existing

Proposed Treatment Process

Specify the processes that will be included, whether the equipment will be new or existing.

Note: Only select the processes that are included.

Treatment Process	Equipment	Description of Treatment Systems
UV Disinfection System	<input type="radio"/> Not included <input checked="" type="radio"/> New <input type="radio"/> Existing	
pH Adjustment System	<input type="radio"/> Not included <input type="radio"/> New <input checked="" type="radio"/> Existing	
Inline Pressure Filtration	<input checked="" type="radio"/> Not included <input type="radio"/> New <input type="radio"/> Existing	
Iron / Manganese Removal	<input type="radio"/> Not included <input checked="" type="radio"/> New <input type="radio"/> Existing	
Arsenic Removal	<input checked="" type="radio"/> Not included <input type="radio"/> New <input type="radio"/> Existing	
Membrane Treatment	<input checked="" type="radio"/> Not included <input type="radio"/> New <input type="radio"/> Existing	
Conventional WTP	<input checked="" type="radio"/> Not included <input type="radio"/> New <input type="radio"/> Existing	
PWDU	<input checked="" type="radio"/> Not included <input type="radio"/> New <input type="radio"/> Existing	

New Treatment Plant Building

Will a new building be required? ☒ Yes ☐ No

If a new building is required, select the processes that will need to be housed in the new building?
 In this list below, do not select processes that will be housed in an existing building.

- ☐ Chlorine Disinfection system (Sodium hypochlorite, chlorine gas, other)
☐ UV Disinfection System
☐ pH Adjustment System
☐ Inline Pressure Filtration
☒ Fe and/or Mn Removal
☐ As Removal
☐ Membrane Treatment
☐ Conventional WTP
☐ PWDU

Yard Piping

Yard piping is defined as the in-ground piping constructed at the treatment facility site. Do not include distribution system upgrades here, as there is a separate page for those upgrades.

Enter the length of piping connecting the new water WTP to the nearest point in the distribution system. If unknown, the program assumes 20 m.

m

If the treatment plant will require a connection to the wastewater collection system, enter the distance to the nearest point in the collection system.

m

Note: if a conventional water treatment process is being used, a connection to the collection system is required. This program assumes that the facility can be connected to the sewer system using a gravity collection system.

Previous Page

Next Page

This indicates that the community will continue to use their existing pH adjustment system after the upgrades are completed

Click this button to be directed to a detailed description of the treatment equipment

This indicates that the upgrades include the installation of new iron and/or manganese removal equipment

By not selecting these boxes, the user has indicated that the new UV disinfection system and existing pH adjustment system will be operated within an existing building

In this case, the upgrades will include a new building to house the Iron and/or Manganese removal equipment.

The final box on the page is used for entering information about yard piping at the treatment facility site.

Proposed Pumping

On this page, the user enters information about the types of pumps that will be included after the system has been upgraded. Pumping systems are defined below:

- *Well Pump – are submersible pumps installed within a well. Well pumps convey ground water to a well house, where water is disinfected and treated. This tool assumes that the flow remains pressurized through the well house and into the distribution system.*
- *Low Lift Pump – are pumps that are used to pump surface water from a surface water supply up to a treatment building.*
- *High Lift Pump – any pump that feeds water from a treatment building up to a distribution system.*

A selector button has also been provided to indicate if pumps are being installed within a new building or new addition to a building. This could include pumps that are being housed in a new building that is being constructed for other treatment processes or in a dedicated pump building.

Description of Distribution System Upgrades

On this page, the user will indicate if upgrades are being completed in the distribution. This could include the installation of new water main, new hydrants, valves, or a new treated water storage tank. This page may be skipped if the upgrades do not include any work in the distribution system.

For facilities adding a storage tank, the user must indicate whether or not a fire storage component is being provided. This is a decision that must be made by the community when planning their water supply system. Should the community require fire storage, this will need to be added by the user by selecting a fire flow rate and a fire flow duration. If the user is unaware of these values, then they may be left blank, and the Tool will assume these values.

For communities that have elected to provide fire protection through their potable water supply system, fire flow requirements should be established through the appropriate Insurance Advisory Organization.

Upgrade Costs

The user should enter the number of customers that are presently connected the water supply system and the current annual water tax. The user must then select whether the capital costs used in the tool are calculated by the Tool, or entered manually based on a cost estimate that was provided by an engineer. If an assessment has been completed by an engineer, this data is considered to be more reliable than the value generated by the tool, and therefore it should be used. If an assessment has not yet been completed by an engineer, the Tool can estimate a value for the purposes of identifying potential water tax requirements to fund the operation of the upgrades.

If the community is likely to receive funding for the upgrades, the user may select the amount of funding that is likely to be provided. The tool then displays the approximate amount that could be covered by the community, as well as the operation and maintenance costs associated with the operation and maintenance.

If a site specific cost estimate has been completed by an engineer or qualified person, the value should be entered here. If a site specific cost estimate has not been completed, then the user may use the predicted cost generated by the tool.

These are the predicted capital and operation and maintenance costs generated by the Full Cost Accounting Assessment Tool

Part 2

Cost Curve Predictions

Predicted Capital Costs for Upgrades

Enter the number of customers on the water supply system: 260

Enter the current Water Tax: \$180

Has a cost estimate for the proposed upgrades been developed through an engineering study?

☐ Yes, the estimate is:

☒ No, have the tool calculate an approximate value based on historical data.

Note: Estimates obtained through an engineering study are considered to be more reliable than the values generated by this program, which are based on cost data from previous projects in the Province.

Enter the fraction of the capital cost will be covered by government funding: 90%

Note: Project funding is reduced by the amount of GST rebate due to the community if the full project costs are expended. The community is responsible for applying for the appropriate rebates and interim financing of the rebates.

Upgrade Component	Capital Cost	Government Contributions	Balance Covered by Community
Water Treatment Facility	\$1,321,000	\$1,188,900	\$132,100
Pumping Systems			
Distribution			
Storage	\$1,073,000	\$965,700	\$107,300
Range of Probable Cost			
-30%	\$1,675,800	\$1,508,220	\$167,580
Median	\$2,394,000	\$2,154,600	\$239,400
+30%	\$3,112,200	\$2,800,980	\$311,220

Notes:

- The values above do not include taxes or take into account any site specific features, and were calculated based on historical costs from other projects.
- The values presented in the table above were calculated to demonstrate the potential impacts that proposed upgrades may have on the annual costs of operating the water supply system. For capital budgeting, an assessment should be conducted by an engineer or qualified person.

Predicted Operation and Maintenance Costs

Item	Predicted O&M Costs ¹
Source of Supply	\$10,700
Pumping	\$12,300
Treatment & Disinfection	\$62,200
Transmission & Distribution	\$82,600
Administration	\$16,780
Total	\$184,580

¹ Predicted O&M expenditures have been calculated based on the size of the community, characteristics of the water supply system, and the type of systems included in the proposed upgrade. These values were estimated assuming best practices are followed for items such as monitoring, preventive maintenance, etc.

Previous Page
Next Page

Financing

Enter the amount of funds that the community has reserved for the upgrades. The user will then enter terms of financing so the tool can calculate annual debt servicing costs. The user must specify the duration of a loan, the anticipated interest rate on any borrowed funds, and whether the loan will be paid through blended payments or serial payments. These are described below:

- *Blended payments is a loan repayment method where the loan is repaid in equal instalment amounts over the entire period of the loan*
- *Serial payments – is a loan repayment method where the principal is paid in equal amounts over the entire period of the loan. Interest payments decrease each period, meaning the highest annual payment is in the first year of the loan.*

The Tool generates several values and figures. It lists the current annual water tax per household and the number of customers. It then specifies the annual water tax that would need to be paid per household in the first year after the upgrades have been completed. The water tax was calculated to pay operation and maintenance costs of the system, and the loan repayment for the upgrades.

The figures show the annual loan payments over the design period, as well as the total operation and maintenance costs and water taxes.