



Real-Time Water Quality Report

Waterford River

@

Kilbride

NF02ZM0009

Deployment Period
September 17 to October 23, 2014



Government of Newfoundland & Labrador
Department of Environment and Conservation
Water Resources Management Division

Prepared by:

Kelly Maher
Environmental Scientist
Water Resources Management Division
Department of Environment & Conservation
Phone (709) 896 - 5542
Fax (709) 896 - 9566
kellymaher@gov.nl.ca

General

- The Water Resources Management Division monitors real-time water quality data on a daily basis.
- The instrument used for the deployment period of September 17 to October 23, 2014 was a YSI 6600 series multi-probe, which continuously measured water temperature, pH, dissolved oxygen, specific conductivity and turbidity.
- The instrument was deployed for 37 days.
- Upon deployment a grab sample was taken and submitted to EXOVA laboratory for analysis (Sample ID: 2014-1903-00-SI-SP).

Quality Assurance and Quality Control

- As part of the Quality Assurance and Quality Control (QA/QC), an assessment of the reliability of data recorded by the instrument is made at the beginning and end of the deployment period.
- This procedure is based on the approach used by the United States Geological Survey and is outlined in Appendix A.
- At deployment and removal, a QA/QC Sonde is temporarily deployed alongside the Field Sonde.
- Values for temperature, pH, conductivity, dissolved oxygen and turbidity are compared between the two instruments.
- Based on the difference between the parameters measured on the Field Sonde and the QA/QC Sonde at deployment and removal, a qualitative statement is made on the data quality (Table 1).

Table 1: Instrument Performance Ranking classifications for deployment and removal

Parameter	Rank				
	Excellent	Good	Fair	Marginal	Poor
Temperature (°C)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	<+/-1
pH (unit)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Sp. Conductance (µS/cm)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Sp. Conductance > 35 µS/cm (%)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Dissolved Oxygen (mg/L) (% Sat)	<=+/-0.3	>+/-0.3 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Turbidity <40 NTU (NTU)	<=+/-2	>+/-2 to 5	>+/-5 to 8	>+/-8 to 10	>+/-10
Turbidity > 40 NTU (%)	<=+/-5	>+/-5 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20

- It should be noted that the temperature sensor on any sonde is the most important. All other parameters can be divided into subgroups of: temperature dependant, temperature compensated and temperature independent.
- Due to the importance of this parameter it is necessary for temperature to stabilize first, if a reading is taken too soon it may not accurately portray the water body.
- Deployment and removal instrument performance rankings for the station at Waterford River at Kilbride for the period of September 17 to October 23, 2014 are summarized in Table 2.

Table 2: Instrument performance rankings for Waterford River at Kilbride

Station	Date	Action	Comparison Ranking				
			Temperature	pH	Conductivity	Dissolved Oxygen	Turbidity
Waterford River	September 17, 2014	Deployment	Excellent	Excellent	Excellent	Good	Excellent
	October 23, 2014	Removal	Excellent	Excellent	Excellent	Fair	Excellent

- During the deployment at Waterford River at Kilbride Station, temperature, pH, conductivity, and turbidity ranked as ‘excellent’. With dissolved oxygen ranking as ‘good’.
- At removal, temperature, pH, conductivity, and turbidity ranked as ‘excellent’. With dissolved oxygen ranking as ‘fair’.

Data Interpretation

- Performance issues and data records were interpreted, for each station during the deployment period, for the following eight parameters:
 - Temperature (°C)
 - pH
 - Stage (m)
 - Flow (m³/s)
 - Specific conductivity (µS/cm)
 - Total dissolved solids (g/l)
 - Dissolved oxygen (mg/l or % saturation)
 - Turbidity (NTU)
- With the exception of water quantity data (stage & flow), all data in the preparation of the graphs and subsequent discussions below adhere to this QAQC protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request.
- A brief description of each parameter is provided in Appendix B.

Water Temperature

Water temperature ranged from 7.60 °C to 17.86 °C during this deployment period (Figure 1). There are noticeable increases and decreases in the water temperature during the deployment period. This is consistent with ambient air temperatures recorded by Environment Canada at the St. John's International Airport weather station over this time period, generally increasing during daylight hours and cooling overnight (Appendix C).

The water temperatures at this station display diurnal variations. Shallow streams and ponds are highly influenced by natural diurnal variations in the surrounding air temperatures.

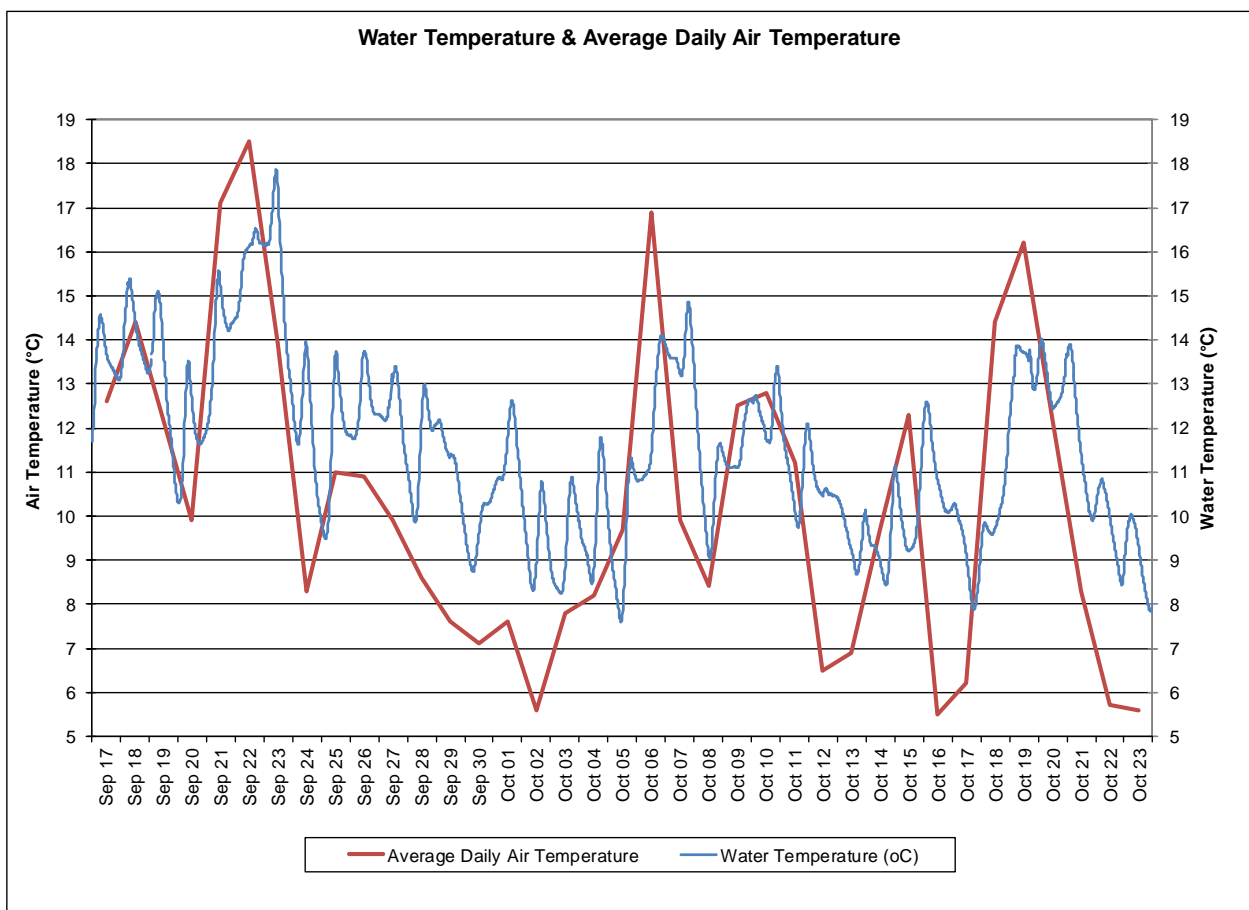


Figure 1: Water temperature (°C) values at Waterford River at Kilbride Station and daily air temperature at St. John's International Airport

pH

Throughout this deployment period pH values ranged between 7.07 pH units and 7.86 pH units (Figure 2).

The CCME guideline for the Protection of Aquatic Life provides a basis by which to judge the overall health of the river. The pH at the station remained between the CCME guidelines of 6.5 to 9.0 with a median value of 7.29 over the deployment period.

Photosynthesis uses up hydrogen molecules, which causes the concentration of hydrogen ions to decrease and therefore the pH to increase. For this reason, pH may be higher during daylight hours and during the growing season, when photosynthesis is at a maximum.

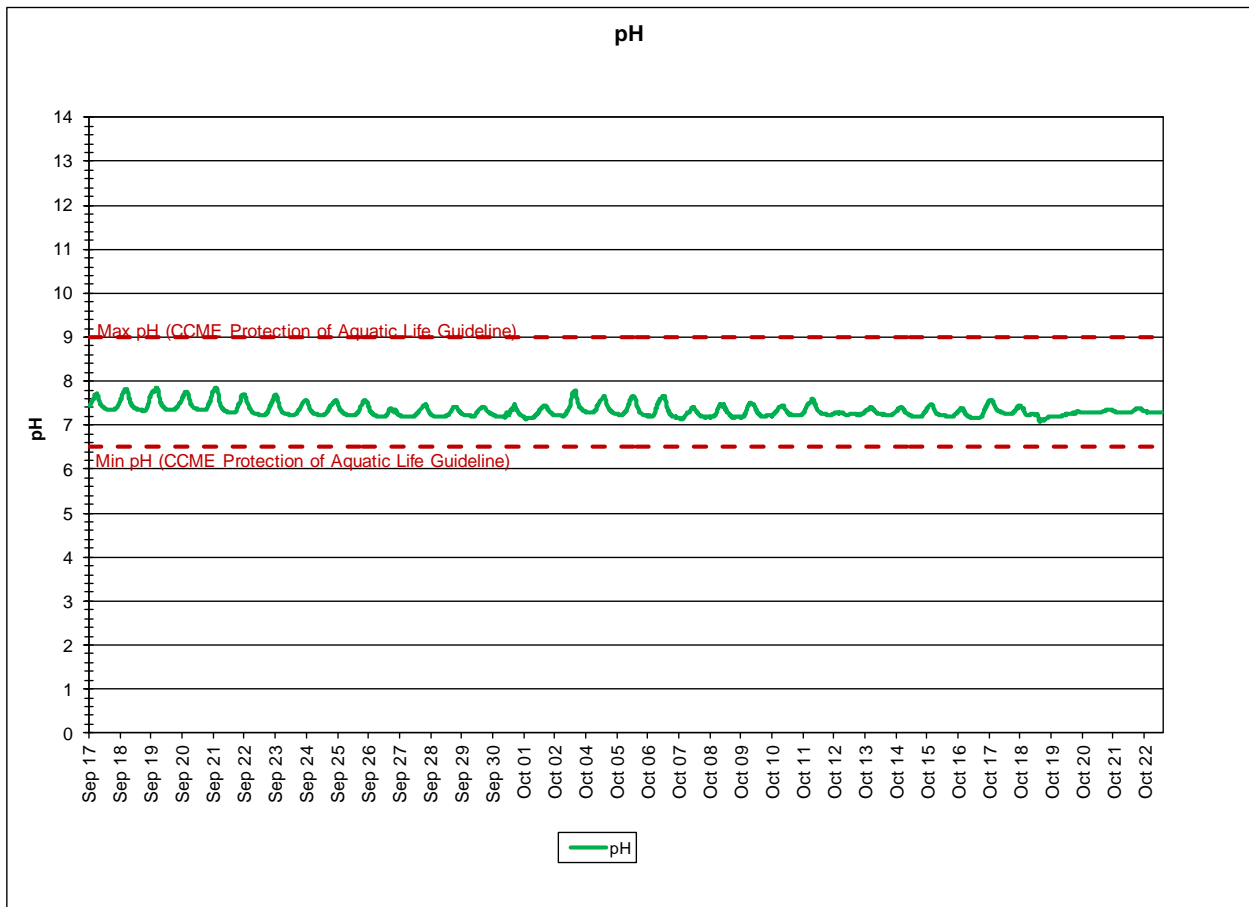


Figure 2: pH levels at Waterford River at Kilbride Station

Specific Conductivity & TDS

The conductivity levels were between 119.0 μ S/cm and 561.0 μ S/cm and the Total Dissolved Solids (TDS) ranged from 0.0770g/L to 0.3650g/L during the deployment period.

When stage levels rise, the specific conductance levels drop in response as the increased amount of water in the river system dilutes the solids that are present.

Significant rainfall events created multiple spikes in stage level in the Waterford River throughout the deployment period (Appendix C). These spikes in stage level coincide with a decrease in specific conductivity and TDS.

TDS, is a parameter that the instrument calculates by an algorithm that utilizes the data from specific conductivity and water temperature to produce a TDS value. TDS generally always mirrors specific conductivity as seen in Figure 3.

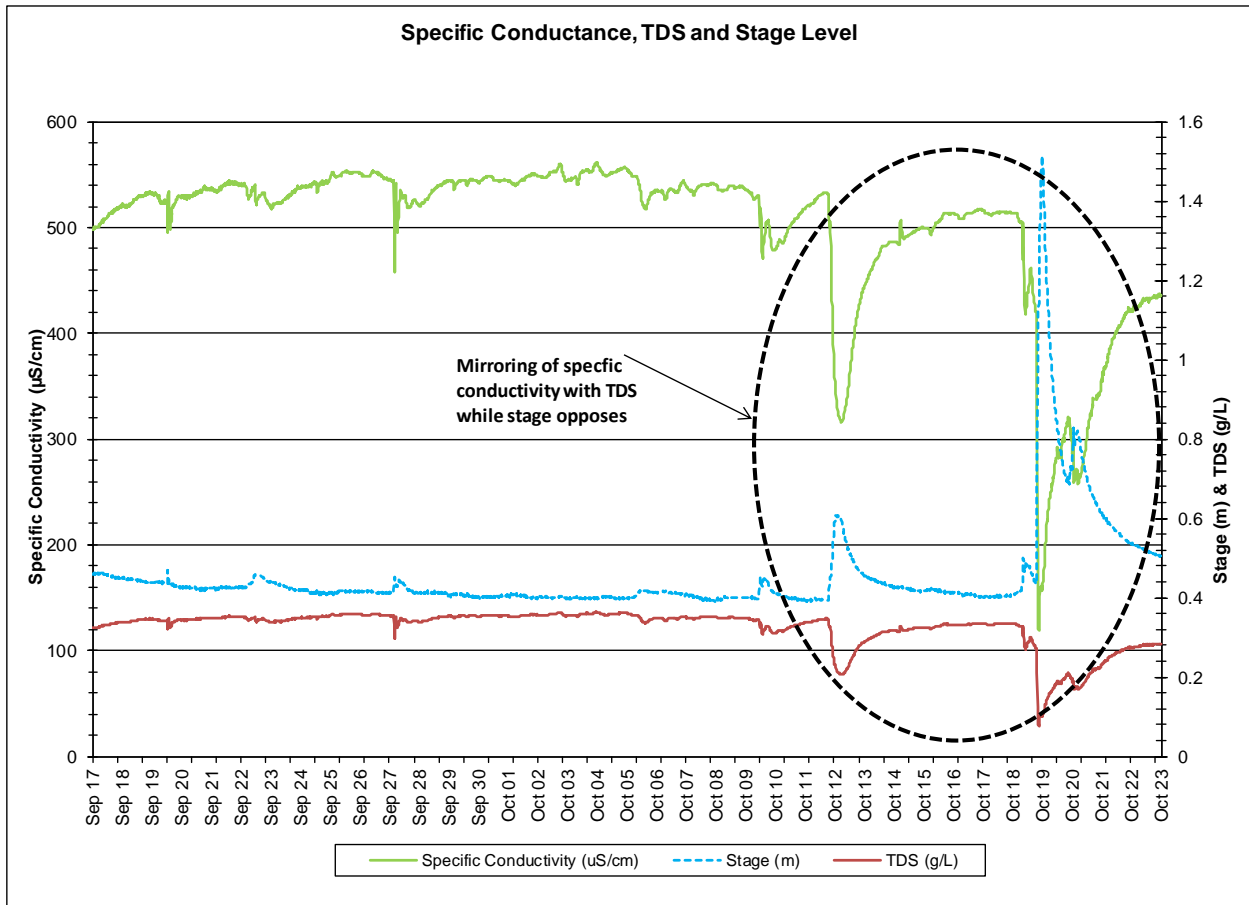


Figure 3: Specific conductivity (μ S/cm), TDS (g/L) and stage (m) values for Waterford River at Kilbride Station

Dissolved Oxygen

The dissolved oxygen concentration was between 9.43 mg/L and 12.90 mg/L and the dissolved oxygen percent saturation was between 94.8 % and 113.8% during the deployment period.

The water quality instrument measures dissolved oxygen (mg/L) with the dissolved oxygen probe and then the instrument calculates percent saturation (% Sat) with water temperature.

During this deployment the dissolved oxygen concentration only dipped below the CCME guidelines for the Protection of Early Life Stages for a brief period on September 22nd and 23rd. The median value over the deployment period was 11.16 mg/L and 100.6 % saturation.

There is an evident relationship between water temperature and dissolved oxygen. As water temperature decreases the level of dissolved oxygen consumed decreases, which means there is slightly more dissolved oxygen in the river during these cooler temperatures. This is displayed by the trend lines on the dissolved oxygen (mg/L) and water temperature data (Figure 4). Over the course of the deployment period there is a gradual decrease in water temperature due to seasonal changes in air temperature while a gradual increase in dissolved oxygen is noted due to the colder temperatures.

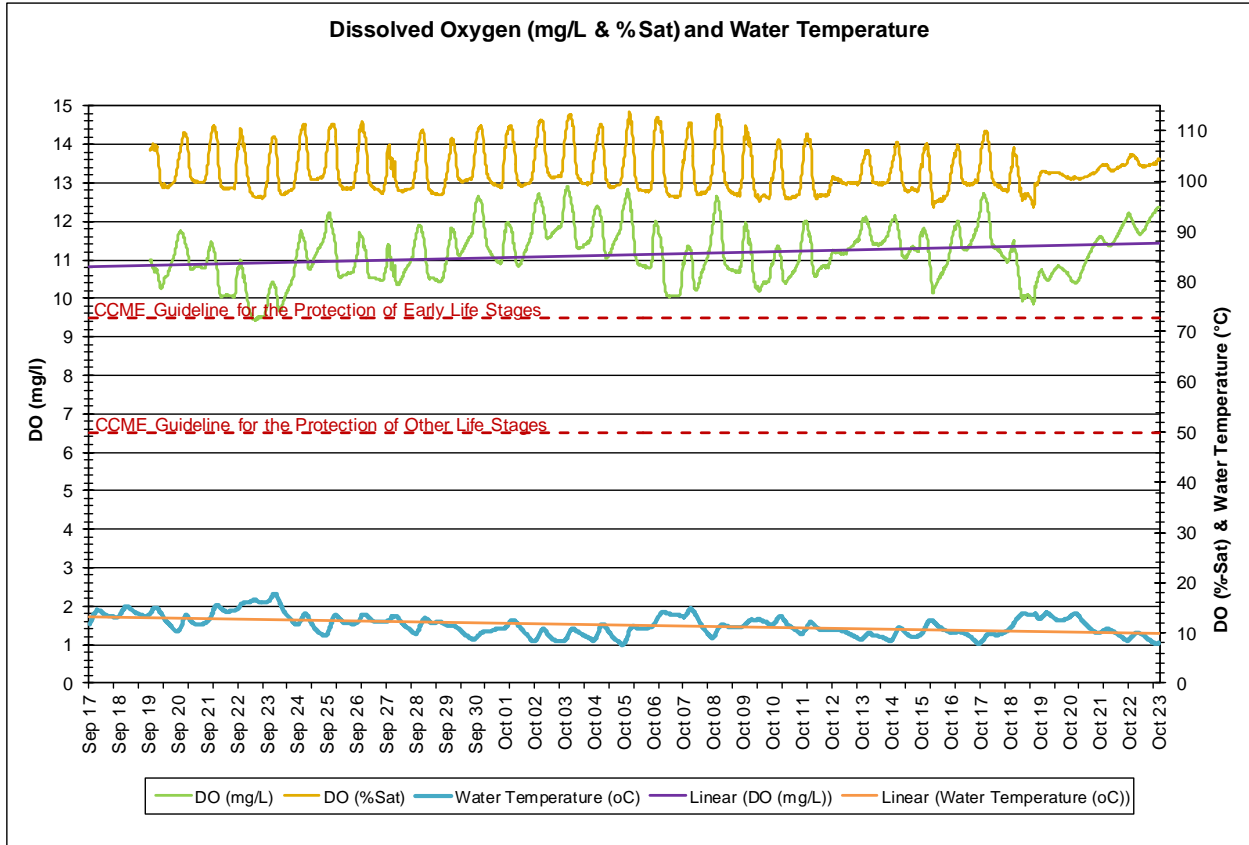


Figure 4: Dissolved Oxygen (concentration and percent saturation) at Waterford River at Kilbride Station

Turbidity, Stage, & Precipitation

Turbidity levels during this deployment period ranged within 0.0 NTU and 149.1 NTU (Figure 4). The median turbidity during the deployment period was 1.8 NTU.

The turbidity sensor on this instrument can read turbidity values between 0 NTU and 3000 NTU. However a turbidity reading of 3000 NTU is always identified as an error reading and should not be used as a valid reading or included in any statistical analysis.

Most of the turbidity events in the deployment period correlate with increases in stage from precipitation events. Precipitation can increase the presence of suspended material in water as seen clearly on October 12th and 19th. Some spikes in turbidity can be associated with fouling of the sensor. On occasion the sensor becomes covered in sediment on the riverbed causing periods of turbidity spikes as indicated in Figure 5 and 6.

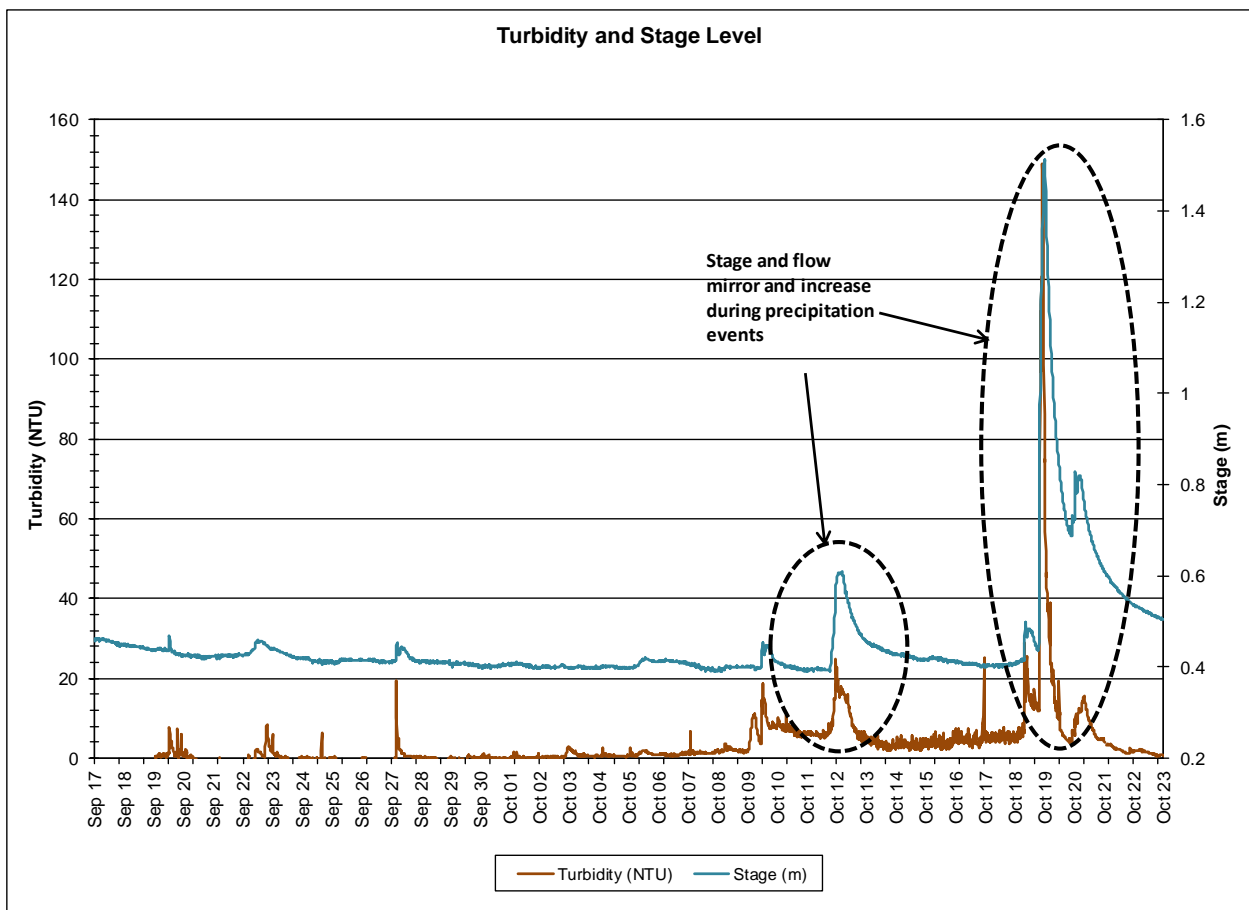


Figure 5: Turbidity (NTU) and Stage Level (m) at Waterford River at Kilbride Station

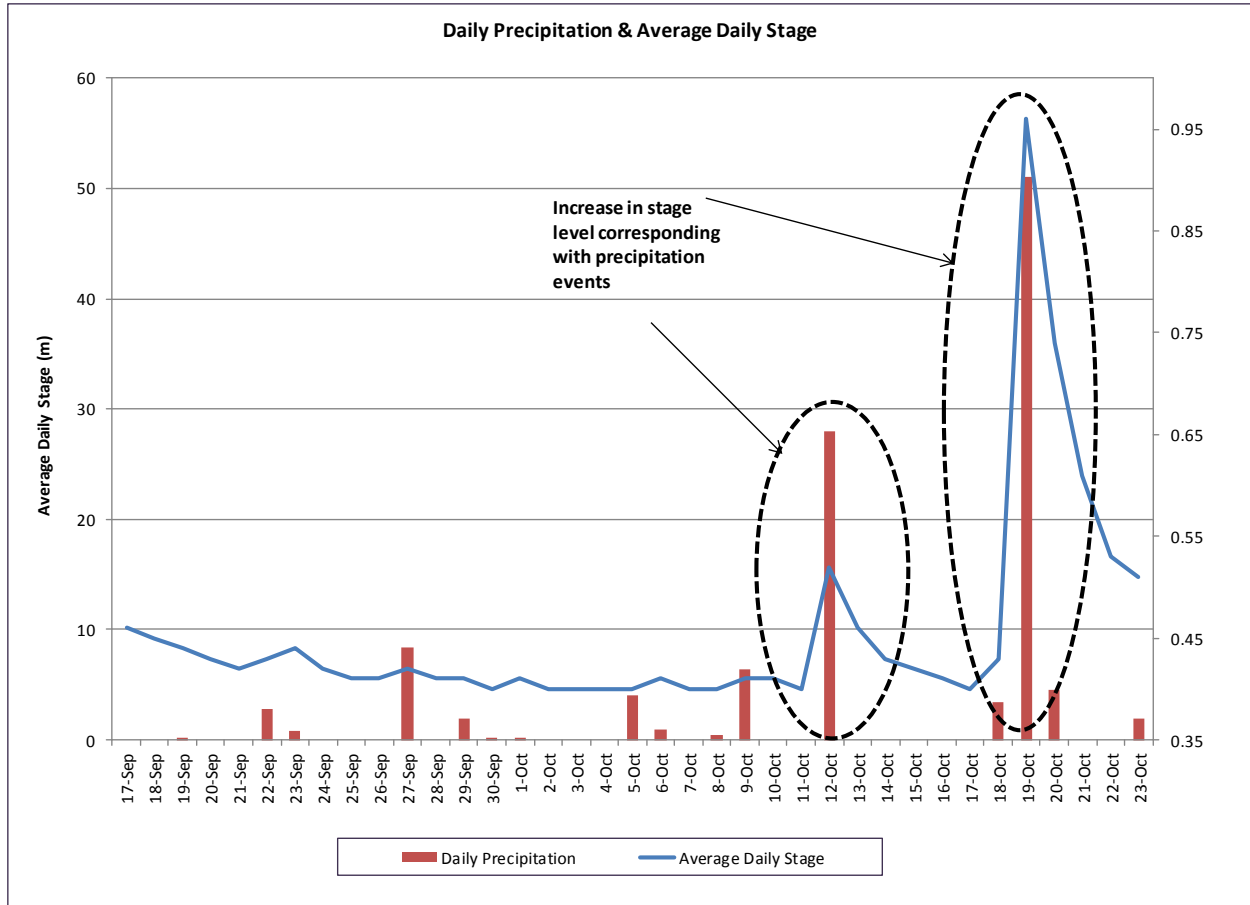


Figure 6: Average daily stage (m) at Waterford River at Kilbride Station and Daily Precipitation (mm) at St. John's International Airport

Stage & Stream Flow

Stage can be defined as the height or elevation of the stream's water surface above a reference elevation (sea level, gage level). Stage is important to display as it provides an estimation of water level at the station and can explain some of the events that are occurring with other parameters (i.e. Specific Conductivity, DO, turbidity).

Stream flow can be defined as the volume of water in a river at a specific location and time. It is measured in cubic meters per second.

Stage and Stream flow will increase during rainfall events and during any surrounding snow or ice melt as runoff will collect in the river. However, direct snowfall will not cause them to rise significantly. During the deployment period, the stage values ranged from 0.39m to 1.513m. The stream flow values ranges from 0.478 m³/s to 25.109m³/s. The larger peaks in stage and stream flow do correspond with substantial rainfall events as noted on Figure 7 and in Appendix C.

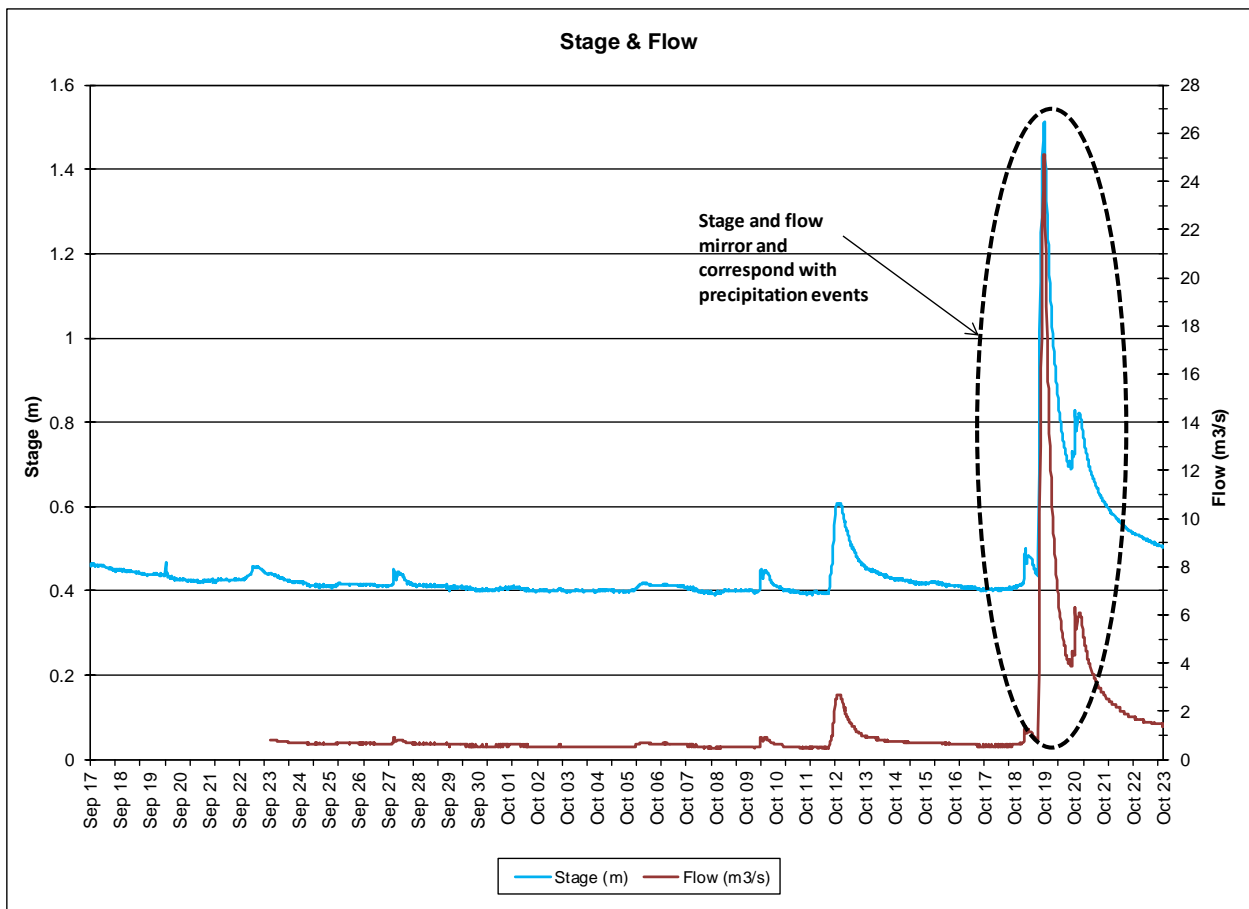


Figure 7: Stage and Flow at Waterford River at Kilbride Station

Conclusion

- As ambient air temperatures decrease with the seasonal changes it is reflected in the water temperature. Diurnal water temperature patterns are also noted with the increasing temperatures during sunlight hours.
- The data shows evidence that large spikes in stage level were a result of several rainfall events as displayed in Figure 5 & 6. Rainfall events can also influence changes in water temperatures, conductivity, pH, DO and turbidity in the water column.
- pH values during the deployment were quite stable with a median value of 7.29 pH units. All pH measurements were with the CCME recommended guideline range for the protection of aquatic life, of 6.5-9.0 pH units.
- Specific conductivity levels at the Waterford River monitoring station ranged from 119.0 μ S/cm and 561.0 μ S/cm and the Total Dissolved Solids (TDS) ranged from 0.0770g/L to 0.3650g/L during the deployment period.
- During the deployment period, the stage values ranged from 0.039m to 1.513m. The stream flow values ranged from 0.478m³/s to 25.109m³/s.
- During the deployment period the dissolved oxygen ranged from 9.43mg/L to 12.90 mg/L. As water temperature becomes colder entering the fall season there is less dissolved oxygen being used up and therefore increased concentration in the water.
- This river flows through significantly developed areas, including residential, commercial, and industrial zones within the boundaries of heavily used road ways, which can influence the water quality parameters in the areas of turbidity increases or conductivity increases when runoff from residential areas is a factor.

References

Canadian Council of Ministers of the Environment. 2007. Canadian water quality guidelines for the protection of aquatic life: Summary table. Updated December, 2007. In: Canadian environmental quality guidelines, 1999, Canadian Council of Ministers of the Environment, Winnipeg.

Online: <http://st-ts.ccme.ca/en/index.html?chems=154,162&chapters=1>

Swanson, H.A., and Baldwin, H.L., 1965. A Primer on Water Quality, U.S. Geological Survey.

Online: <http://ga.water.usgs.gov/edu/characteristics.html> (accessed August 24, 2010)

APPENDIX A

Quality Assurance / Quality Control Procedures

- As part of the Quality Assurance / Quality Control (QA/QC) protocol, the performance of a station's water quality instrument (i.e., Field Sonde) is rated at the beginning and end of its deployment period. The procedure is based on the approach used by the United States Geological Survey (Wagner *et al.* 2006)¹.
- At the beginning of the deployment period, a newly calibrated QA/QC water quality instrument (i.e., QA/QC Sonde) is temporarily deployed *in-situ* and along side the newly calibrated Field Sonde. A grab sample is also taken from the water body at this time and sent away to a laboratory for analysis. Field Sonde performance ratings for *temperature* ($^{\circ}\text{C}$) and *Dissolved Oxygen (% saturation)* are based on differences recorded by the Field Sonde and QA/QC Sonde. Field Sonde performance ratings for *specific conductivity* ($\mu\text{S}/\text{cm}$), *pH (unit)* and *turbidity (NTU)* are based on differences between Field Sonde readings and grab sample results.
- At the end of the deployment period, water quality parameters are recorded by the Field Sonde before and after a thorough cleaning of its probes. Error caused by *bio-fouling* (E_f) is assessed by comparing these readings with readings made by a newly calibrated QA/QC Sonde, which is temporarily deployed *in-situ* and along side the Field Sonde. An assessment of *instrument drift error* (E_d) is made during laboratory calibration of the Field Sonde, and the two error values are added to give an estimate of total error ($E_t = E_f + E_d$). If E_t exceeds a predetermined data correction criterion, a correction factor is applied to the dataset based on linear interpolation of E_t . The Field Sonde performance is also rated at the end of the deployment period, based on the E_t value.
- Performance ratings are based on differences listed in the table below.

Parameter	Rating				
	Excellent	Good	Fair	Marginal	Poor
Temperature ($^{\circ}\text{C}$)	$\leq \pm 0.2$	$> \pm 0.2$ to 0.5	$> \pm 0.5$ to 0.8	$> \pm 0.8$ to 1	$> \pm 1$
pH (unit)	$\leq \pm 0.2$	$> \pm 0.2$ to 0.5	$> \pm 0.5$ to 0.8	$> \pm 0.8$ to 1	$> \pm 1$
Sp. Conductance ($\mu\text{S}/\text{cm}$)	$\leq \pm 3$	$> \pm 3$ to 10	$> \pm 10$ to 15	$> \pm 15$ to 20	$> \pm 20$
Sp. Conductance $> 35 \mu\text{S}/\text{cm}$ (%)	$\leq \pm 3$	$> \pm 3$ to 10	$> \pm 10$ to 15	$> \pm 15$ to 20	$> \pm 20$
Dissolved Oxygen (mg/l) (% Sat)	$\leq \pm 0.3$	$> \pm 0.3$ to 0.5	$> \pm 0.5$ to 0.8	$> \pm 0.8$ to 1	$> \pm 1$
Turbidity < 40 NTU (NTU)	$\leq \pm 2$	$> \pm 2$ to 5	$> \pm 5$ to 8	$> \pm 8$ to 10	$> \pm 10$
Turbidity > 40 NTU (%)	$\leq \pm 5$	$> \pm 5$ to 10	$> \pm 10$ to 15	$> \pm 15$ to 20	$> \pm 20$

¹ Wagner, R.J., Boulger, R.W., Jr., Oblinger, C.J., and Smith, B.A., 2006, Guidelines and standard procedures for continuous water-quality monitors—Station operation, record computation, and data reporting: U.S. Geological Survey Techniques and Methods 1–D3, 51 p. + 8 attachments; accessed April 10, 2006, at <http://pubs.water.usgs.gov/tm1d3>

APPENDIX B

Water Parameter Description

Dissolved Oxygen - The amount of Dissolved Oxygen (DO) (mg/l or % saturation) in the water is vital to aquatic organisms for their survival. The concentration of DO is affected by such things as water temperature, water depth and flow (e.g., aeration by rapids, riffles etc.), consumption by aerobic organisms, consumption by inorganic chemical reactions, consumption by plants during darkness, and production by plants during the daylight (Allan 2010).

Flow – Flow (m³/s) is a measure of how quickly a volume of water is displaced in streams, rivers, and other channels.

pH - pH is the measure of hydrogen ion activity and affects: (i) the availability of nutrients to aquatic life; (ii) the concentration of biochemical substances dissolved in water; (iii) the efficiency of hemoglobin in the blood of vertebrates; and (iv) the toxicity of pollutants. Changes in pH can be attributed to industrial effluence, saline inflows or aquatic organisms involved in the photosynthetic cycling of CO₂ (Allan 2010).

Specific conductivity - Specific conductivity (μS/cm) is a measure of water's ability to conduct electricity, with values normalized to a water temperature of 25°C. Specific conductance indicates the concentration of dissolved solids (such as salts) in the water, which can affect the growth and reproduction of aquatic life. Specific conductivity is affected by rainfall events, the composition of inflowing tributaries and their associated geology, saline inflow (e.g., road salt), agricultural run-off and industrial inputs (Allan 2010; Swanson and Baldwin 1965).

Stage – Stage (m) is the elevation of the water surface and is often used as a surrogate for the more difficult to measure flow.

Temperature - Essential to the measurement of most water quality parameters, temperature (°C) controls most processes and dynamics of limnology. Water temperature is influenced by such things as ambient air temperature, solar radiation, meteorological events, industrial effluence, wastewater, inflowing tributaries, as well as water body size and depth (Allan 2010; Hach 2006).

Total Dissolved Solids - Total Dissolved Solids (TDS) (g/l) is a measure of alkaline salts dissolved in water or in fine suspension and can affect the growth and reproduction of aquatic life. It is affected by rainfall events, the composition of inflowing tributaries and their associated geology, saline inflow (e.g., road salt), agricultural run-off and industrial inputs (Allan 2010; Swanson and Baldwin 1965).

Turbidity - Turbidity (NTU) is a measure of the translucence of water and indicates the amount of suspended material in the water. Turbidity is caused by any substance that makes water cloudy (e.g., soil erosion, micro-organisms, vegetation, chemicals, etc.) and can correspond to precipitation events, high stage, and floating debris near the sensor (Allan 2010; Hach 2006; Swanson and Baldwin 1965).

APPENDIX C

Environment Canada Weather Data – St. John’s International Airport (September 17 to October 23, 2014)

Date yyyy-mm-dd	Max Temp °C	Min Temp °C	Mean Temp °C	Heat Deg Days °C	Cool Deg Days °C	Total Rain mm	Total Snow cm	Total Precipitation mm
2014-09-17	18.1	7.1	12.6	5.4	0	0	0	0
2014-09-18	17.3	11.4	14.4	3.6	0	0	0	0
2014-09-19	18.4	5.7	12.1	5.9	0	0.2	0	0.2
2014-09-20	14.3	5.4	9.9	8.1	0	0	0	0
2014-09-21	20.8	13.3	17.1	0.9	0	0	0	0
2014-09-22	20.3	16.6	18.5	0	0.5	2.8	0	2.8
2014-09-23	19.6	8.1	13.9	4.1	0	0.8	0	0.8
2014-09-24	12.9	3.6	8.3	9.7	0	0	0	0
2014-09-25	17.4	4.6	11	7	0	0	0	0
2014-09-26	13.6	8.2	10.9	7.1	0	0	0	0
2014-09-27	14.6	5.2	9.9	8.1	0	8.4	0	8.4
2014-09-28	14.7	2.5	8.6	9.4	0	0	0	0
2014-09-29	13.5	1.7	7.6	10.4	0	2	0	2
2014-09-30	12.1	2	7.1	10.9	0	0.2	0	0.2
2014-10-01	12.8	2.3	7.6	10.4	0	0.2	0	0.2
2014-10-02	9.3	1.8	5.6	12.4	0	0	0	0
2014-10-03	11.6	3.9	7.8	10.2	0	0	0	0
2014-10-04	13.3	3.1	8.2	9.8	0	0	0	0
2014-10-05	15.7	3.6	9.7	8.3	0	4	0	4
2014-10-06	22.1	11.7	16.9	1.1	0	1	0	1
2014-10-07	15.4	4.3	9.9	8.1	0	0	0	0
2014-10-08	13.7	3.1	8.4	9.6	0	0.4	0	0.4
2014-10-09	15.3	9.7	12.5	5.5	0	6.4	0	6.4
2014-10-10	16.6	8.9	12.8	5.2	0	0	0	0
2014-10-11	16	6.4	11.2	6.8	0	0	0	0
2014-10-12	8.5	4.4	6.5	11.5	0	28	0	28
2014-10-13	9.5	4.2	6.9	11.1	0	0	0	0
2014-10-14	14.5	4.8	9.7	8.3	0	0	0	0
2014-10-15	16	8.6	12.3	5.7	0	0	0	0
2014-10-16	8.9	2	5.5	12.5	0	0	0	0
2014-10-17	10.6	1.8	6.2	11.8	0	0	0	0

2014-10-18	18.3	10.5	14.4	3.6	0	3.4	0	3.4
2014-10-19	21.3	11.1	16.2	1.8	0	51	0	51
2014-10-20	17.3	7	12.2	5.8	0	4.6	0	4.6
2014-10-21	11.8	4.7	8.3	9.7	0	0	0	0
2014-10-22	9.7	1.7	5.7	12.3	0	0	0	0
2014-10-23	9.3	1.9	5.6	12.4	0	2	0	2
