



Real-Time Water Quality Report

Waterford River at Kilbride

Deployment Period
October 8, 2015 to November 13, 2015



Government of Newfoundland & Labrador
Department of Environment and Conservation
Water Resources Management Division

Prepared by:

Tara Clinton
Environmental Scientist
Water Resources Management Division
Department of Environment & Conservation
4th Floor, Confederation Building, West Block
PO Box 8700, St. John's NL A1B 4J6
Ph. No.: (709) 729 - 5925
Fax No.: (709) 729 - 0320
taracClinton@gov.nl.ca

General

The Water Resources Management Division (WRMD), in partnership with Water Survey of Canada - Environment Canada (WSC-EC), maintain a real-time water quality and water quantity monitoring station on Waterford River at Kilbride.

This deployment report discusses water quality related events occurring at this station.

The purpose of the real-time water quality station is to monitor process and publish real-time water quality data.

This report covers the period from deployment on October 8, 2015 until removal on November 13, 2015.



Figure 1: Waterford River at Kilbride Real-Time Water Quality and Quantity Station.

Quality Assurance and Quality Control

As part of the Quality Assurance and Quality Control protocol (QA/QC), an assessment of the reliability of data recorded by an instrument is made at the beginning and end of the deployment period. The procedure is based on the approach used by the United States Geological Survey.

At deployment and removal, a QA/QC Sonde is temporarily deployed alongside the Field Sonde. Values for temperature, pH, conductivity, dissolved oxygen and turbidity are compared between the two instruments. Based on the degree of difference between the parameters on the Field Sonde and QA/QC Sonde at deployment and at removal, a qualitative statement is made on the data quality (Table 1).

WRMD staff (Environment and Conservation (ENVC)) is responsible for maintenance of the real-time water quality monitoring equipment, as well as recording and managing the water quality data. Tara Clinton, under the supervision of Renee Paterson, is ENVC's main contact for the real-time water quality monitoring operation at Waterford River station, and is responsible for maintaining and calibrating the water quality instrument, as well as grooming, analyzing and reporting on water quality data recorded at the station.

WSC staff (Environment Canada (EC) under the management of Howie Wills, play an essential role in the data logging/communication aspect of the network and the maintenance of the water quantity monitoring equipment. WSC-EC staff visit the site regularly to ensure the data logging and data transmitting equipment are working properly. WSC is responsible for handling stage and streamflow issues. The quantity data is raw data that is transmitted via satellite and published online along with the water quality data on the Real-Time Stations website. Quantity data has not been corrected or groomed when published online or used in the monthly reports for the stations. WSC is responsible for QA/QC of water quantity data. Corrected stage and streamflow data can be obtained upon request to WSC.

Table 1: Instrument Performance Ranking classifications for deployment and removal

	Rank				
Parameter	Excellent	Good	Fair	Marginal	Poor
Temperature (°C)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	<+/-1
pH (unit)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Sp. Conductance (µS/cm)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Sp. Conductance > 35 µS/cm (%)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Dissolved Oxygen (mg/L) (% Sat)	<=+/-0.3	>+/-0.3 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Turbidity <40 NTU (NTU)	<=+/-2	>+/-2 to 5	>+/-5 to 8	>+/-8 to 10	>+/-10
Turbidity > 40 NTU (%)	<=+/-5	>+/-5 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20

It should be noted that the temperature sensor on any sonde is the most important. All other parameters can be divided into subgroups of: temperature dependant, temperature compensated and temperature independent. Due to the temperature sensor's location on the sonde, the entire sonde must be at a constant temperature before the temperature sensor will stabilize. The values may take some time to climb to the appropriate reading; if a reading is taken too soon it may not accurately portray the water body.

Table 2: Instrument performance rankings for Waterford River at Kilbride

Station	Date	Action	Comparison Ranking				
			Temperature	pH	Conductivity	Dissolved Oxygen	Turbidity
Waterford	October 8	Deployment	Fair	Excellent	Excellent	Poor	Good
	November 13	Removal	Poor	Excellent	Good	Marginal	Good

On deployment the rankings of the field data against the QAQC data was as follows; water temperature ranked as 'Fair'. pH and conductivity data ranked as 'Excellent' with dissolved oxygen data ranking as 'Poor' and turbidity data ranked as 'Good'. The low water temperature ranking of 'Fair' likely also contributed to the 'Poor' ranking for dissolved oxygen. The QAQC used in the deployment comparison was an older Hydrolab model that calculates dissolved oxygen of the water through a Clark Cell sensor. There are some differences between how the QAQC instrument and the field instrument calculate dissolved oxygen and this may have also contributed to the ranking of 'Poor'.

At removal of the instrument, the water temperature data ranked as 'Poor'. The pH data was ranked as 'Excellent', the conductivity and turbidity data ranked as 'Good'. The dissolved oxygen data ranked as 'Marginal' at removal. After several low rankings for the water temperature data during the deployment and removal rankings, the instrument was switched out with another to see if there was any improvement.

Concerns Or Issues During Deployment

Due to a technical issue with the quantity instrument, stage data was not available between the dates October 14th, 2015 through to October 20th, 2015. WSC is responsible for handling stage and streamflow issues. The quantity data is raw data that is transmitted via satellite and published online along with the water quality data on the Real-Time Stations website. Quantity data has not been corrected or groomed when published online or used in the monthly reports for the stations. WSC is responsible for QA/QC of water quantity data. Corrected stage and streamflow data can be obtained upon request to WSC.

Waterford River at Kilbride

Water Temperature

Water temperature ranged from 1.99°C to 13.68°C during this deployment period (Figure 2). There were noticeable increases and decreases in the water temperature. This would likely be consistent with ambient air temperatures over this time period, generally temperatures will increase during daylight hours and cool overnight.

The water temperature at this station displays diurnal variations although slightly elongated due to the depth of water at this station. Deeper streams are influenced more subtly by natural diurnal variations in air temperatures (Appendix I).

The water temperatures decrease across the deployment period. During the higher stage events the water temperatures do increase briefly before settling back down.

Please note, the stage data is raw data that is published on the ENVC web page. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

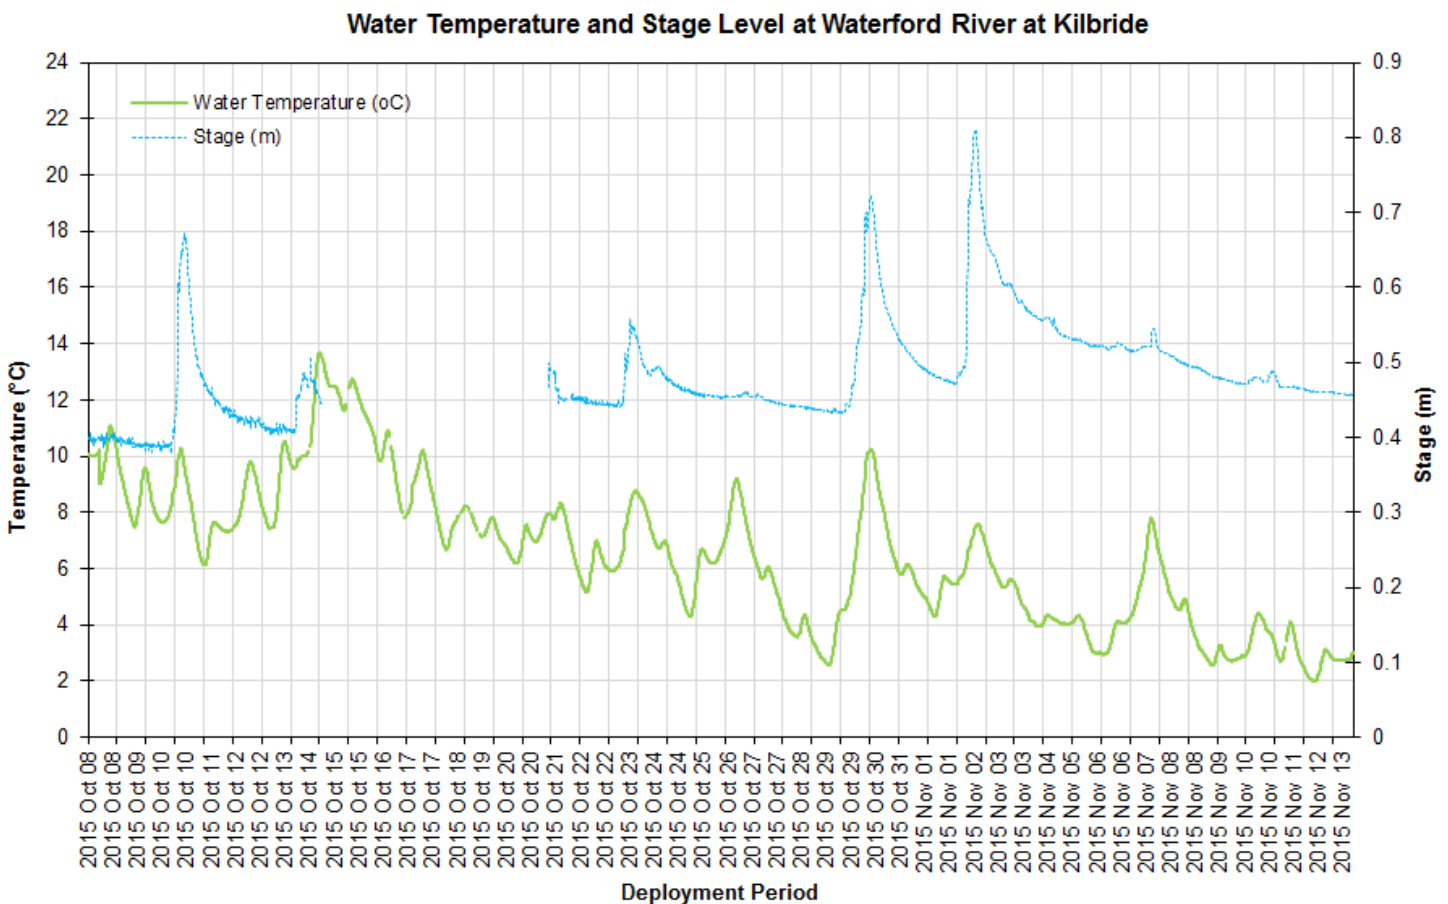


Figure 2: Water temperature (°C) and Stage (m) values at Waterford River at Kilbride

pH

Throughout the deployment period, pH values ranged between 6.53 pH units and 8.11 pH units (Figure 3).

The pH levels at the beginning of deployment were slightly higher than would be expected for Waterford River, it is not clear what may have influence pH at that time. Throughout the remainder of the deployment the pH data was reasonably consistent. The pH values at this station were above the minimum CCME Guideline for the Protection of Aquatic Life (above 6.5 pH units).

The CCME guideline provides a basis by which to judge the overall health of the brook. Naturally, all streams and brooks are different. During the deployment period the median pH level was 7.04 pH units.

During the higher stage periods the pH values flattening slightly before returning to its previous values. Please note the stage data is raw data that is published on the ENVC web page. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

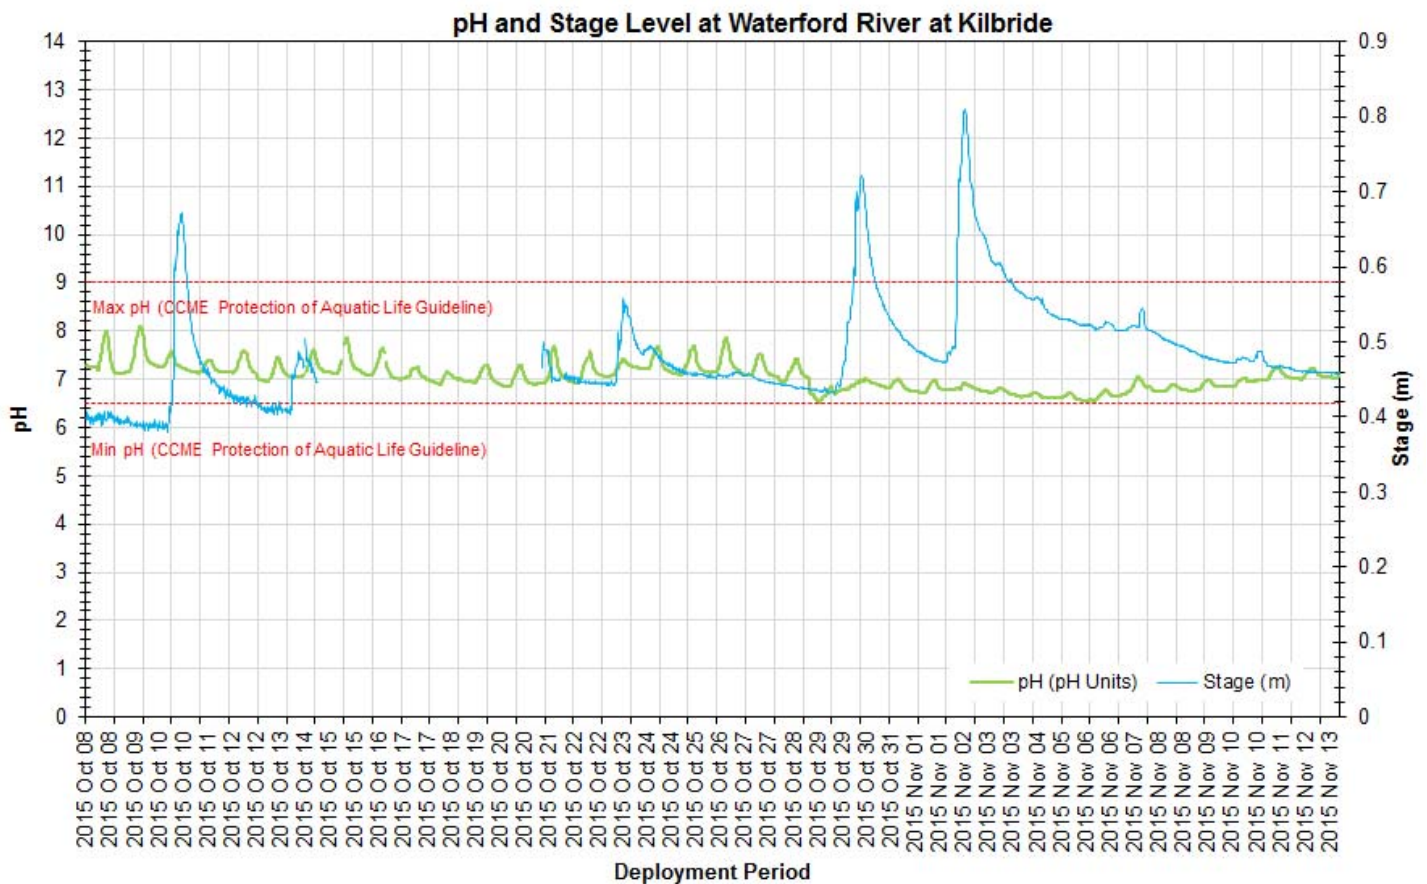


Figure 3: pH (pH units) and stage level (m) values at Waterford River at Kilbride

Specific Conductivity & Total Dissolved Solids

The conductivity levels were within 241 $\mu\text{S}/\text{cm}$ and 1518.0 $\mu\text{S}/\text{cm}$ during this deployment period. TDS (a calculated value) ranged from 0.1570 g/L to 0.9870 g/L (Figure 4).

Commonly the relationship between conductivity and stage level is inversed. When stage levels rise, the specific conductance levels drop in response as the increased amount of water in the river system dilutes the solids that are present. This relationship is evident in this deployment period in the circled conductivity events on Figure 4.

Spikes in conductivity, as seen toward the end of deployment, are likely a result of road salting as air temperatures were at or below freezing during this timeframe. Additional material and dissolved substances in the brook are captured by the conductivity probe before the levels drop back down.

Please note the stage data is raw data that is published on the ENVC web page. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

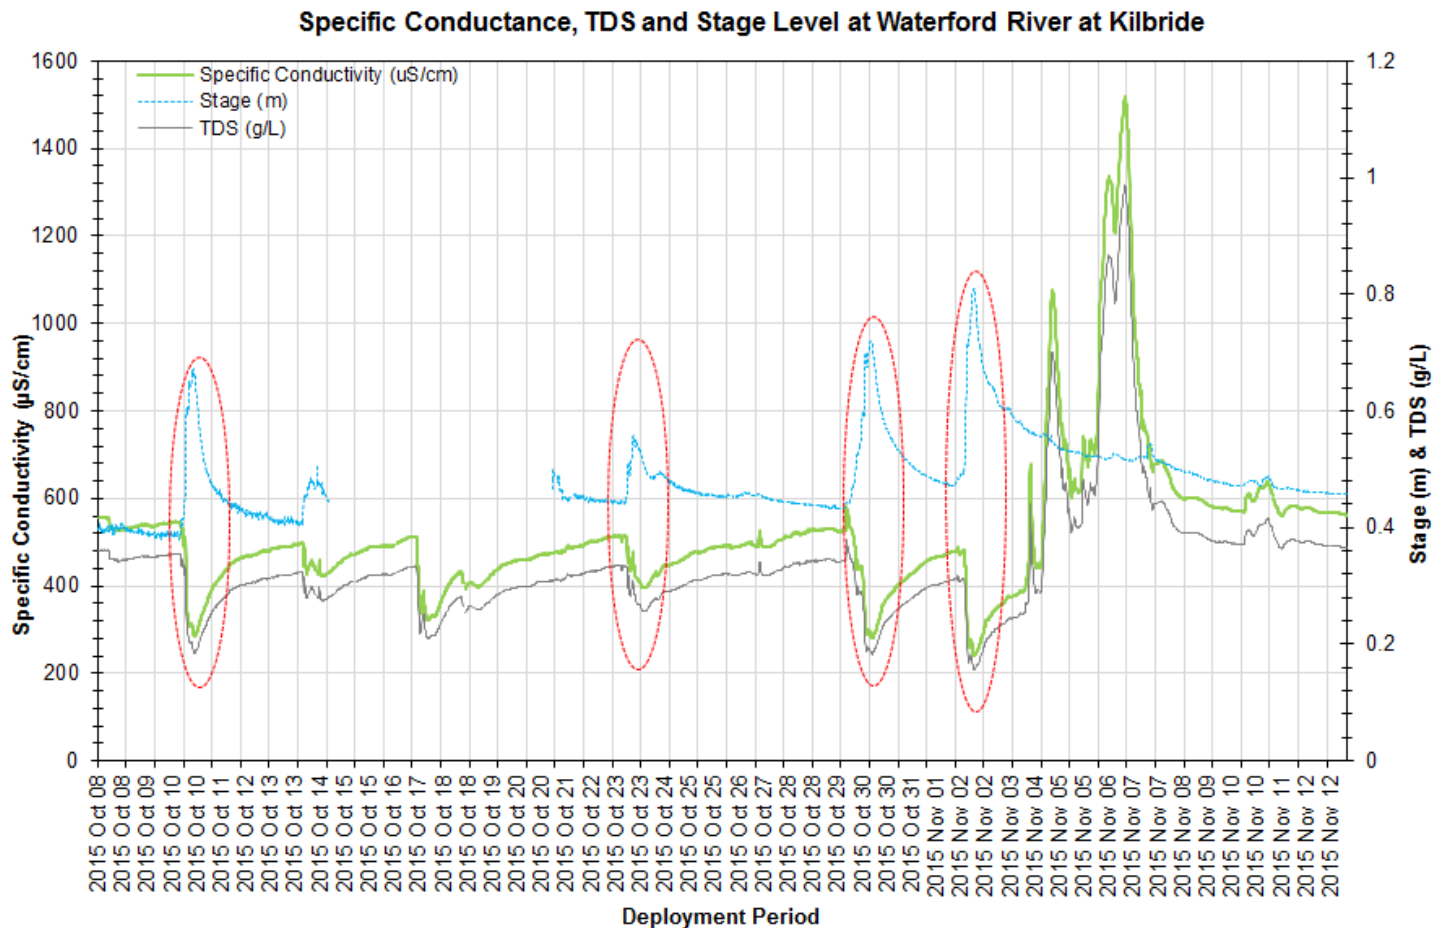


Figure 4: Specific conductivity ($\mu\text{S}/\text{cm}$), TDS (g/L) and stage (m) values at Waterford River at Kilbride.

Dissolved Oxygen

The water quality instrument measures dissolved oxygen (mg/L) with the dissolved oxygen probe and then the instrument calculates percent saturation (% Sat) with water temperature.

During the deployment the dissolved oxygen concentration levels ranged within a minimum of 10.15mg/L to a maximum of 14.33mg/L. The percent saturation levels for dissolved oxygen ranged within 90.2 %Sat to 109.7 %Sat (Figure 5).

The dissolved oxygen concentration remains constant through deployment. The dissolved oxygen do not dip below the CCME guideline for the Protection of Early Life Stages (9.5). The cooler water temperatures allow for higher dissolved oxygen amounts in the water column.

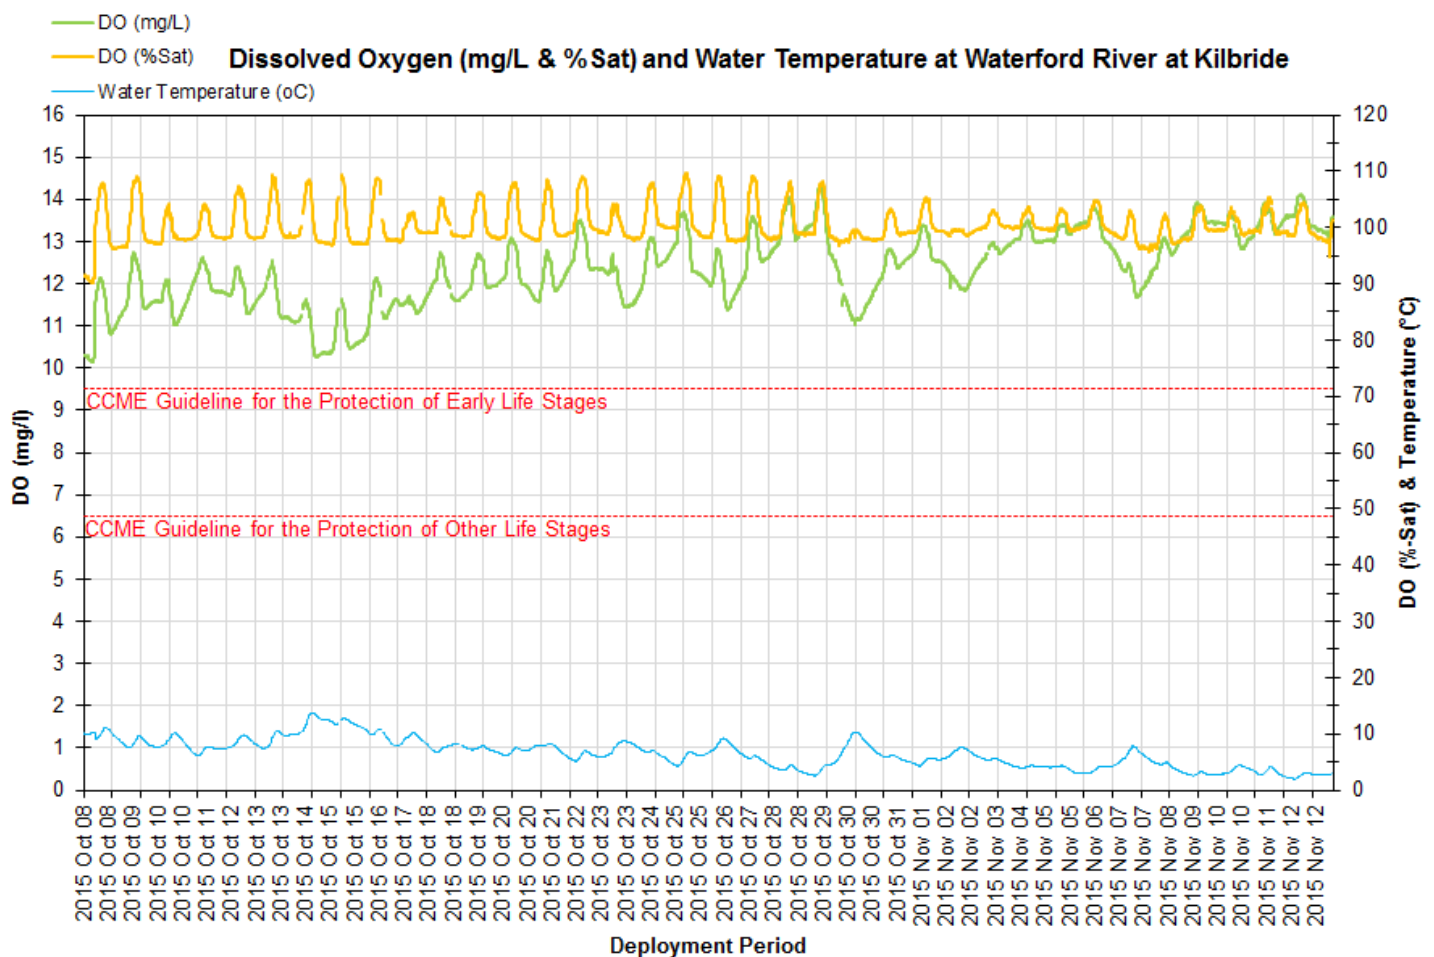


Figure 5: Dissolved Oxygen (mg/L & Percent Saturation) and Water Temperature (°C) at Waterford River at Kilbride.

Turbidity

Turbidity levels during the deployment ranged within 0.0 NTU and 1025.7 NTU (Figure 6). The deployment data had a median of 4.5 NTU.

Overall the turbidity levels for the deployment period were constant. The higher turbidity events in the deployment period correlate with increases in stage potentially from precipitation. Precipitation can increase the presence of suspended material in water. After the peak in turbidity the values return to a lower level.

Please note the stage data is raw data that is published on the ENVC web page. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

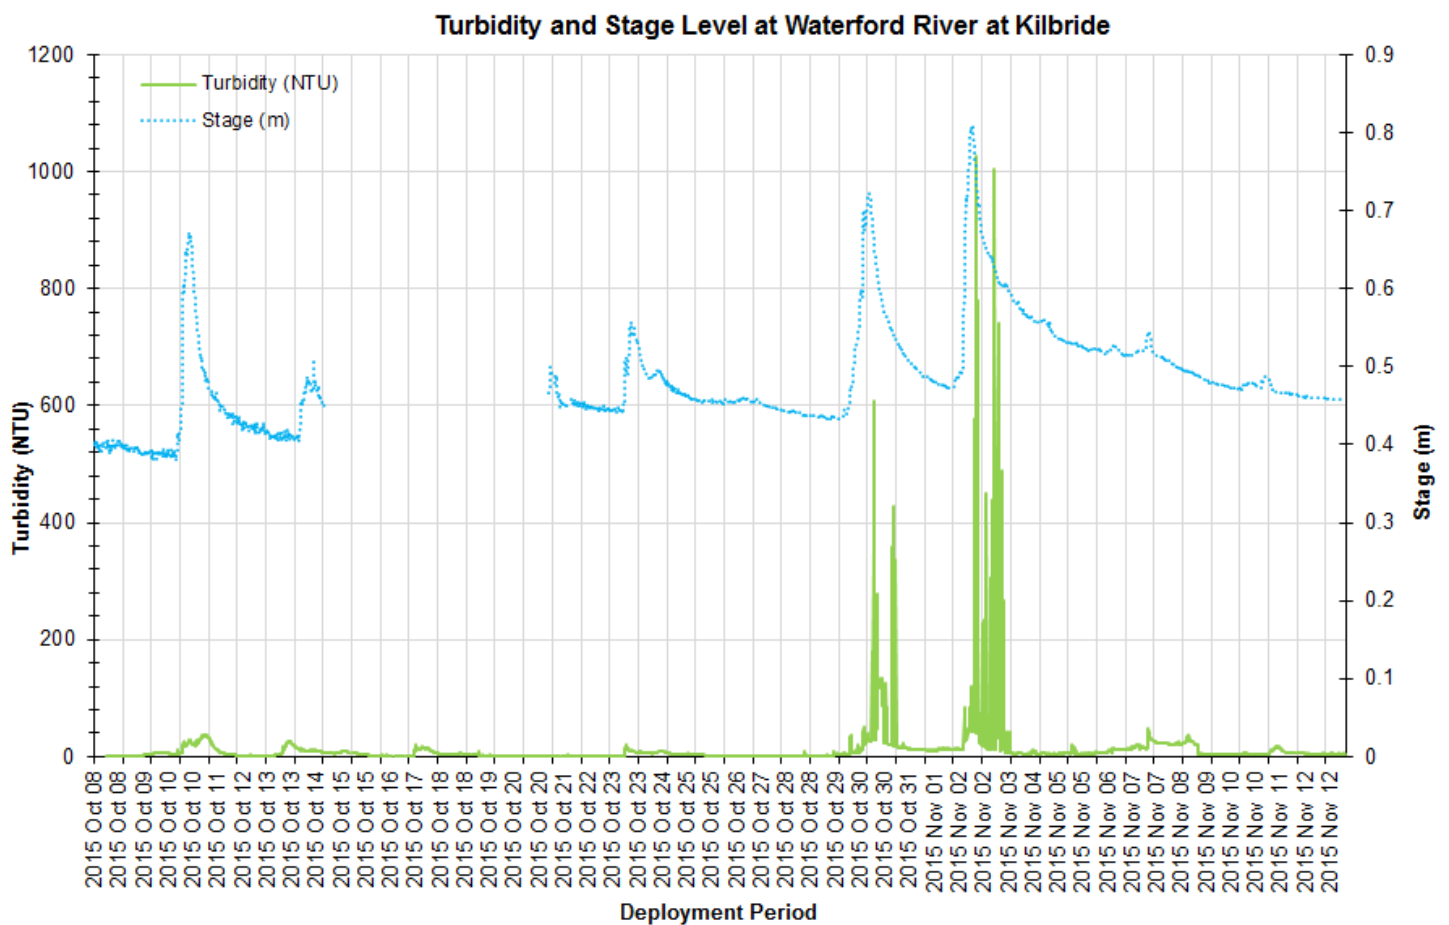


Figure 6: Turbidity (NTU) and stage level (m) values at Waterford River at Kilbride.

Stage and Precipitation

Please note the stage data graphed below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Stage is important to display as it provides an estimation of water level at the station and can explain some of the events that are occurring with other parameters (i.e. Specific Conductivity, DO, turbidity). Stage will increase during rainfall events (Figure 7) and during any surrounding snow or ice melt as runoff will collect in the brooks. However, direct snowfall will not cause them to rise significantly.

During the deployment period, the stage values ranged from 0.38m to 0.81m. The larger peaks in stage do correspond with substantial rainfall events as noted on Figure 7.

Precipitation data was obtained from Environment Canada's St. John's Airport weather station. Precipitation ranges for the deployment period were a minimum of 0.0 mm and a maximum of 23 mm on November 2nd, 2015.

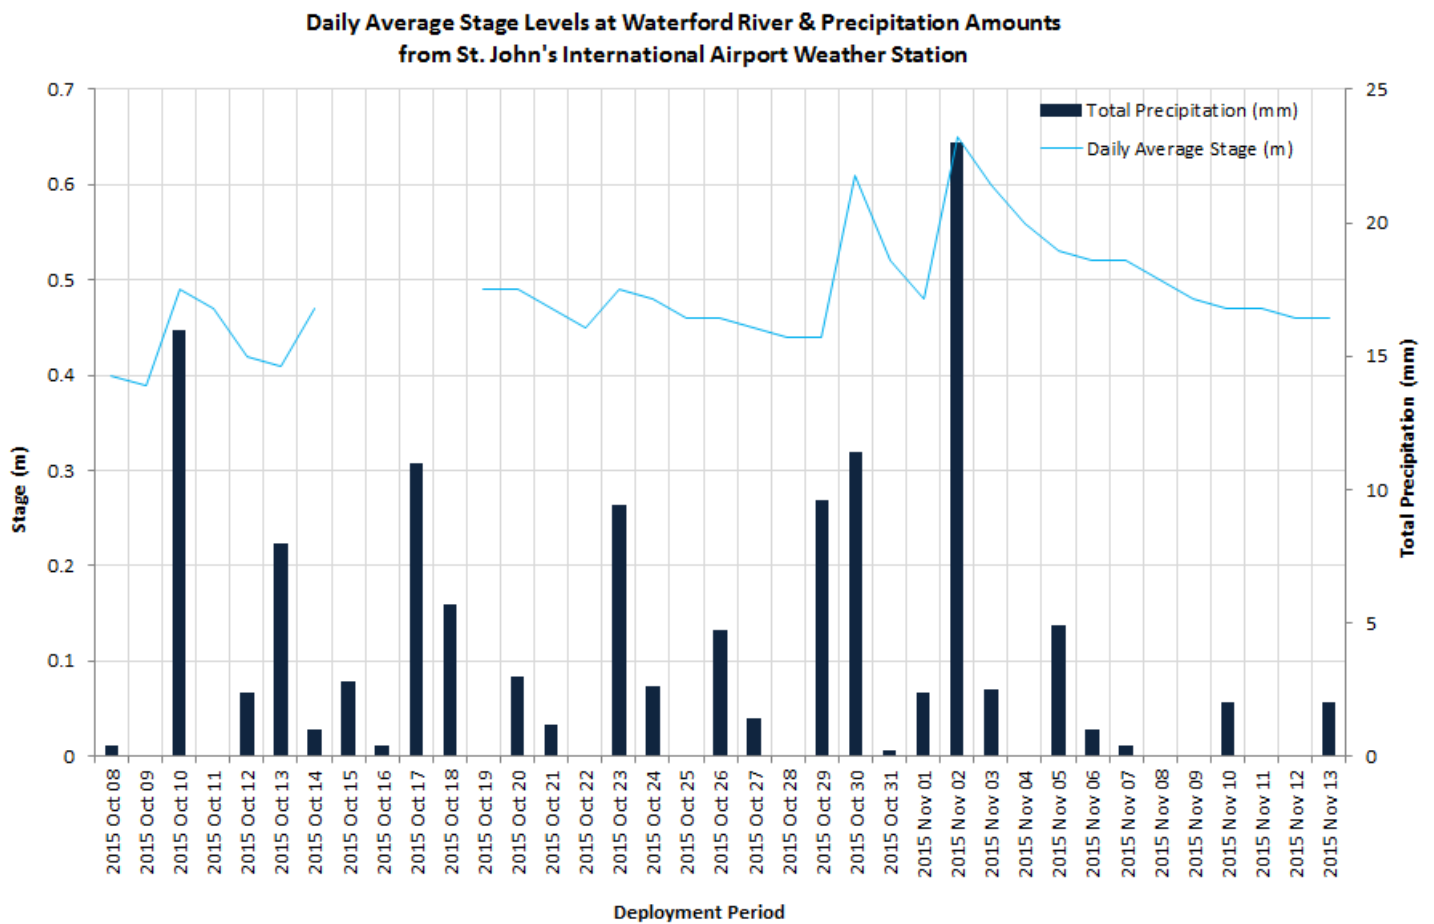


Figure 7: Daily average stage values at Waterford River at Kilbride and daily total precipitation from St. John's Airport Weather Station.

Conclusion

As with many urban brooks and streams, precipitation and runoff events play a role in influencing the water quality within the water body. Waterford River flows through significant developed areas, including residential and industrial zones, the brook can also be found along the boundaries of heavily used road ways, all these factors can influence the parameters that are recorded by the water quality instrument.

It is evident by the recorded data that precipitation events have influenced fluctuations in stage. When reviewing the graphs as a whole it is evident that the larger precipitation events did create varying effects with the water quality parameters pH, conductivity, dissolved oxygen and turbidity.

The high pH values during the beginning of the deployment are higher than would be expected, however after an increase in stage the pH levels dip back down. It is not clear what may have influenced the high pH during those times.

Despite the changes in the water quality parameters during the higher stage events the data was as expected of an urban brook during this time of the year. After each event the data for all the parameters returned to its previous levels.

Overall the water quality parameters recorded at Waterford River at Kilbride displayed natural events expected of a brook in an urbanized environment.

APPENDIX I

Daily Averaged Water Temperatures (oC) at Waterford River and Mean Air Temperatures recorded at St. John's Airport Weather Station

