

Real-Time Water Quality 2025 Annual Report

Vale Voisey's Bay Network

May 27 to October 15, 2025



Government of Newfoundland & Labrador
Department of Environment, Conservation & Climate Change
Water Resources Management Division

Contents

ACKNOWLEDGEMENTS	2
ABBREVIATIONS	3
INTRODUCTION	4
MAINTENANCE AND CALIBRATION	4
QUALITY ASSURANCE AND QUALITY CONTROL	6
DATA INTERPRETATION	8
Reid Brook at Outlet of Reid Pond	9
Camp Pond Brook below Camp Pond	16
Reid Brook below Tributary	23
Tributary to Reid Brook	30
MULTI-STATION COMPARISON	37
CONCLUSIONS	49
PATH FORWARD	50

Acknowledgements

The Real-Time Water Quality Monitoring Network in Voisey's Bay is successful in tracking emerging water quality issues due to the hard work and diligence of certain individuals. The management and staff of Vale work in cooperation with the management and staff of the Department of Environment, Conservation and Climate Change's Water Resources Management Division (WRMD), as well as Environment and Climate Change Canada (ECCC), to ensure the protection of ambient water resources in Voisey's Bay, Labrador.

Employees with the Water Resources Management Division were integral in ensuring the smooth operation of such a technologically advanced network. WRMD staff were responsible for installation of new, upgraded water quality instrumentation purchased by Vale, deployment and removal of instruments including cleaning, calibration, and maintenance, as well as preparation of monthly deployment reports for the 2025 season. WRMD provides data to the general public on a near real-time basis through the departmental web page.

Environment and Climate Change Canada staff of the Meteorological Service of Canada: Water Survey Canada play an essential role in the data logging/communication aspect of the network. These individuals visit the site to ensure the data logging equipment is operating properly and transmitting the data efficiently. Finally, they play the lead role in dealing with hydrological quantity and flow issues.

Staff with WRMD, ECCC, and Vale are fully committed to improving this network and ensuring it provides meaningful and accurate water quality/quantity data that can be used in the decision-making process. This network is successful due to the cooperation of all three agencies involved.

Abbreviations

ECCC	Environment and Climate Change Canada
WSC	Water Survey of Canada
WRMD	Water Resources Management Division
DO	Dissolved Oxygen
NL	Newfoundland and Labrador
QA/QC	Quality Assurance and Quality Control
RTWQ	Real-time Water Quality
%Sat	Percent Saturation
PTE	Performance Testing and Evaluation

Introduction

The RTWQ network in Voisey's Bay was successfully established by WRMD and ECCC in cooperation with Vale in 2003 and further expanded in 2006. The objective of the network is to identify and track emerging water quality or quantity management issues and ensure protection of ambient water resources in and around the Voisey's Bay operations.

The RTWQ network consists of four water quality monitoring stations: Reid Brook at Outlet of Reid Pond, Camp Pond Brook below Camp Pond, Tributary to Reid Brook, and Reid Brook below Tributary. These stations measure water quality parameters including water temperature, pH, specific conductivity, dissolved oxygen, and turbidity. Two additional parameters, total dissolved solids and percent saturation are calculated from measured parameters.

These stations also record continuous stage level and streamflow rate data. These parameters are the responsibility of ECCC; however, if needed, WRMD staff reporting on water quality will have access to water quantity information to understand and explain water quality fluctuations.

In 2025, Vale Voisey's Bay purchased four new EXO3 multiparameter water quality monitoring instruments to replace ageing network infrastructure, as well as an EXO1S and handheld display unit for QA/QC measurements. Equipment was switched out and installed by WRMD staff in May 2025 during the first deployment trip.

This annual deployment report illustrates, discusses and summarizes water quality related events from May 27 to October 15, 2025. During this time, three visits were made to each of the four RTWQ sites. Unfortunately, helicopter availability was an issue due to forest fires in the province, resulting in fewer maintenance trips than were planned.

Instruments were deployed for approximately 40-97 days in two deployment periods.

Maintenance and Calibration

It is recommended that regular maintenance and calibration of the instruments take place as per manufacturer's recommended guidelines to ensure accurate data collection. This procedure was the responsibility of WRMD staff.

Maintenance includes a thorough cleaning of the instrument and replacement of any small sensor parts that are damaged or unsuitable for reuse. Once the instrument is cleaned, WRMD staff members carefully calibrate each sensor attachment for pH, specific conductivity, dissolved oxygen and turbidity.

An extended deployment period can result in instrument sensor drift, which may result in skewed data. Instrument sensors will still work to capture any water quality event, although exact data values collected may be inaccurate. Extended deployment periods can also result in data loss if there is a power failure and the instrument is solely reliant on internal battery power for logging. Installation and removal dates for each station in the 2025 deployment season are summarized in Table 1.

Table 1: Installation and removal dates for 2025 deployment periods

Station	Initial	Removal	Deployment Periods (days)
Reid Brook at Outlet of Reid Pond	May 27	October 15	41, 97
Camp Pond Brook below Camp Pond	May 27	October 15	41, 96
Reid Brook below Tributary	May 27	October 14	41, 95
Tributary to Reid Brook	May 28	October 14	40, 95

Quality Assurance and Quality Control

As part of the Quality Assurance and Quality Control protocol (QA/QC), an assessment of the reliability of data recorded by an instrument is made at the beginning and end of the deployment period. The procedure is based on the approach used by the United States Geological Survey.

At deployment and removal, a QA/QC Instrument is temporarily deployed adjacent to the Field Instrument. Values for temperature, pH, conductivity, dissolved oxygen and turbidity are compared between the two instruments. Based on the degree of difference between parameters recorded by the Field Instrument and QA/QC Instrument at deployment and at removal, a qualitative statement is made on the data quality (Table 2).

Table 2: Ranking classifications for deployment and removal

Parameter	Rank				
	Excellent	Good	Fair	Marginal	Poor
Temperature (oC)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	<+/-1
pH (unit)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Sp. Conductance (µS/cm)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Sp. Conductance > 35 µS/cm (%)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Dissolved Oxygen (mg/l) (% Sat)	<=+/-0.3	>+/-0.3 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Turbidity <40 NTU (NTU)	<=+/-2	>+/-2 to 5	>+/-5 to 8	>+/-8 to 10	>+/-10
Turbidity > 40 NTU (%)	<=+/-5	>+/-5 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20

It should be noted that the temperature sensor on any instrument is the most important. All other parameters can be broken down into three groups: temperature dependent, temperature compensated and temperature independent. As the temperature sensor is not isolated from the rest of the instrument, the entire instrument must be at the same temperature before the sensor will stabilize. The values may take some time to climb to the appropriate reading; if a reading is taken too soon it may not accurately portray the water body.

Deployment and removal comparison rankings for the Voisey's Bay Network stations are summarized in Table 3. For additional information and explanations of rankings, including "Cannot Rank" and "N/A" rankings, please refer to the monthly deployment reports.

Table 3: Comparison Rankings for Voisey's Bay Network Stations for 2025 Deployment Season

Station	Date	Action	Temperature	pH	Specific Conductivity	Dissolved Oxygen	Turbidity
Reid Brook at Outlet of Reid Pond	May 27, 2025	Deployment	Excellent	Good	Excellent	Fair	Excellent
	July 8, 2025	Removal	Excellent	Good	Excellent	Fair	Excellent
	July 8, 2025	Deployment	Excellent	Excellent	Excellent	Excellent	Excellent
	October 15, 2025	Removal	Excellent	Good	Excellent	Fair	Excellent
Camp Pond Brook below Camp Pond	May 27, 2025	Deployment	Excellent	Excellent	Excellent	Good	Good
	July 8, 2025	Removal	Excellent	Excellent	Excellent	Good	Excellent
	July 9, 2025	Deployment	Excellent	Excellent	Excellent	Excellent	Excellent
	October 15, 2025	Removal	Excellent	Good	Excellent	Excellent	Excellent
Reid Brook below Tributary	May 27, 2025	Deployment	Excellent	Good	Excellent	Excellent	Excellent
	July 8, 2025	Removal	Excellent	Excellent	Excellent	Excellent	Excellent
	July 9, 2025	Deployment	Excellent	Excellent	Excellent	Excellent	Excellent
	October 14, 2025	Removal	Good	Poor	Excellent	Fair	Excellent
Tributary to Reid Brook	May 28, 2025	Deployment	Excellent	Excellent	Excellent	Excellent	Excellent
	July 8, 2025	Removal	Excellent	Excellent	Excellent	Good	Excellent
	July 9, 2025	Deployment	Excellent	Excellent	Excellent	Excellent	Excellent
	October 14, 2025	Removal	Excellent	Fair	Excellent	Excellent	Excellent

Data Interpretation

The following graphs and discussions illustrate significant water quality-related events from May 27 through October 15, 2025 in the Voisey's Bay RTWQ Network.

With the exception of water quantity data (stage), all data used in the preparation of the graphs and subsequent discussion below adhere to this stringent QA/QC protocol. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Reid Brook at Outlet of Reid Pond

During the 2025 deployment season, water temperature ranged from 1.63°C to a maximum of 19.02°C (Figure 1). Water temperature values for 2025 were lower than from the 2024 and 2023 deployment seasons (Table 4) due to the earlier than normal initial deployment in May.

Temperatures were seasonal, increasing steadily until mid-August before gradually decreasing into October (Figure 1).

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

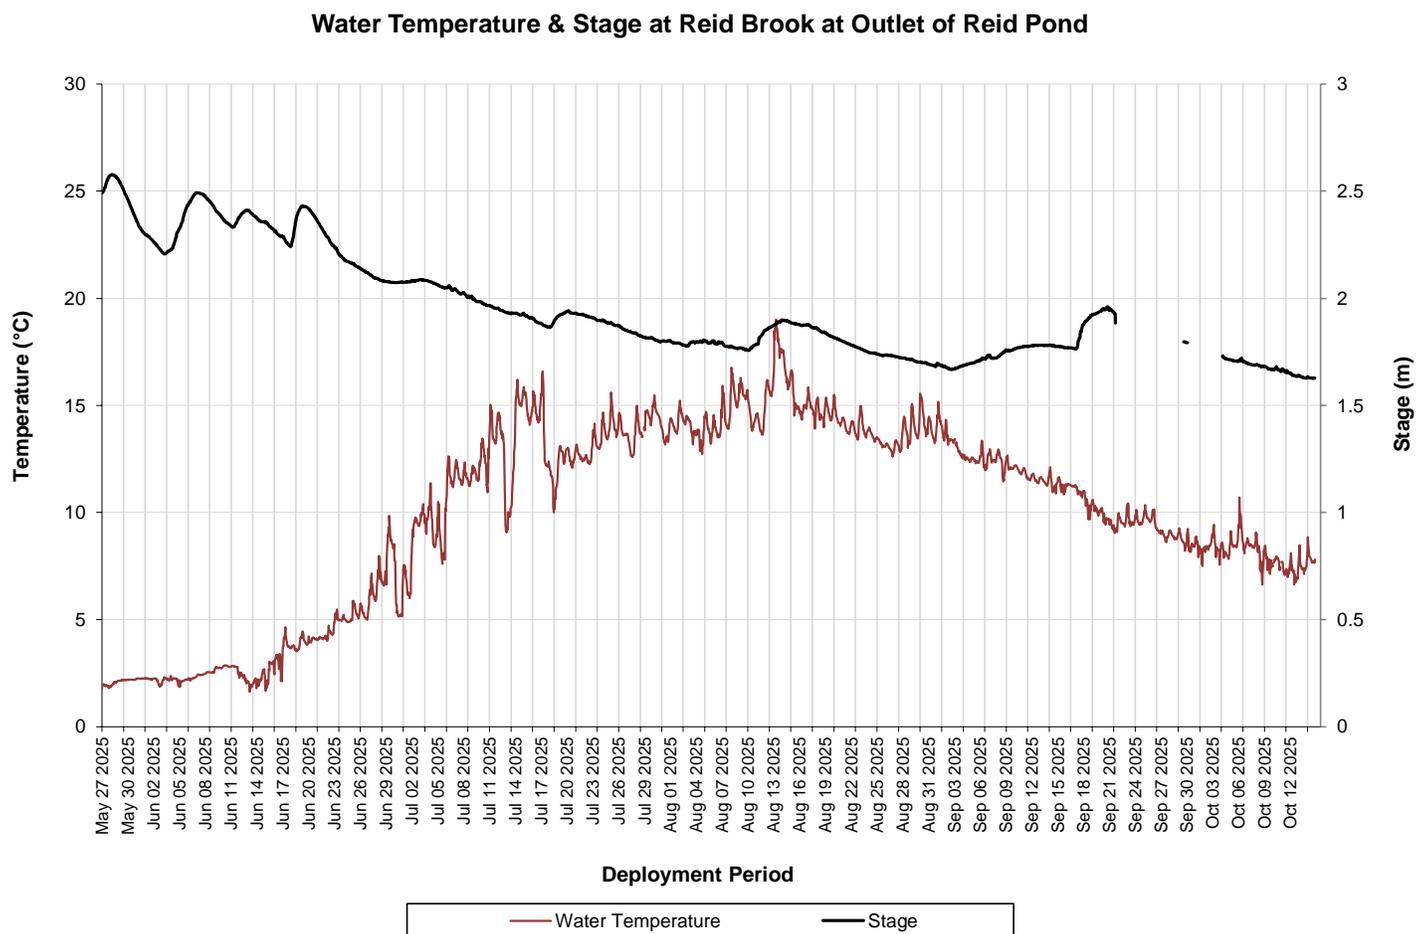


Figure 1: Water Temperature & Stage at Reid Brook at Outlet of Reid Pond

Table 4: Comparisons of Minimum, Maximum and Median from the past three deployment years

Water Temperature	2025	2024	2023
Min	1.63	7.08	6.63
Max	19.02	16.34	20.84
Median	11.24	12.26	14.27

Water temperature maintains a close relationship with air temperature (Figure 2). Increases and decreases in air temperatures throughout 2025 were associated with similar changes in water temperature. Air

temperatures fluctuate to a greater extent each day when compared to water temperatures. This location is also less susceptible to extreme temperature fluctuations as Reid Pond is a larger body of water. Air temperature data was obtained from the Voisey's Bay Weather Station located at the airstrip.

Water Temperature & Air Temperature at Reid Brook at Outlet of Reid Pond

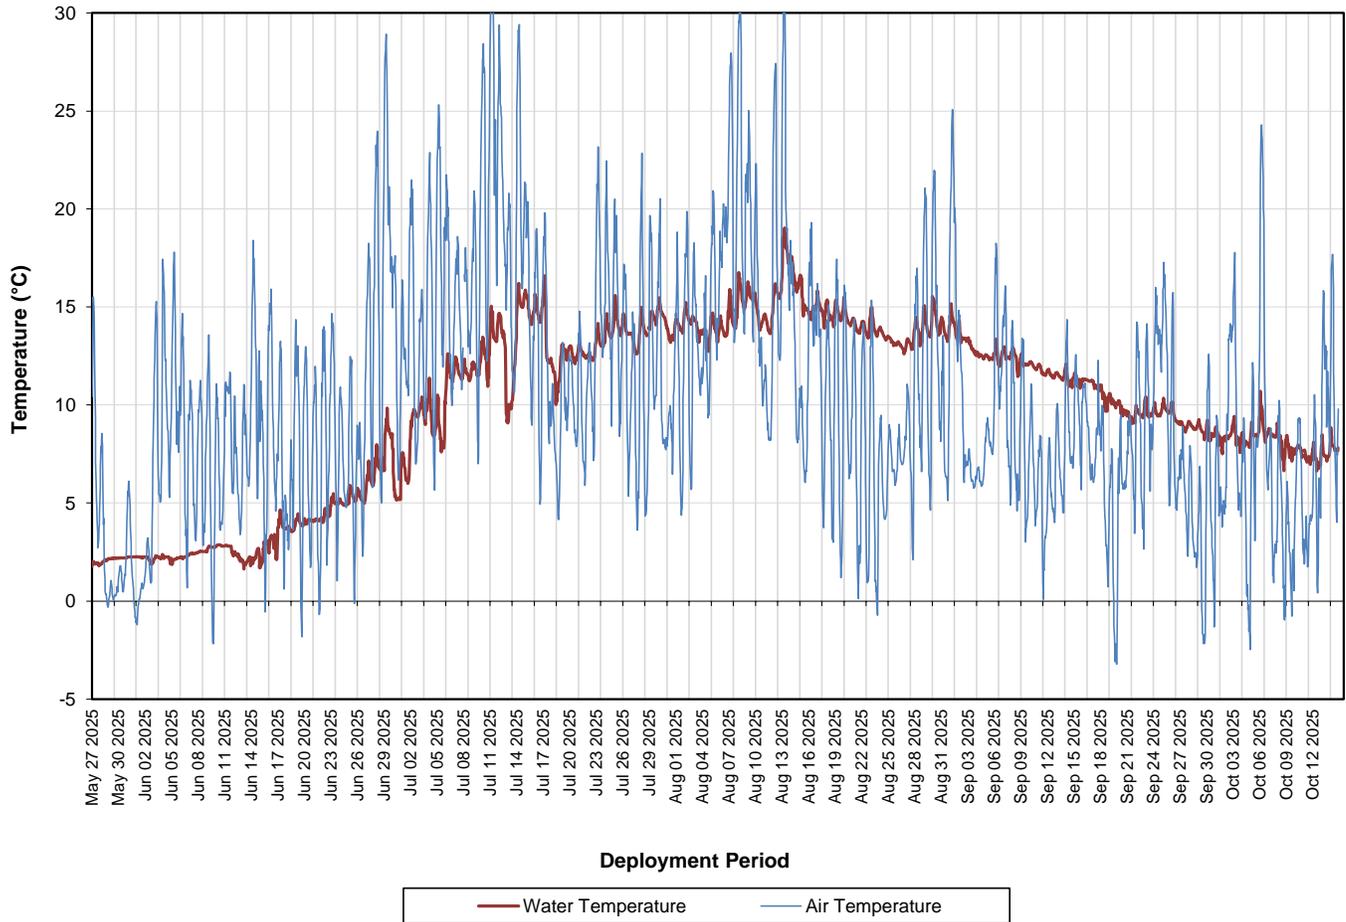


Figure 2: Water Temperature & Air Temperature at Reid Brook at Outlet of Reid Pond

During the 2025 deployment season, pH ranged from 6.50 pH units to a maximum of 7.01 pH units (Table 5). This station is at the outlet of a pond and so pH data has a wider range compared to that of a stream or brook. In a pond environment, water parameters take longer to change after an influence; ponds have a larger volume of water and in turn have a slower turnover rate compared to streams or brooks.

Figure 3 displays the relationship between pH and stage; often when stage increases, pH decreases slightly. pH was within the CCME's Guidelines for the Protection of Aquatic Life throughout the field season.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

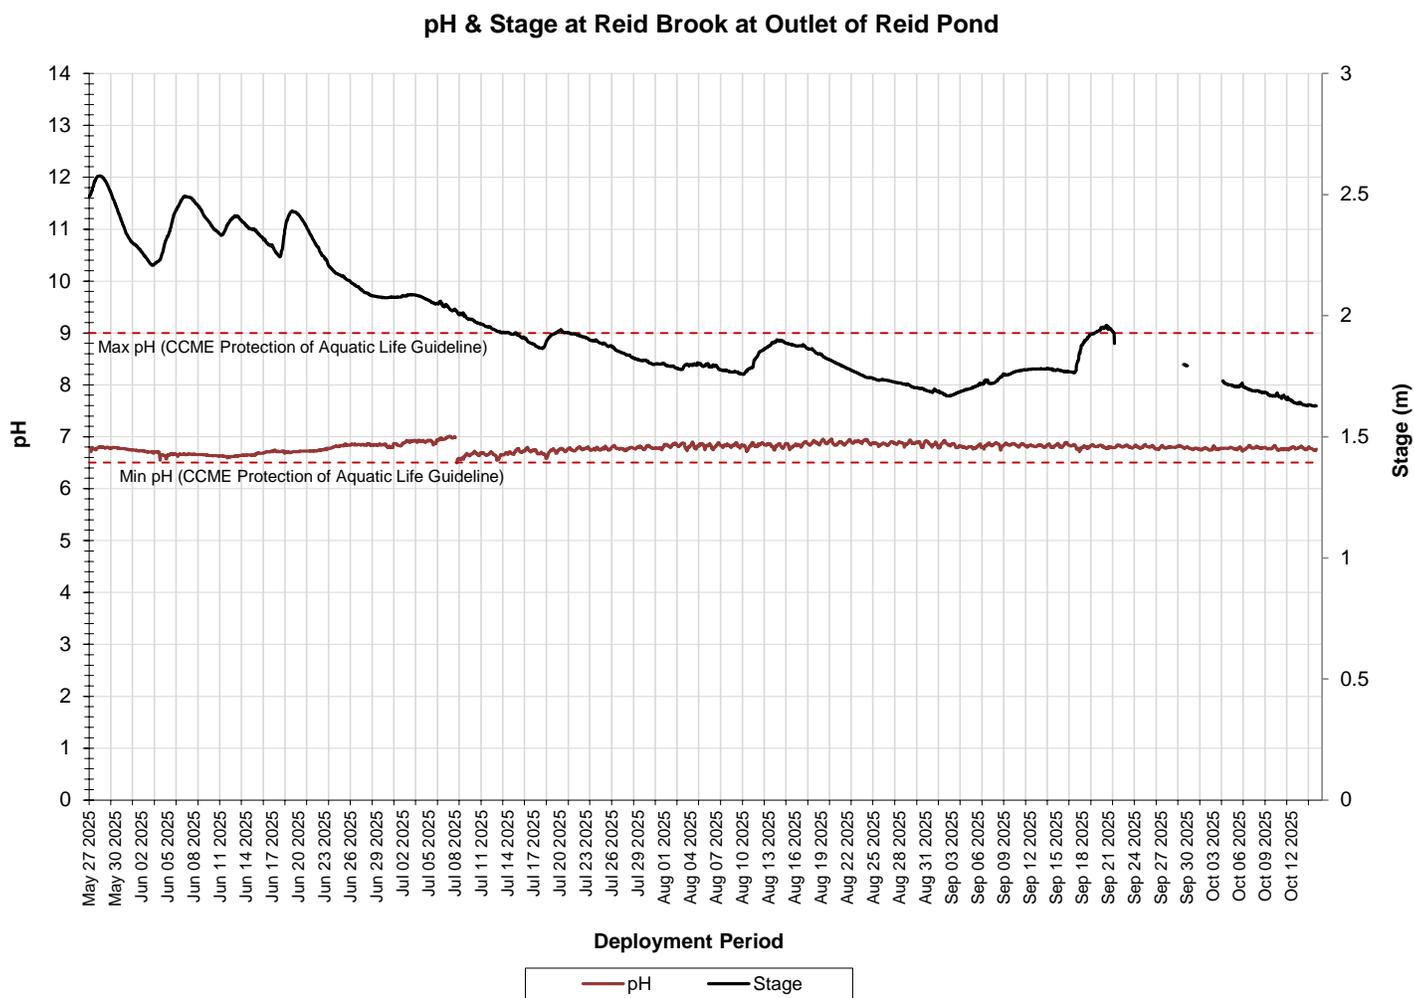


Figure 3: pH & Stage at Reid Brook at Outlet of Reid Pond

Table 5: Comparisons of Minimum, Maximum and Median from the past three deployment years

pH	2025	2024	2023
Min	6.50	0	6.22
Max	7.01	12.6	7.83
Median	6.80	7.10	7.02

During the 2025 deployment season, specific conductivity values ranged from 13.35µS/cm to a maximum of 15.23µS/cm. An overall conductivity median of 14.4µS/cm indicates that this station naturally has very low conductivity, and was similar to previous deployment seasons (Table 6).

Specific conductivity was low and stable throughout the deployment season with only minor fluctuations during stage changes (Figure 4). This trend is to be expected at this station since it is located at the outflow of the stable environment of Reid Pond.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Specific Conductivity & Stage at Reid Brook at Outlet of Reid Pond

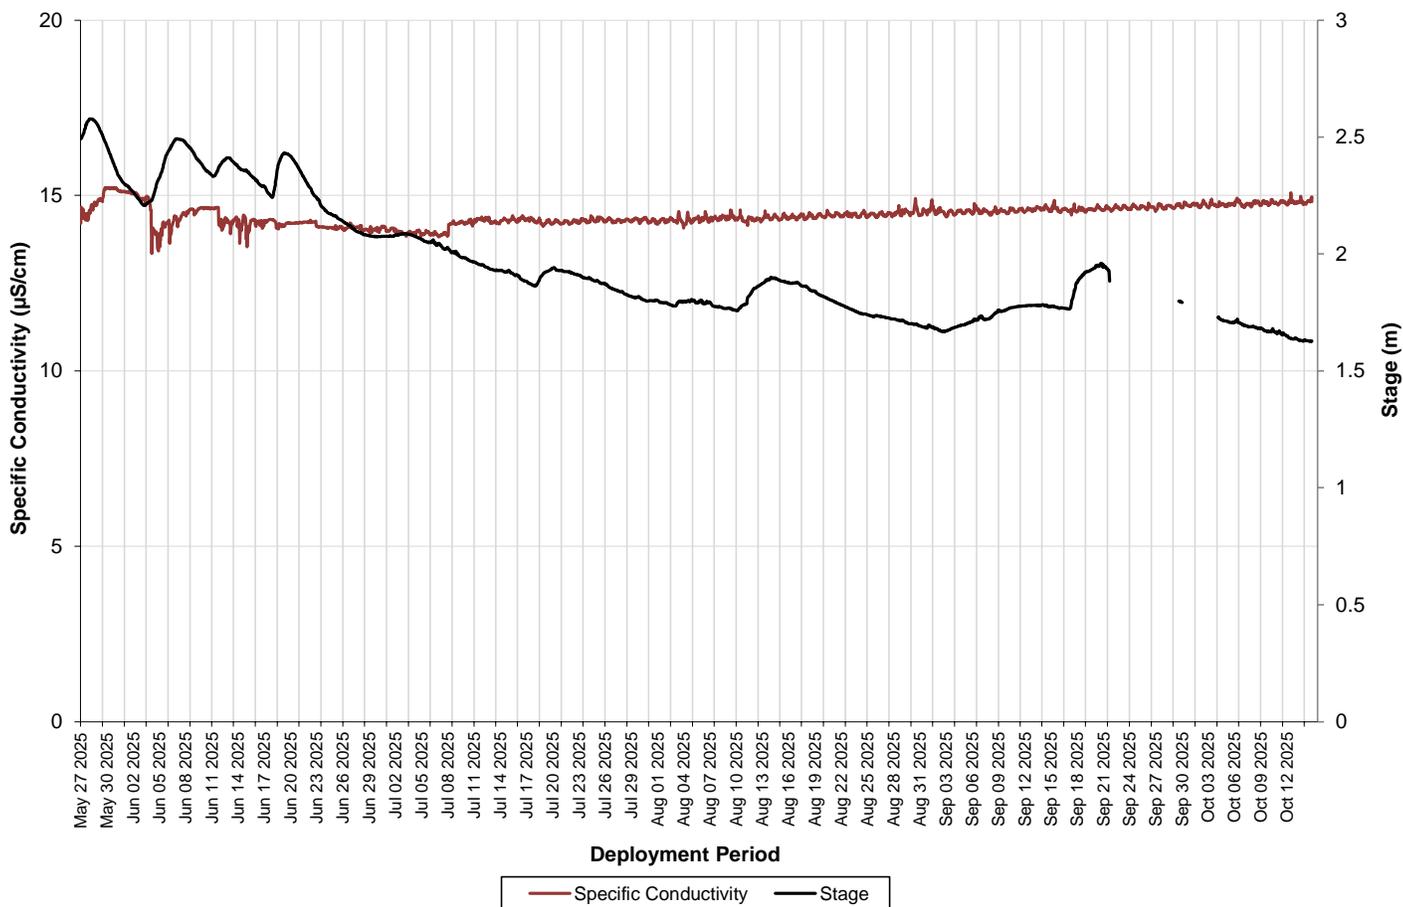


Figure 4: Specific Conductivity & Stage at Reid Brook at Outlet of Reid Pond

Table 6: Comparisons of Minimum, Maximum and Median from the past three deployment years

Specific Conductivity	2025	2024	2023
Min	13.35	11.0	10.0
Max	15.23	32.0	40.8
Median	14.40	13.1	12.0

During the 2025 deployment season, dissolved oxygen concentrations ranged from 10.05mg/L to a maximum of 13.83mg/L, with a median value of 11.55mg/L. Saturation of dissolved oxygen ranged from 92.6% to 117.4%, with a median value of 104.3% (Table 7).

Dissolved oxygen concentrations displayed typical seasonal fluctuations throughout the deployment season and exhibited an inverse relationship with water temperature (Figure 5). Dissolved oxygen values were high at the beginning of deployment when water temperatures were lower. Dissolved oxygen values decreased slowly until mid-August, after which they began to increase again through the remainder of deployment as water temperatures decreased into the fall.

Dissolved oxygen values remained above the CCME's Guideline for the Protection of Other Life Stages (6.5mg/L) and Early Life Stages (9.5mg/L) for the entirety of the deployment season.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

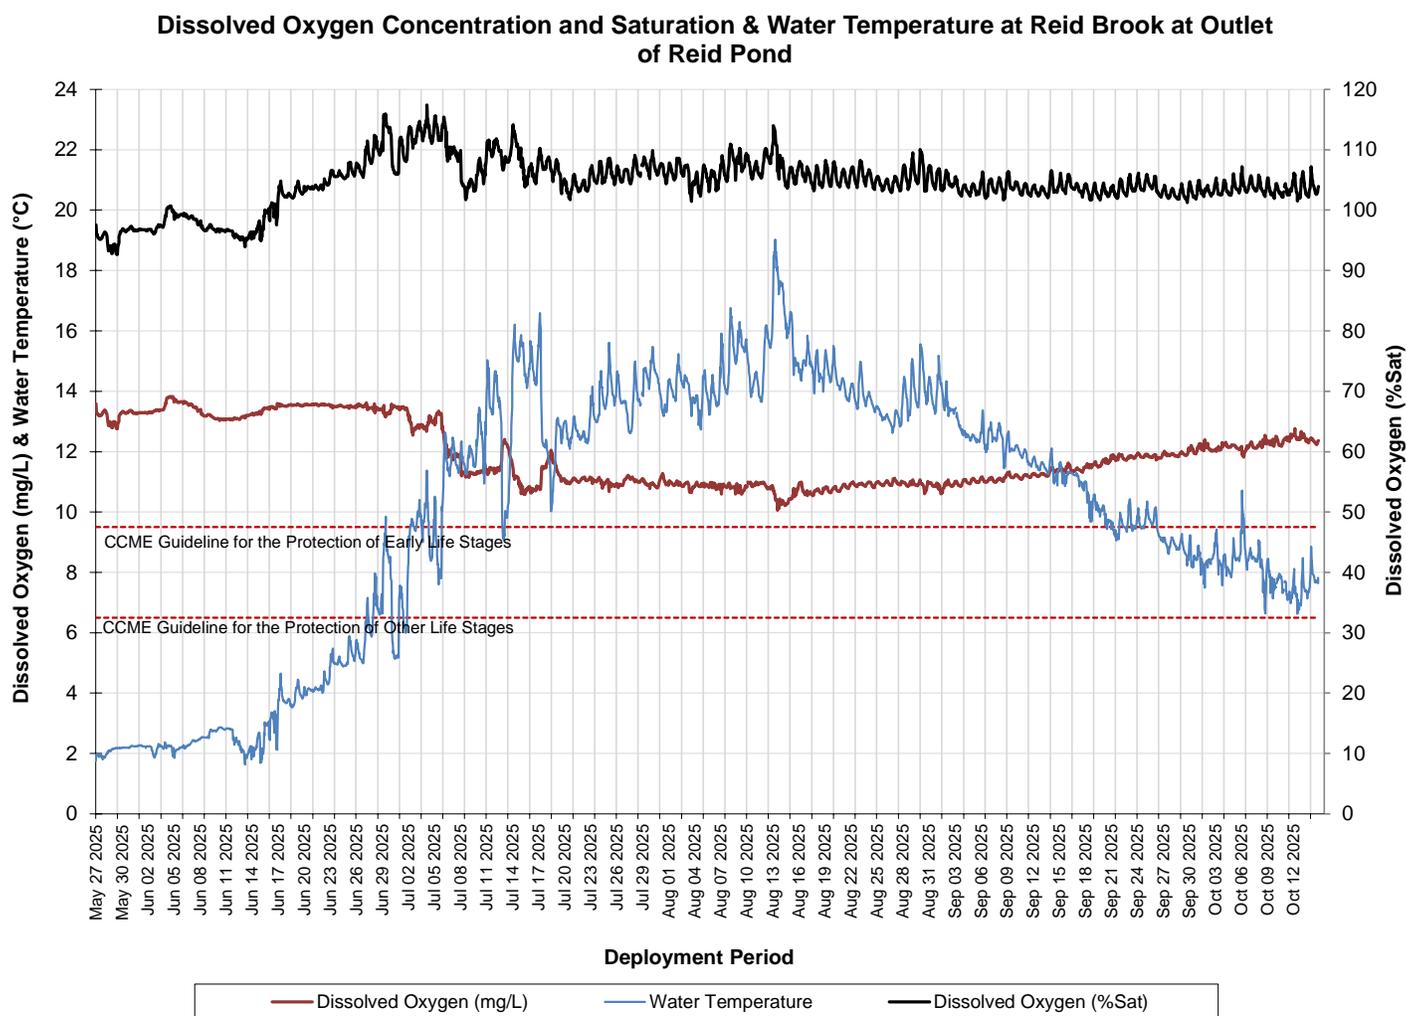


Figure 5: Dissolved Oxygen Concentration and Saturation & Water Temperature at Reid Brook at Outlet of Reid Pond

Table 7: Comparisons of Minimum, Maximum and Median from the past three deployment years

Dissolved Oxygen (mg/L)	2025	2024	2023
Min	10.05	9.39	8.33
Max	13.83	11.38	12.75
Median	11.55	10.10	10.23

Percent Saturation (%)	2025	2024	2023
Min	92.6	89.0	71.9
Max	117.4	103.2	114.8
Median	104.3	94.2	99.1

During the 2025 deployment season, turbidity values ranged from 0.1NTU to a maximum of 8328.1NTU. A median value of 0.5NTU indicates that there is a very low level of background turbidity at this station (Table 8).

There were limited turbidity events at this station over the course of deployment (Figure 6). This is typical for this site, which is pristine in nature and far removed from the Voisey's Bay mine site. The maximum value was caused by the instrument being buried in sediment. Turbidity levels can be influenced by precipitation and subsequent runoff. It is common to see levels increase during these events and it is important that the turbidity levels return to natural levels after such events.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Turbidity, Precipitation & Stage at Reid Brook at Outlet of Reid Pond

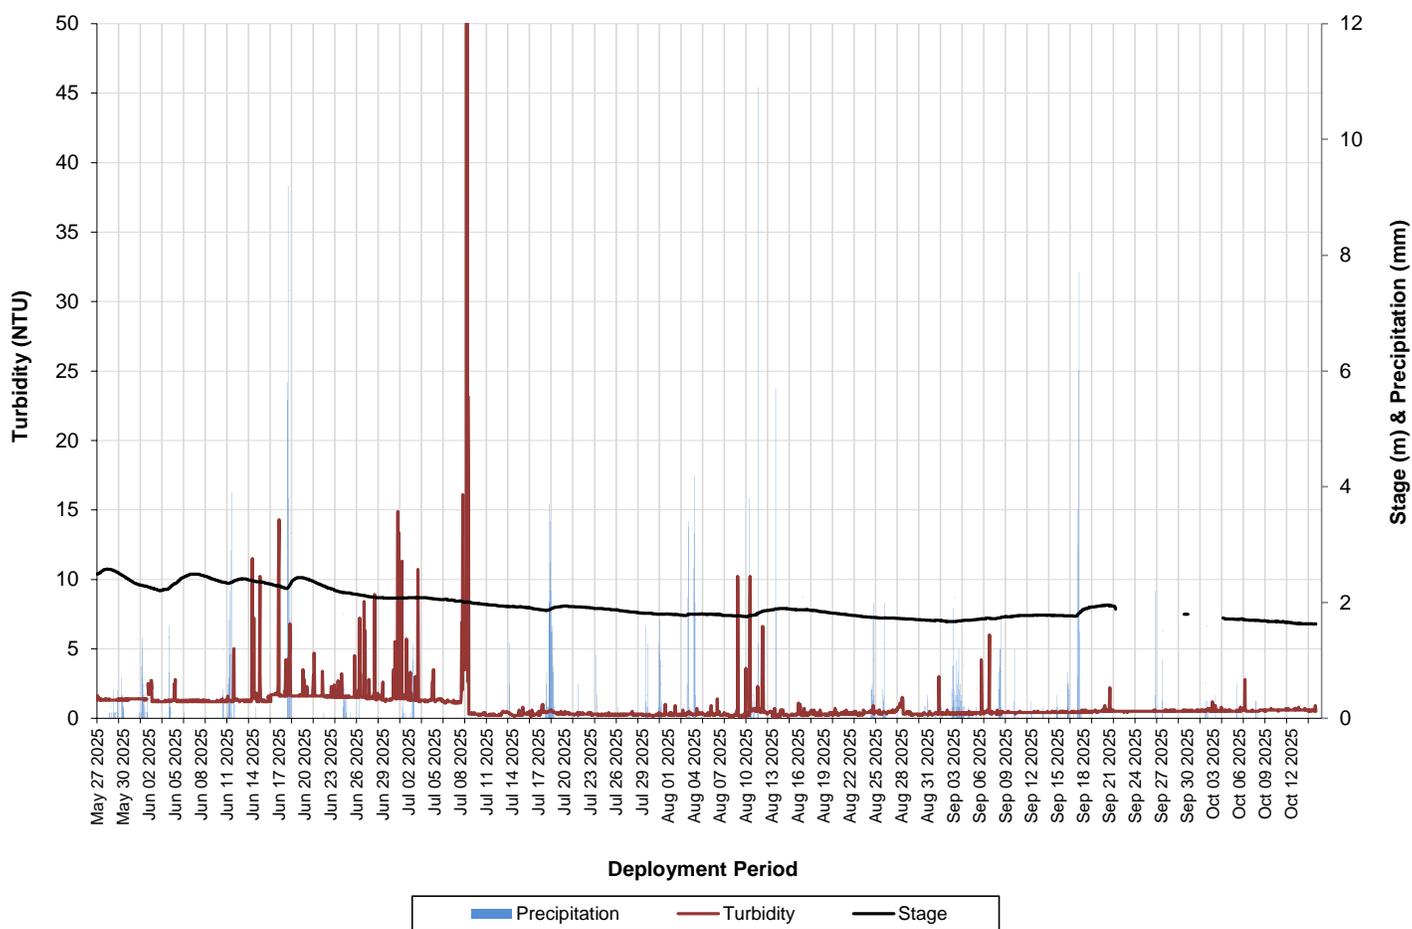


Figure 6: Turbidity & Stage at Reid Brook at Outlet of Reid Pond

Table 8: Comparisons of Minimum, Maximum and Median from the past three deployment years

Turbidity	2025	2024	2023
Min	0.1	0	0
Max	8328.1	652	3.4
Median	0.5	0	0

Camp Pond Brook below Camp Pond

During the 2025 deployment season, water temperature ranged from 2.09°C to a maximum of 22.13°C. The median temperature of 11.37°C was lower than those from the 2024 and 2023 deployment seasons (Table 9).

Water temperature was highest throughout July and August (Figure 7). Water temperatures started to noticeably decrease from mid-August onwards as ambient air temperatures also decreased (Figure 8).

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Water Temperature & Stage at Camp Pond Brook below Camp Pond

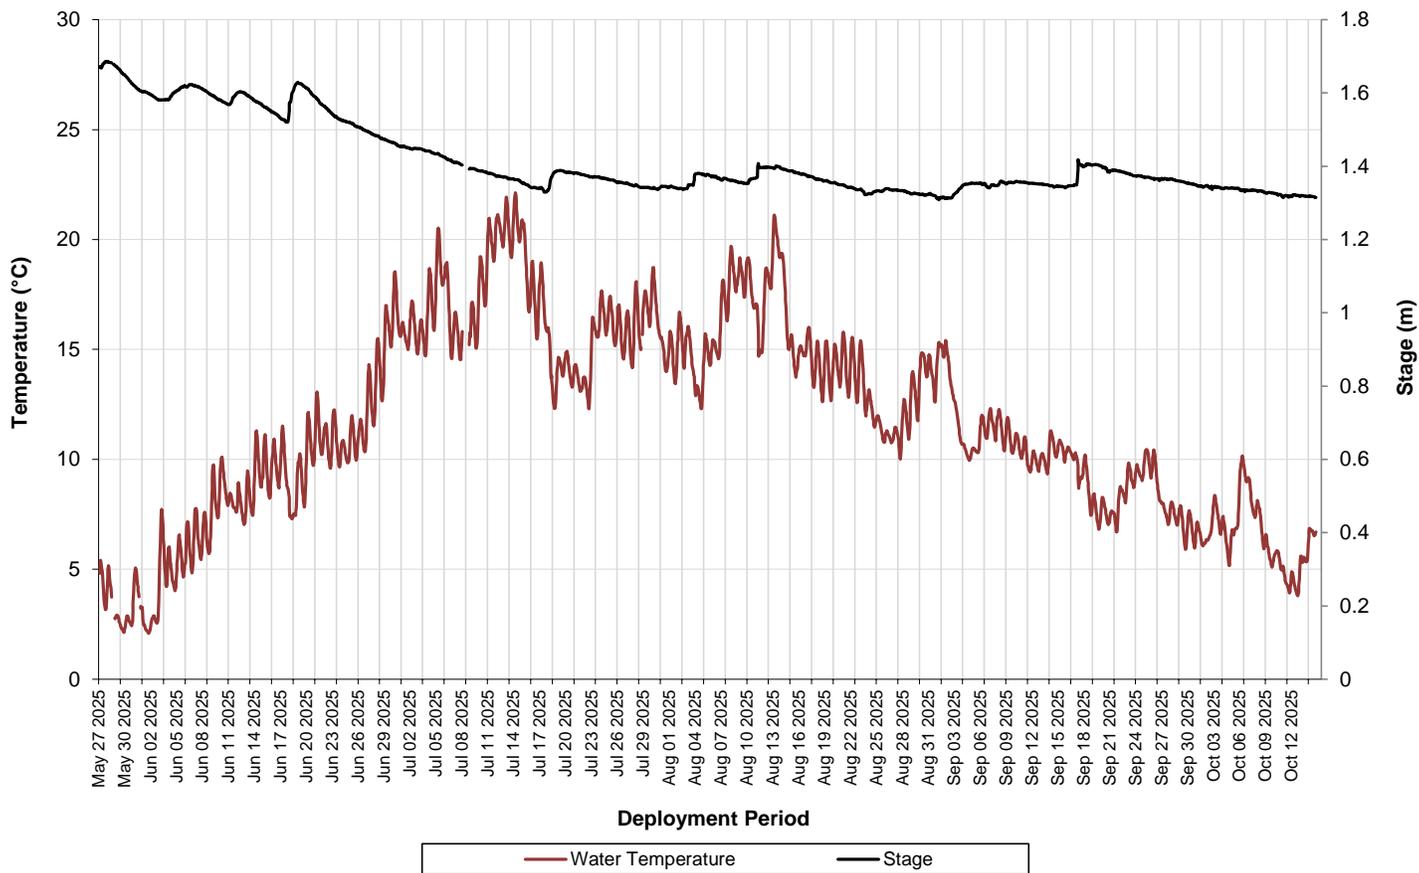


Figure 7: Water Temperature & Stage at Camp Pond Brook below Camp Pond

Table 9: Comparisons of Minimum, Maximum and Median from the past three deployment years

Water Temperature	2025	2024	2023
Min	2.09	2.94	3.01
Max	22.13	19.37	24.80
Median	11.37	12.99	13.57

Water temperatures showed a close relationship with ambient air temperatures (Figure 8); increases and decreases in air temperatures were reflected in similar changes in water temperatures. Air temperatures fluctuate to a greater extent than water temperatures. Air temperature data was obtained from the Voisey's Bay Weather Station located at the airstrip.

Water Temperature & Air Temperature at Camp Pond Brook below Camp Pond

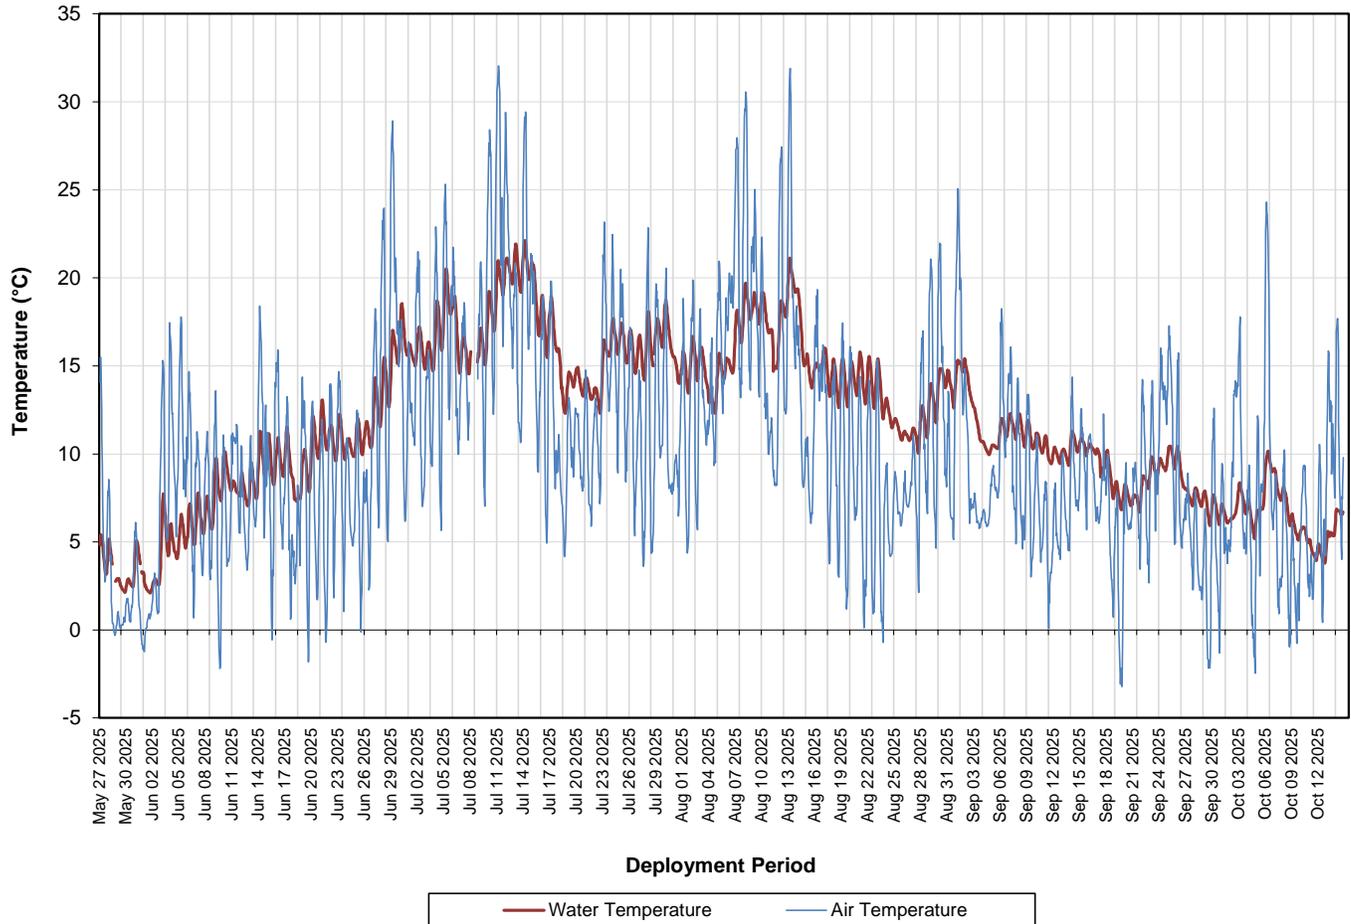


Figure 8: Water Temperature & Air Temperature at Camp Pond Brook below Camp Pond

During the 2025 deployment season, pH ranged from 6.44 pH units to a maximum of 7.14 pH units. The median value of 6.91 was very similar to those from 2024 and 2023 (Table 10).

Stage is included in the graph below to show the relationship between water level and pH values. Across the deployment season, pH data was reasonably stable after the first two weeks when it steadily rose. pH values were within the CCME's Guidelines for the Protection of Aquatic Life for the entirety of the deployment season (Figure 9) except for the initial acclimation period when values started at just below 6.5 pH units.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

pH & Stage at Camp Pond Brook below Camp Pond

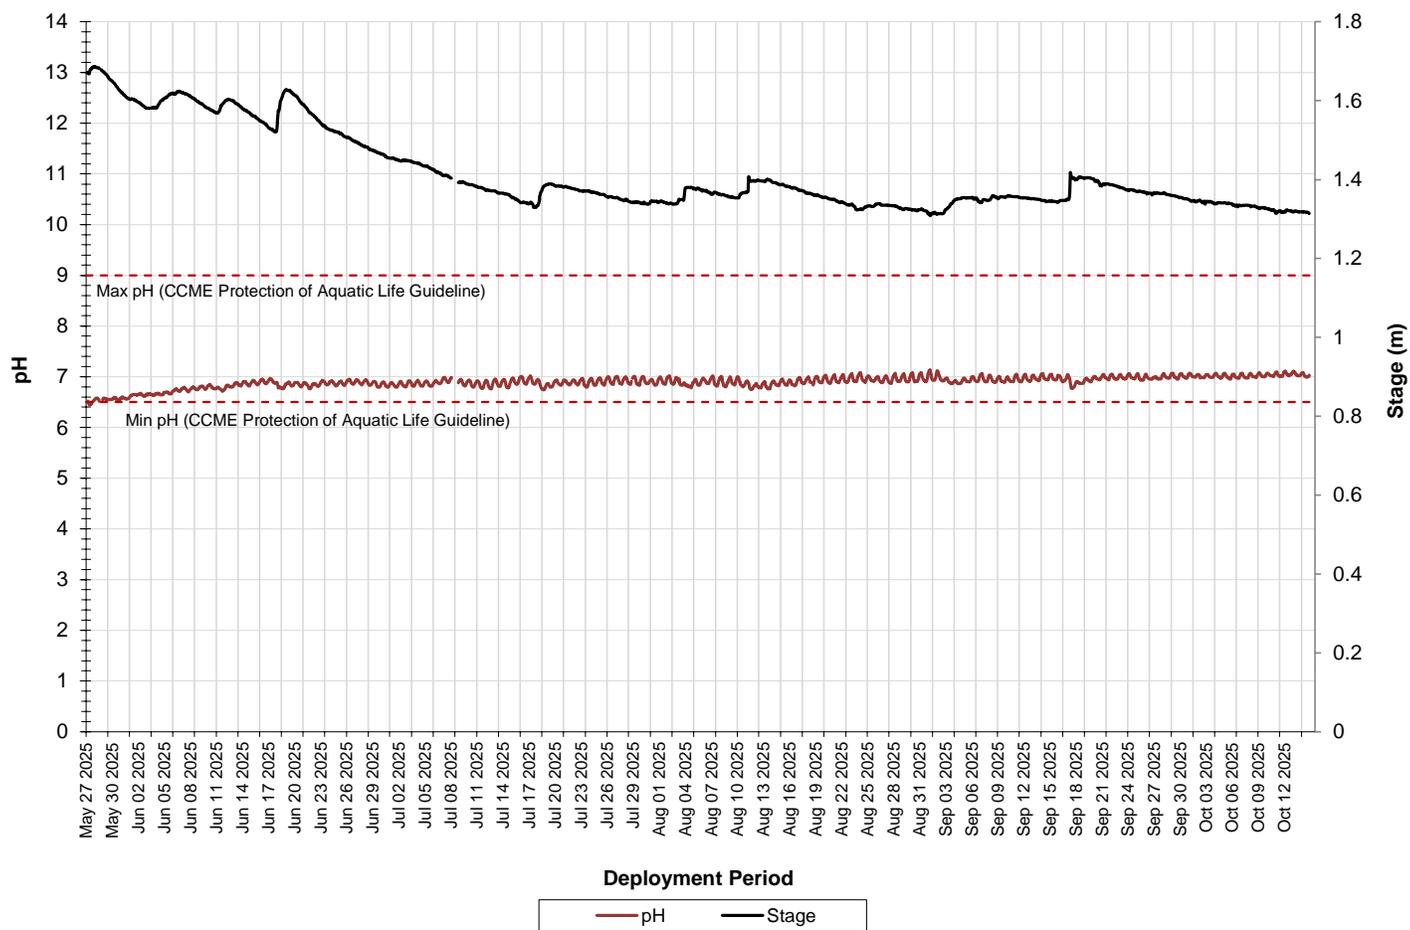


Figure 9: pH & Stage at Camp Pond Brook below Camp Pond

Table 10: Comparisons of Minimum, Maximum and Median from the past three deployment years

pH	2025	2024	2023
Min	6.44	5.97	6.11
Max	7.14	7.06	7.30
Median	6.91	6.70	6.93

During the 2025 deployment season, specific conductivity ranged from 23.4µS/cm to a maximum of 92.04µS/cm (Figure 10). The median value of 44.06µS/cm was lower than previous years (Table 11).

Stage is included in the graph below to illustrate the relationship between conductivity and water level (Figure 10). In general, stage and conductivity exhibit an inverse relationship: when one parameter increases, the other decreases. In some instances, however, sharp increases in stage correlate with similar increases in conductivity, which is likely due to increased rainfall and runoff. This site is in close proximity to the mine site and so is heavily influenced by runoff factors that the other Voisey's Bay real-time stations do not experience.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Specific Conductivity & Stage at Camp Pond Brook below Camp Pond

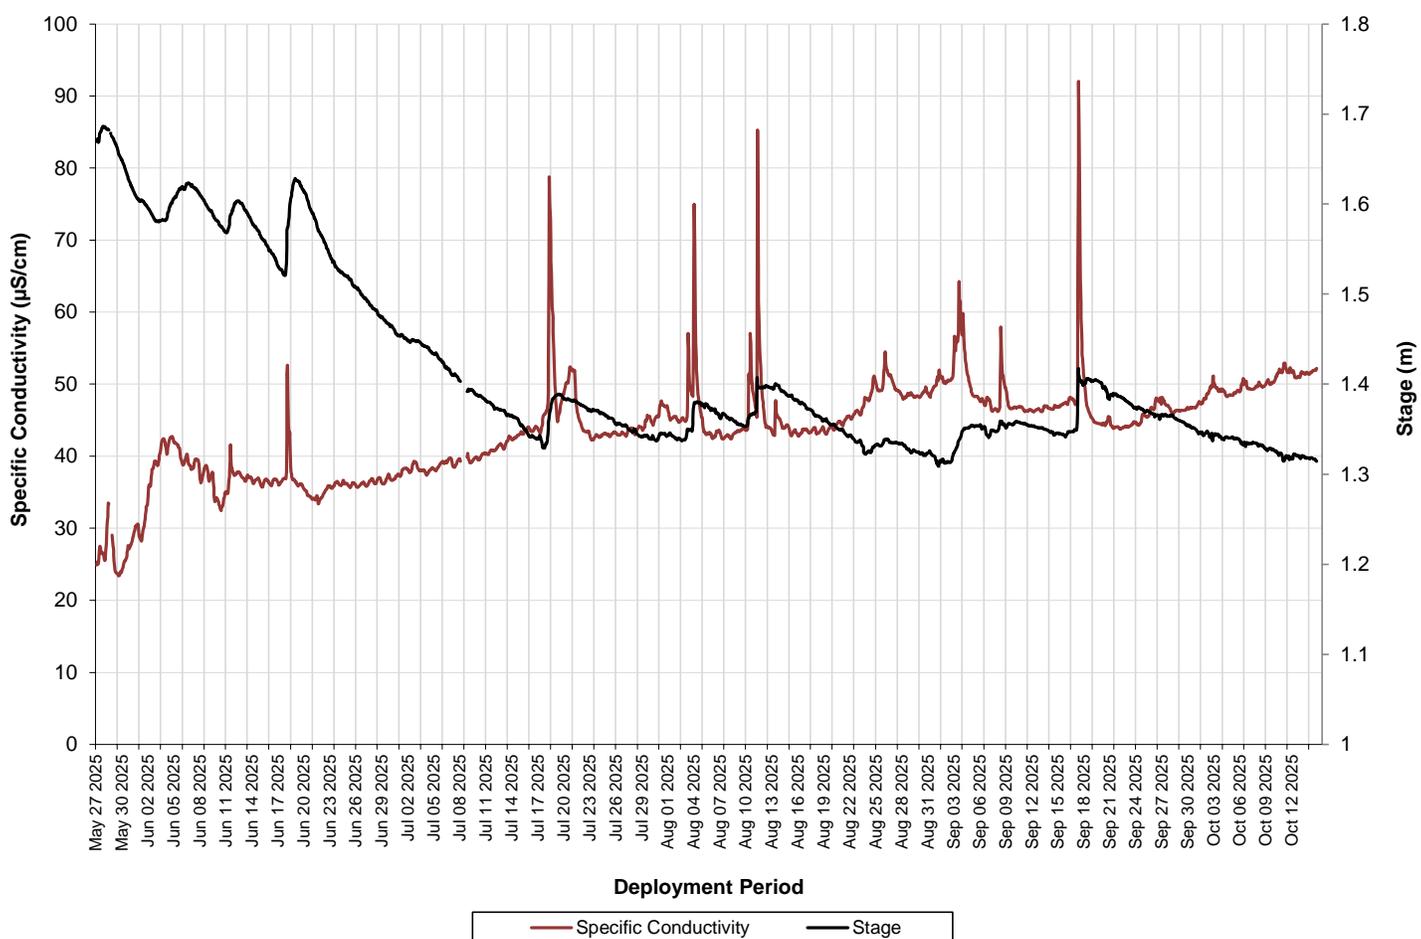


Figure 10: Specific Conductivity & Stage at Camp Pond Brook below Camp Pond

Table 11: Comparisons of Minimum, Maximum and Median from the past three deployment years

Specific Conductivity	2025	2024	2023
Min	23.4	34.6	21.4
Max	92.04	109.4	178.7
Median	44.06	48.5	53.0

During the 2025 deployment season, dissolved oxygen concentrations ranged from 7.91mg/L to a maximum of 13.03mg/L, with a median value of 10.55mg/L which is slightly higher than previous years. Saturation of dissolved oxygen ranged from 87% to 107.3%, with a median value of 95.7%, similar to previous years (Table 12). The higher values than previous years are due to the instrument being deployed earlier in the year, in May, when water temperatures were cool and dissolved oxygen was high.

Dissolved oxygen concentrations exhibited typical seasonal trends and were inversely related to water temperature. Dissolved oxygen concentrations were lowest early July to mid-August when water temperatures were warmest. As water temperatures decreased into late summer and fall, dissolved oxygen concentrations began to increase. Frequent fluctuations in dissolved oxygen levels are consistent with smaller daily changes in water temperature (Figure 11).

Dissolved oxygen concentrations were below the CCME's Guideline for the Protection of Early Life Stages (9.5mg/L) from early July to mid-August. This is to be expected as they correspond closely with increased water temperatures during the same time frame. Dissolved oxygen concentrations remained above the CCME's Guideline for the Protection of Other Life Stages (6.5mg/L) for the duration of the deployment season.

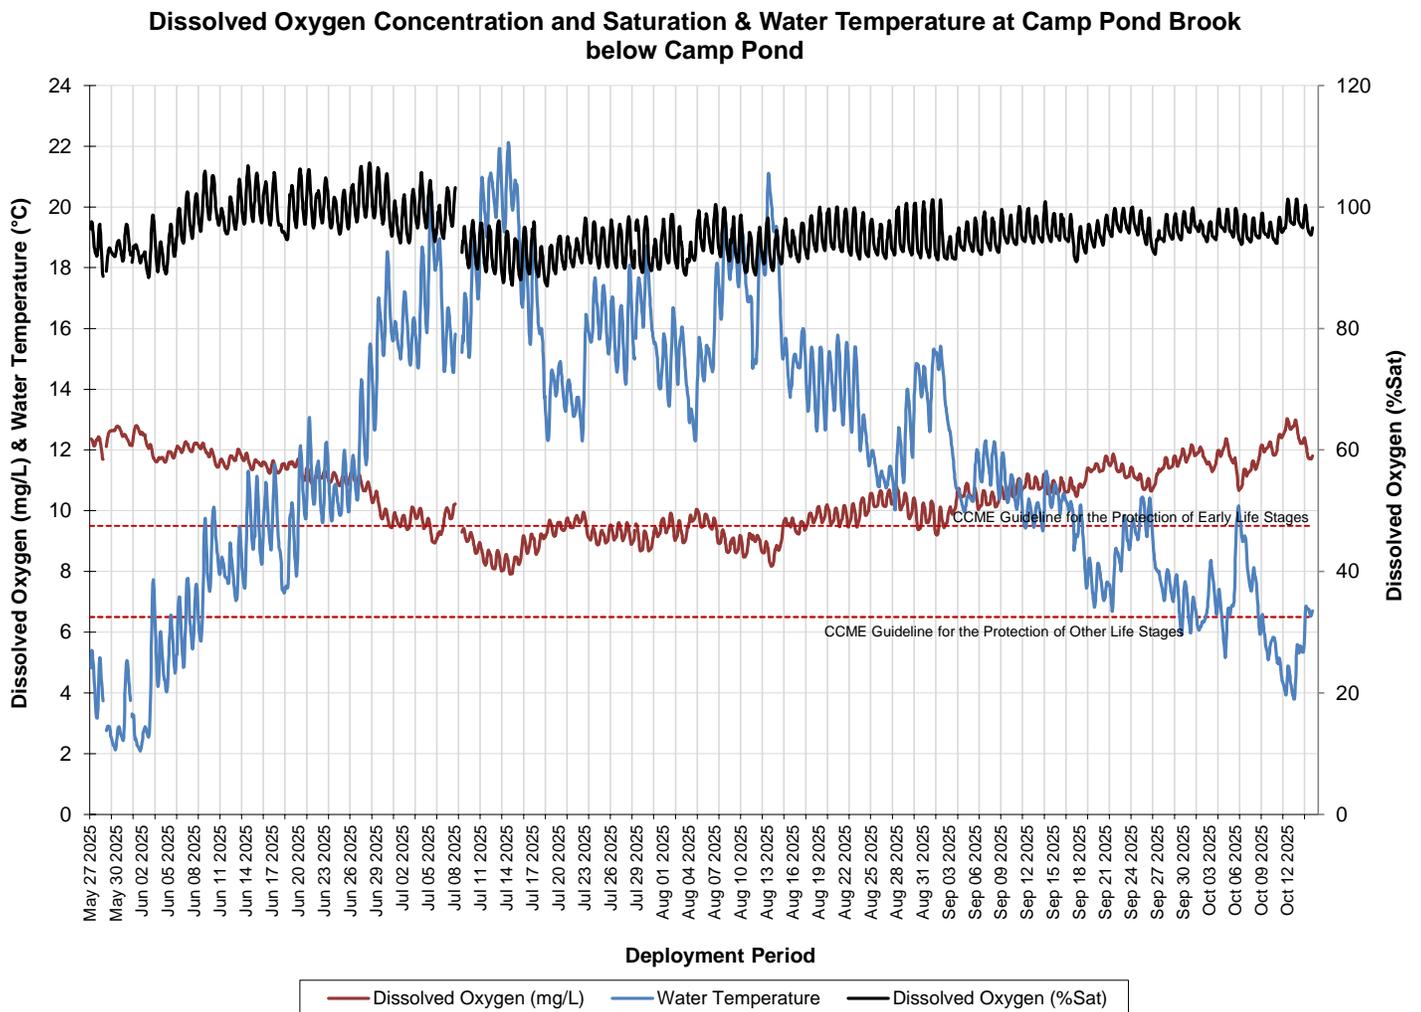


Figure 11: Dissolved Oxygen Concentration and Saturation & Water Temperature at Camp Pond Brook below Camp Pond

Table 12: Comparisons of Minimum, Maximum and Median from the past three deployment years

Dissolved Oxygen (mg/L)	2025	2024	2023
Min	7.91	8.14	7.27
Max	13.03	11.70	12.56
Median	10.55	9.52	9.56

Percent Saturation (%)	2025	2024	2023
Min	87	82.2	81.0
Max	107.3	97.8	103.1
Median	95.7	90.0	93.9

During the 2025 deployment season, turbidity values ranged from 0.4NTU to a maximum of 409.6NTU, with a median value of 1.1NTU (Figure 12). A median value of 1.1NTU indicates that there is a very small amount of natural background turbidity at this station, which is similar to previous years (Table 13).

There were a number of turbidity spikes throughout the deployment season, the majority of which corresponded with precipitation events and subsequent increases in stage.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Turbidity, Precipitation & Stage at Camp Pond Brook below Camp Pond

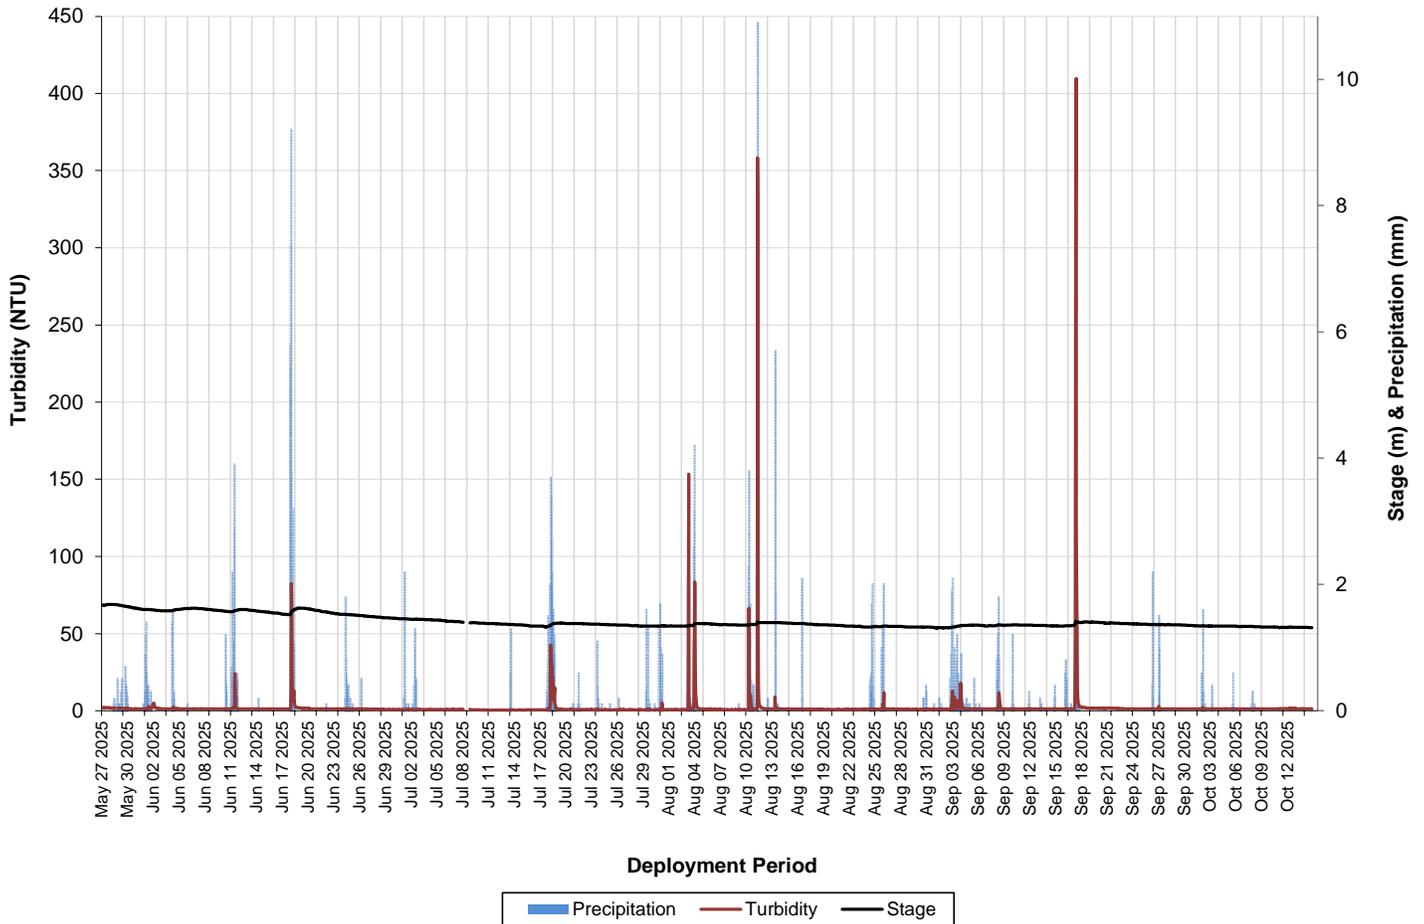


Figure 12: Turbidity & Stage at Camp Pond Brook below Camp Pond

Table 13: Comparisons of Minimum, Maximum and Median from the past three deployment years

Turbidity	2025	2024	2023
Min	0.4	0.0	0.0
Max	409.6	270.5	568
Median	1.1	0.0	0.0

Reid Brook below Tributary

During the 2025 deployment season, water temperature ranged from 1.32°C to a maximum of 18.16°C, with a median value of 8.88°C (Table 14). Water temperatures were highest mid-July through mid-August as air temperatures increased with the summer season. From mid-August onwards, water temperatures steadily declined as ambient air temperatures cooled into the Fall (Figure 13 & 14).

Median water temperature was lower in 2025 than in previous years at this station (Table 14) due to the instrument having been deployed earlier than normal and recording more cooler temperatures at that time.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Water Temperature & Stage at Reid Brook below Tributary

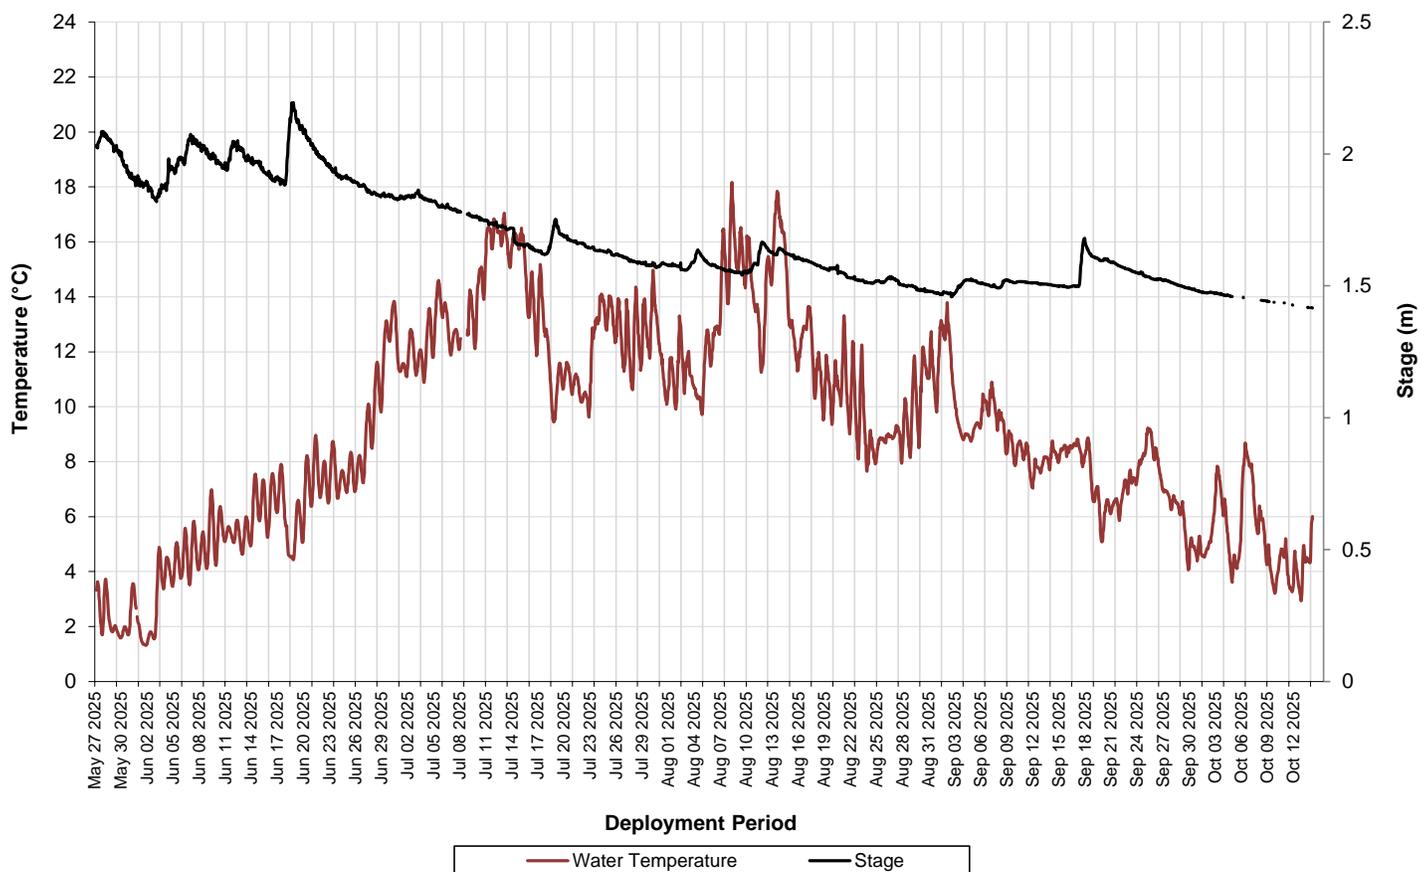


Figure 13: Water Temperature & Stage at Reid Brook below Tributary

Table 14: Comparisons of Minimum, Maximum and Median from the past three deployment years

Water Temperature	2025	2024	2023
Min	1.32	2.38	2.04
Max	18.16	16.62	21.87
Median	8.88	9.96	11.09

Water temperatures closely correlate with ambient air temperatures, with increases and decreases in ambient air temperatures being reflected in water temperatures (Figure 14). Air temperatures fluctuate to a greater extent each day as compared to water temperatures. Air temperature data was obtained from the Voisey's Bay Weather Station located at the airstrip.

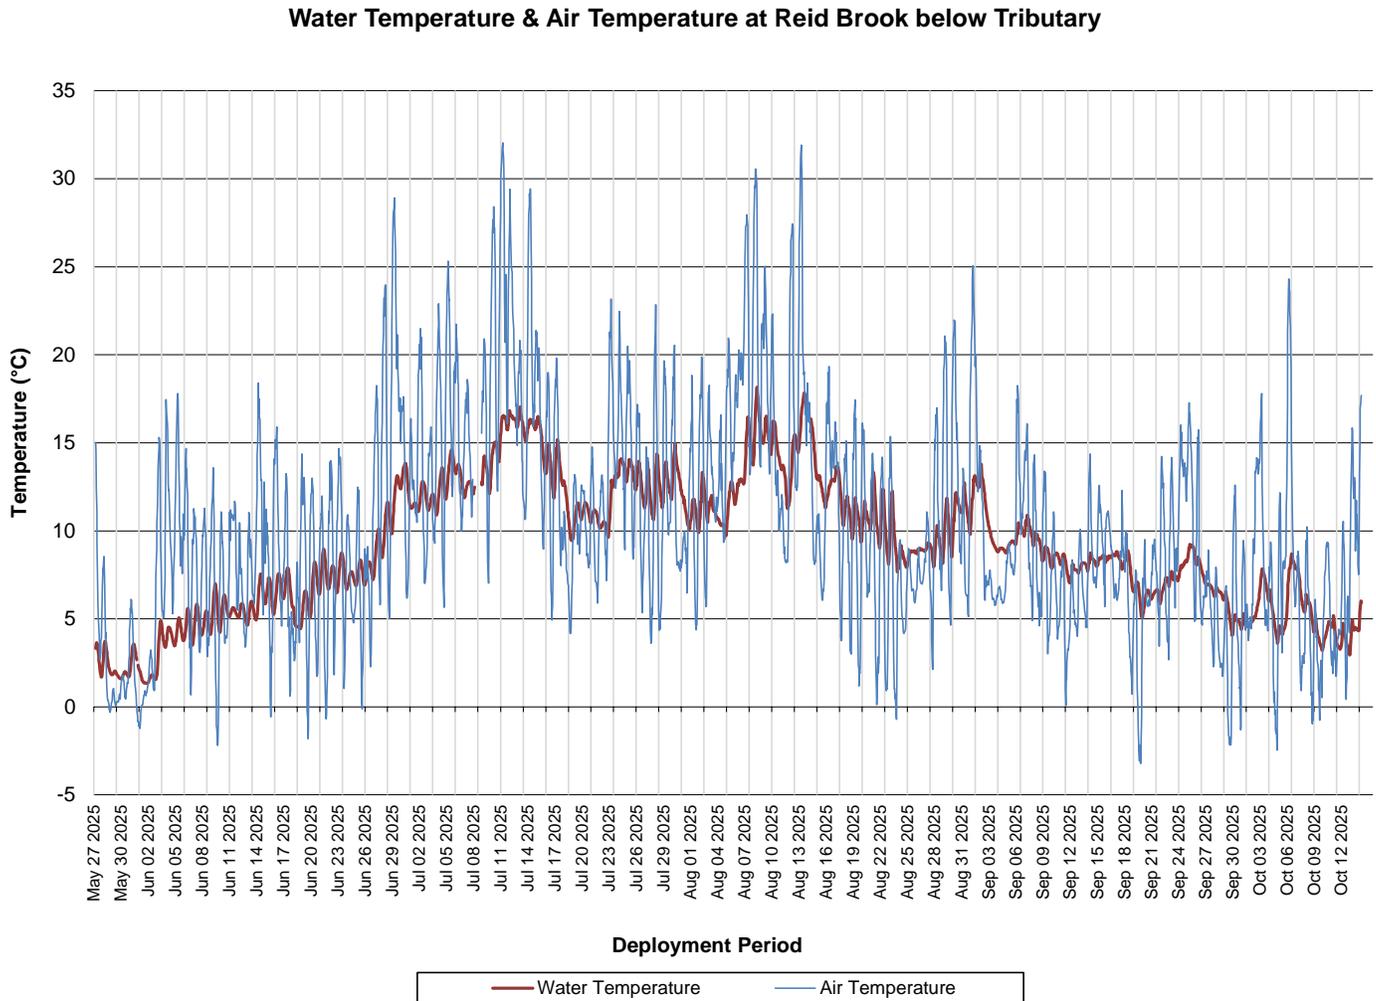


Figure 14: Water Temperature & Air Temperature at Reid Brook below Tributary

During the 2025 deployment season, pH ranged from 5.95 pH units to a maximum of 7.35 pH units, with a median value of 7.13 (Figure 15), which was higher than in recent years (Table 15).

Stage data is included in Figure 15 to show how stage influences pH over time. In general, as stage decreases, pH increases and vice versa. This is a natural relationship and is expected in brooks. Sudden increases in stage also typically correlate with sudden decreases in pH.

pH values at this site were below the CCME's Guidelines for the Protection of Aquatic Life for about a third of the deployment season. There may have been issues with the pH sensor causing the first deployment to record values just below the minimum pH guideline.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

pH & Stage at Reid Brook below Tributary

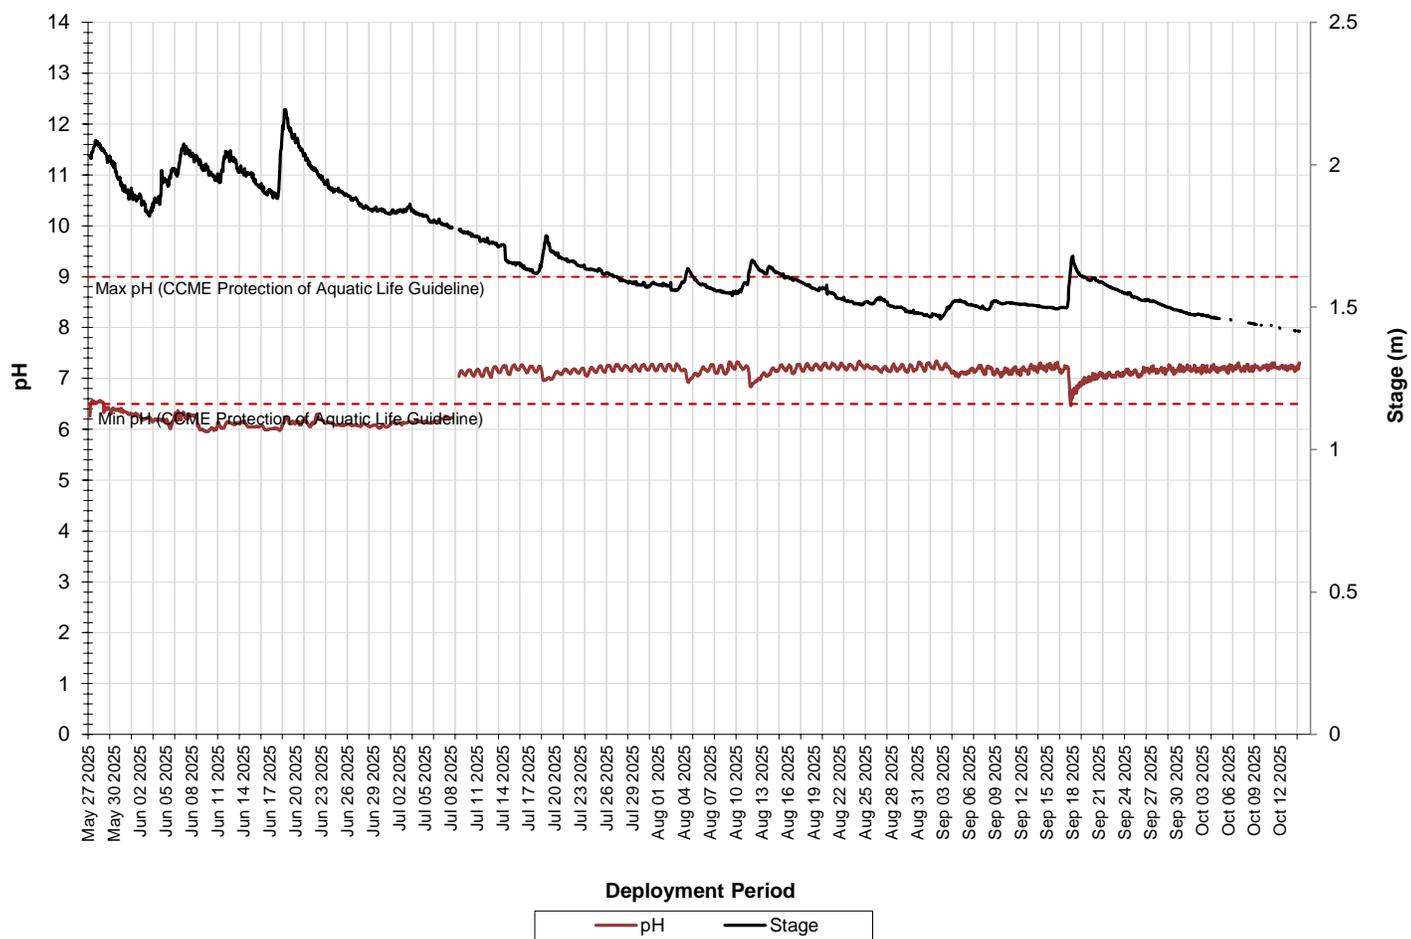


Figure 15: pH & Stage at Reid Brook below Tributary

Table 15: Comparisons of Minimum, Maximum and Median from the past three deployment years

pH	2025	2024	2023
Min	5.95	5.30	6.00
Max	7.35	7.14	8.69
Median	7.13	6.60	6.90

During the 2025 deployment season, specific conductivity levels ranged from 10.25µS/cm to a maximum of 66.8µS/cm, with a median value of 44.34µS/cm (Table 16). This median value is almost identical to the previous year (Figure 16).

Specific conductivity changes with water level fluctuations: as stage increases, specific conductivity decreases. This is due to dilution of dissolved solids in the water column; as stage decreases, the concentration of dissolved solids increases, in turn increasing specific conductivity. This relationship is evident in the graph below.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Specific Conductivity & Stage at Reid Brook below Tributary

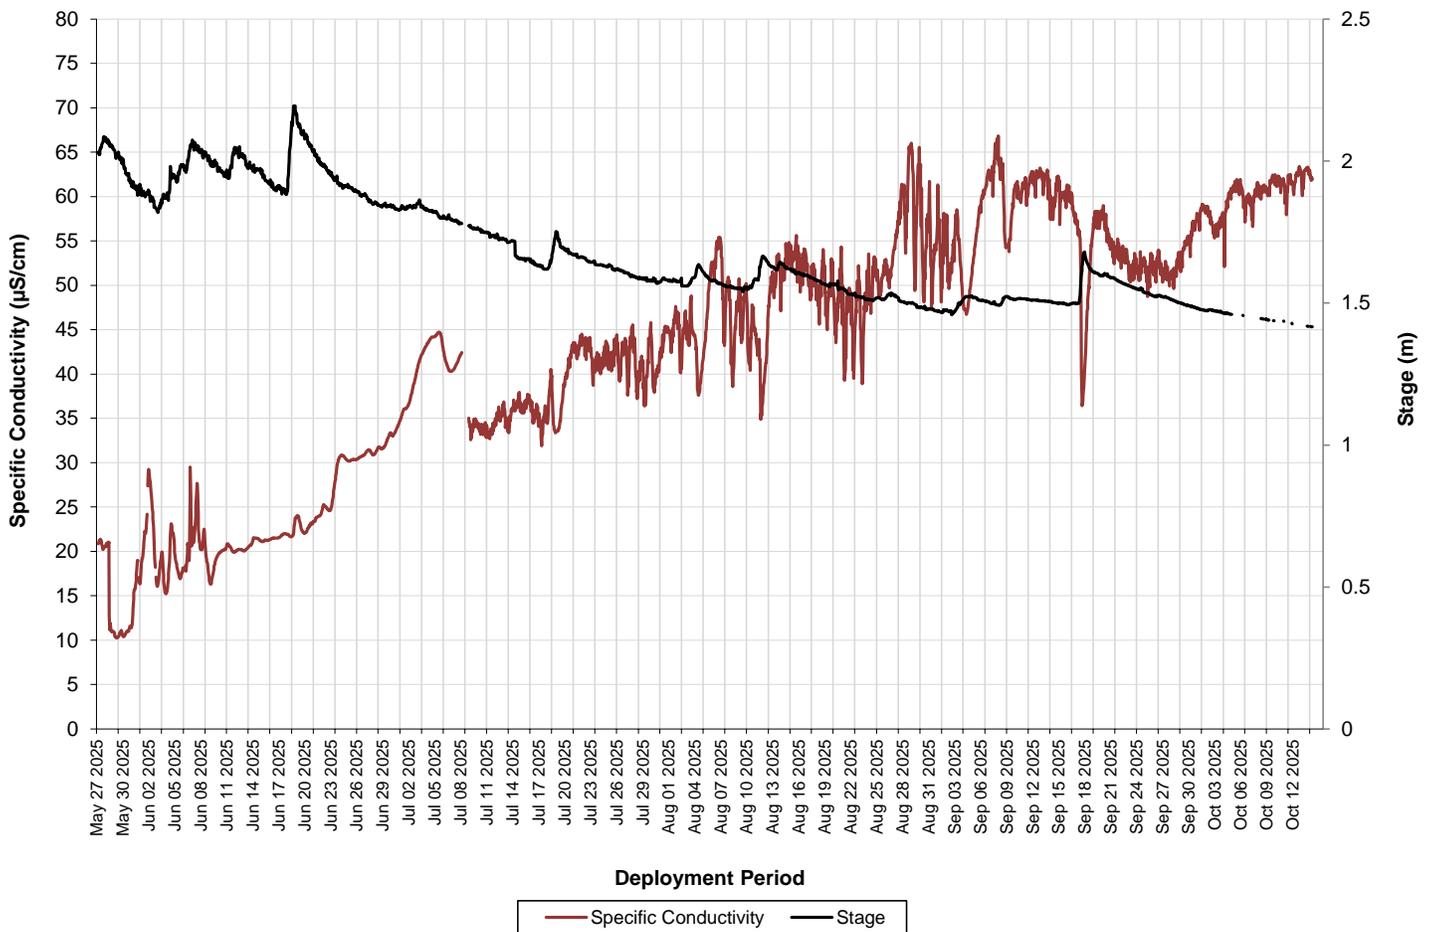


Figure 16: Specific Conductivity & Stage at Reid Brook below Tributary

Table 16: Comparisons of Minimum, Maximum and Median from the past three deployment years

Specific Conductivity	2025	2024	2023
Min	10.25	28.8	7.5
Max	66.8	63.9	74.1
Median	44.34	44.2	32.1

During the 2025 deployment season, dissolved oxygen concentrations ranged from 0.01mg/L to a maximum of 13.83mg/L, with a median value of 10.87mg/L. The saturation of dissolved oxygen ranged from 0% to 106.9%, with a median value of 99.9% (Figure 17). Despite the low minimum values June-July, caused by the instrument being buried in sediment, the dissolved oxygen median values have been very consistent at this site over recent years (Table 17).

When not buried, dissolved oxygen concentrations were lowest through July to mid-August when water temperatures were highest. Increases in water temperature result in less dissolved oxygen being present in a water body. As water temperatures started to decrease from mid-August onwards, dissolved oxygen concentrations started to increase.

When not buried, dissolved oxygen concentrations remained above the CCME's Guidelines for the Protection of Early Life Stages (9.5mg/L) and Other Life Stages (6.5mg/L) for the majority of the deployment season. Instances where dissolved oxygen levels fell below the CCME's Guideline for the Protection of Early Life Stages correlated closely with periods of warmer water temperatures.

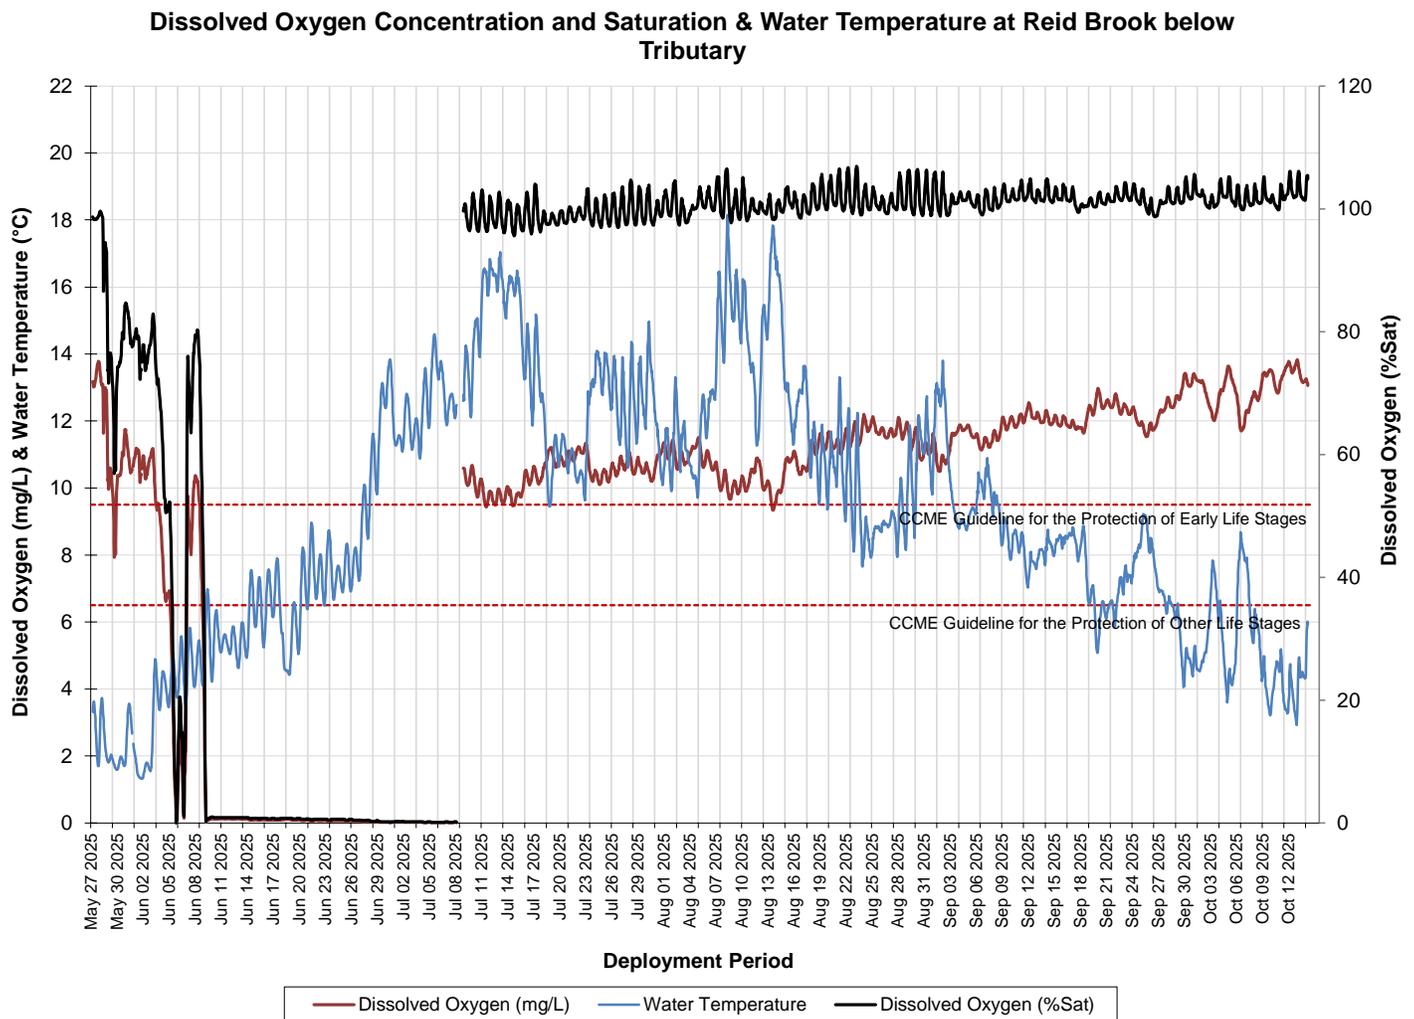


Figure 17: Dissolved Oxygen Concentration and Saturation & Water Temperature at Reid Brook below Tributary

Table 17: Comparisons of Minimum, Maximum and Median from the past three deployment years

Dissolved Oxygen (mg/L)	2025	2024	2023
Min	0.01	9.18	5.76
Max	13.83	13.48	14.13
Median	10.87	10.98	10.72

Percent Saturation (%)	2025	2024	2023
Min	0	93.0	49.8
Max	106.9	103.0	110.6
Median	99.9	96.8	99.9

During the 2025 deployment season, turbidity ranged from 0.5NTU to a maximum of 372.1NTU, with a median value of 2.39NTU (Figure 18). A median value of 2.39NTU indicates that there is some background turbidity at this station which is higher than previous years. This may be related to increased sediment disturbances and accumulation which occurred in June at this station (Table 18).

Turbidity increases at this site typically corresponded with rainfall events and subsequent runoff.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Turbidity, Precipitation & Stage at Reid Brook below Tributary

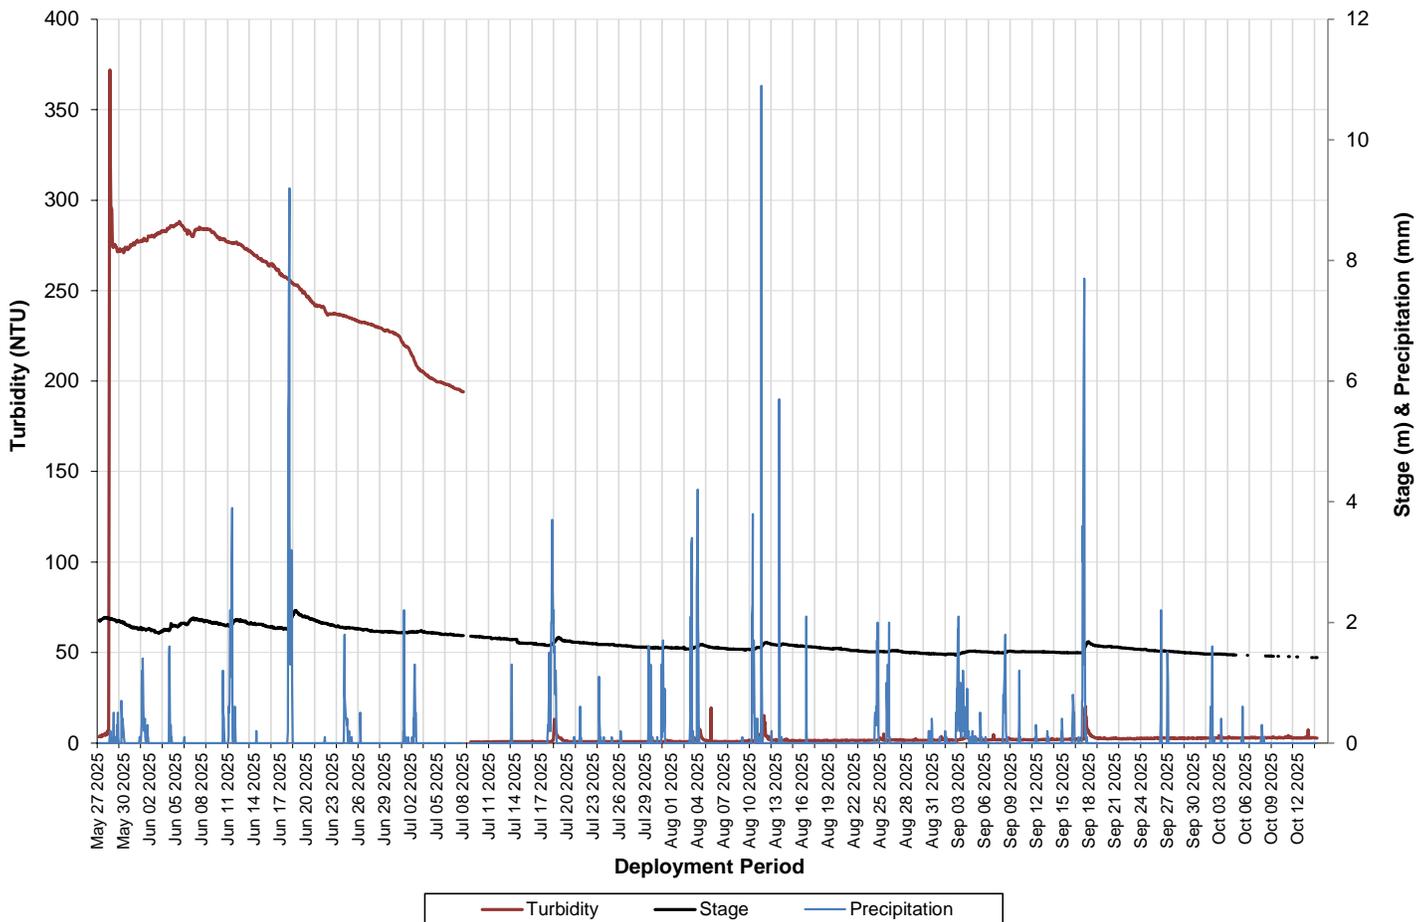


Figure 18: Turbidity, Precipitation & Stage at Reid Brook below Tributary

Table 18: Comparisons of Minimum, Maximum and Median from the past three deployment years

Turbidity	2025	2024	2023
Min	0.5	0	0.0
Max	372.1	24.0	2069
Median	2.39	1.3	0.0

Tributary to Reid Brook

During the 2025 deployment season, water temperature ranged from 1.06°C to a maximum of 17.81°C, with a median value of 8.92°C (Figure 19). Water temperature at this site has been fairly consistent over recent years (Table 19).

Water temperatures were highest through mid-July to mid-August as air temperatures increased with the summer season (Figure 19 & 20). From mid-August onwards, water temperatures steadily declined as ambient air temperatures also declined (Figure 20).

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Water Temperature & Stage at Tributary to Reid Brook

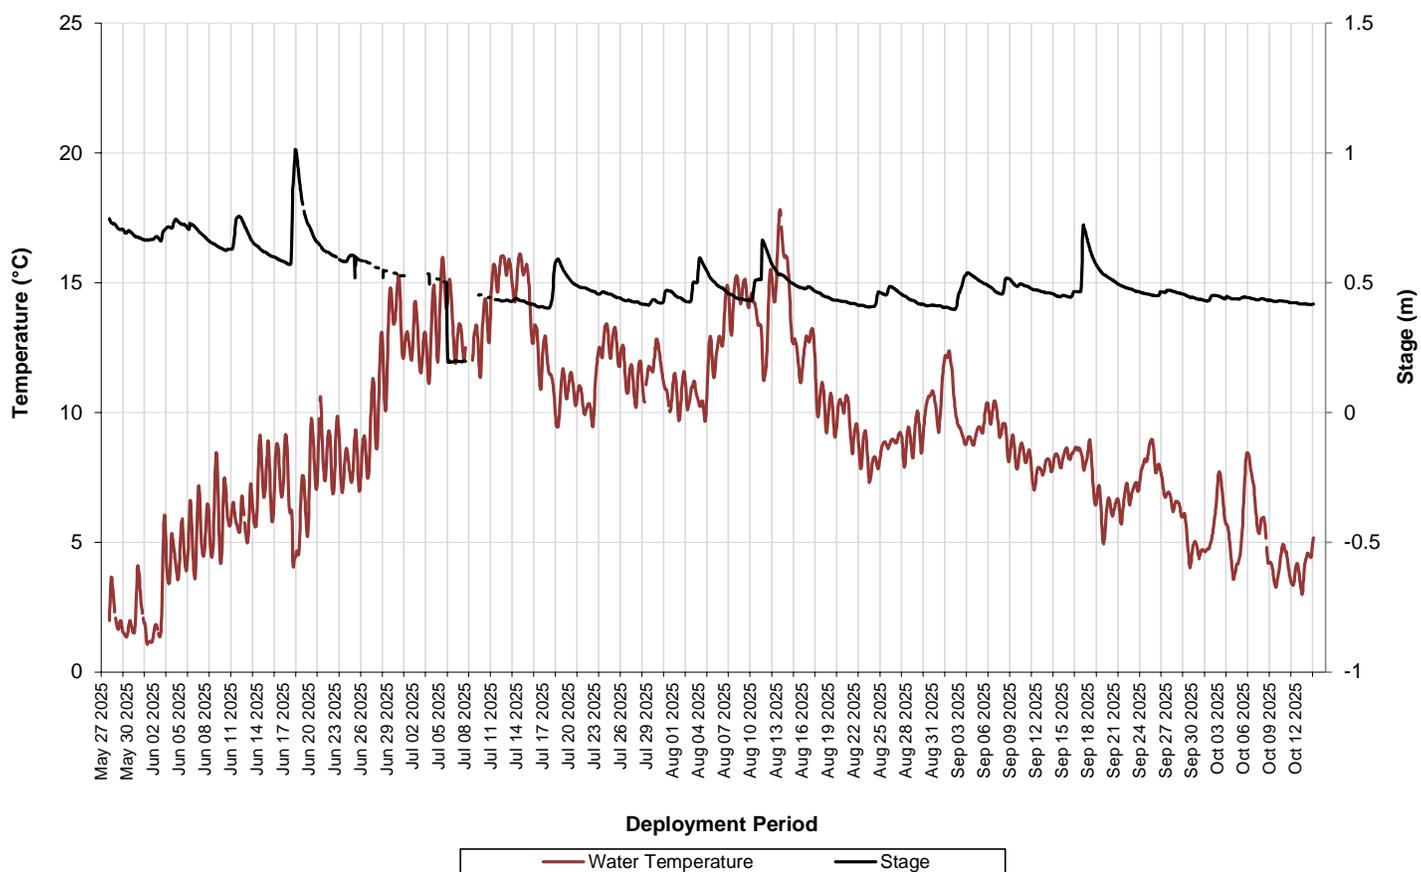


Figure 19: Water Temperature & Stage at Tributary to Reid Brook

Table 19: Comparisons of Minimum, Maximum and Median from the past three deployment years

Water Temperature	2025	2024	2023
Min	1.06	2.09	1.88
Max	17.81	16.06	17.63
Median	8.92	9.86	10.29

Water temperatures showed a close relationship with air temperatures (Figure 20). Fluctuations in air temperatures were reflected in water temperatures. Air temperatures fluctuate to a greater extent each day when compared with water temperatures.

Water Temperature & Air Temperature at Tributary to Reid Brook

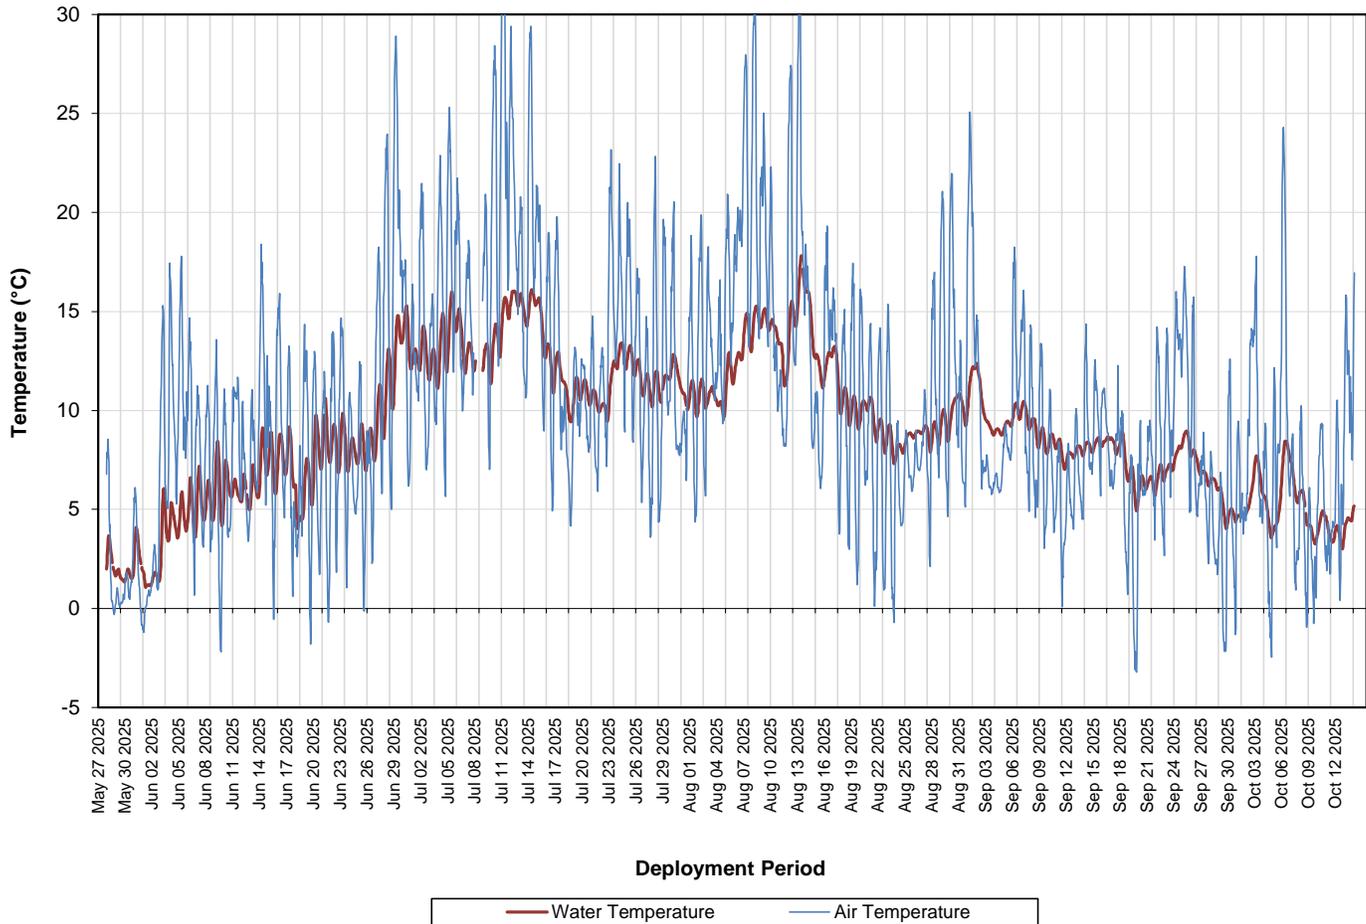


Figure 20: Water Temperature & Air Temperature at Tributary to Reid Brook

During the 2025 deployment season, pH data ranged from 5.85 to a maximum of 7.18 pH units, with a median value of 6.92 pH units (Table 20). Median values at this site over recent years are very similar.

Stage data is included in Figure 21 to show how stage influences pH over time. In general, as stage decreases pH increases, and vice versa. Sharp increases in stage correlate closely with sharp temporary decreases in pH.

pH values remained within the CCME's Guidelines for the Protection of Aquatic Life for the majority of the deployment season (Figure 21), dropping below the minimum guidelines briefly during stage increases.

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

pH & Stage at Tributary to Reid Brook

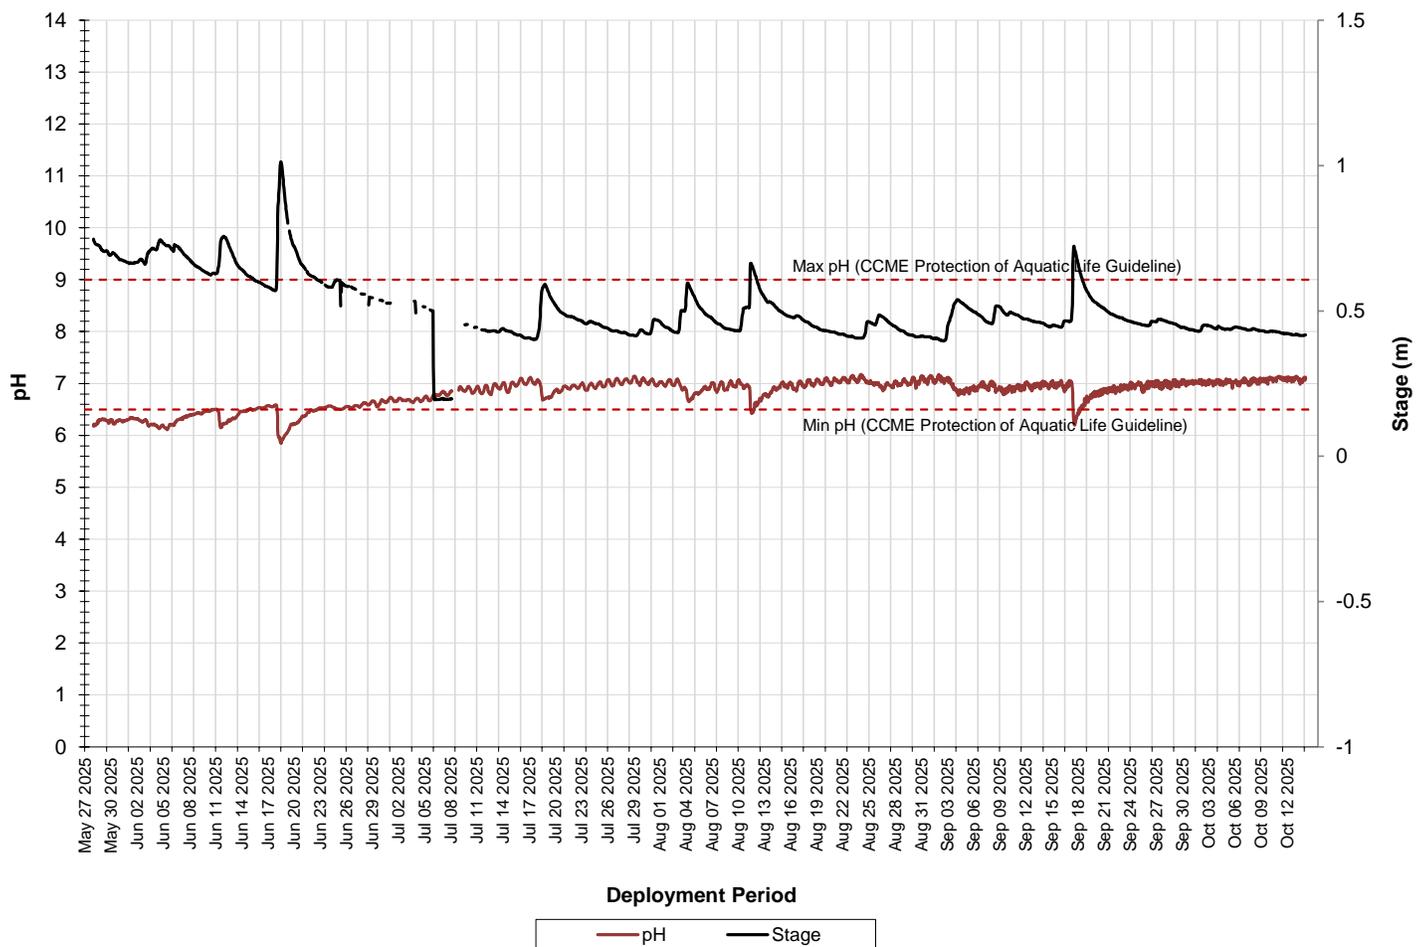


Figure 21: pH & Stage at Tributary to Reid Brook

Table 20: Comparisons of Minimum, Maximum and Median from the past three deployment years

pH	2025	2024	2023
Min	5.85	6.00	6.54
Max	7.18	8.04	7.23
Median	6.92	6.84	6.99

During the 2025 deployment season, specific conductivity ranged from 21.3 μ S/cm to a maximum of 69.73 μ S/cm, with a median value of 50.28 μ S/cm, which was similar to previous years (Table 21).

Specific conductivity demonstrated an increasing trend over the course of deployment, exhibiting a strong inverse relationship with stage. Increases in stage level dilute dissolved solids in the water column, in turn reducing specific conductivity. Inversely, as stage decreases specific conductivity increases as dissolved solids become more concentrated in the water column (Figure 22).

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Specific Conductivity & Stage at Tributary to Reid Brook

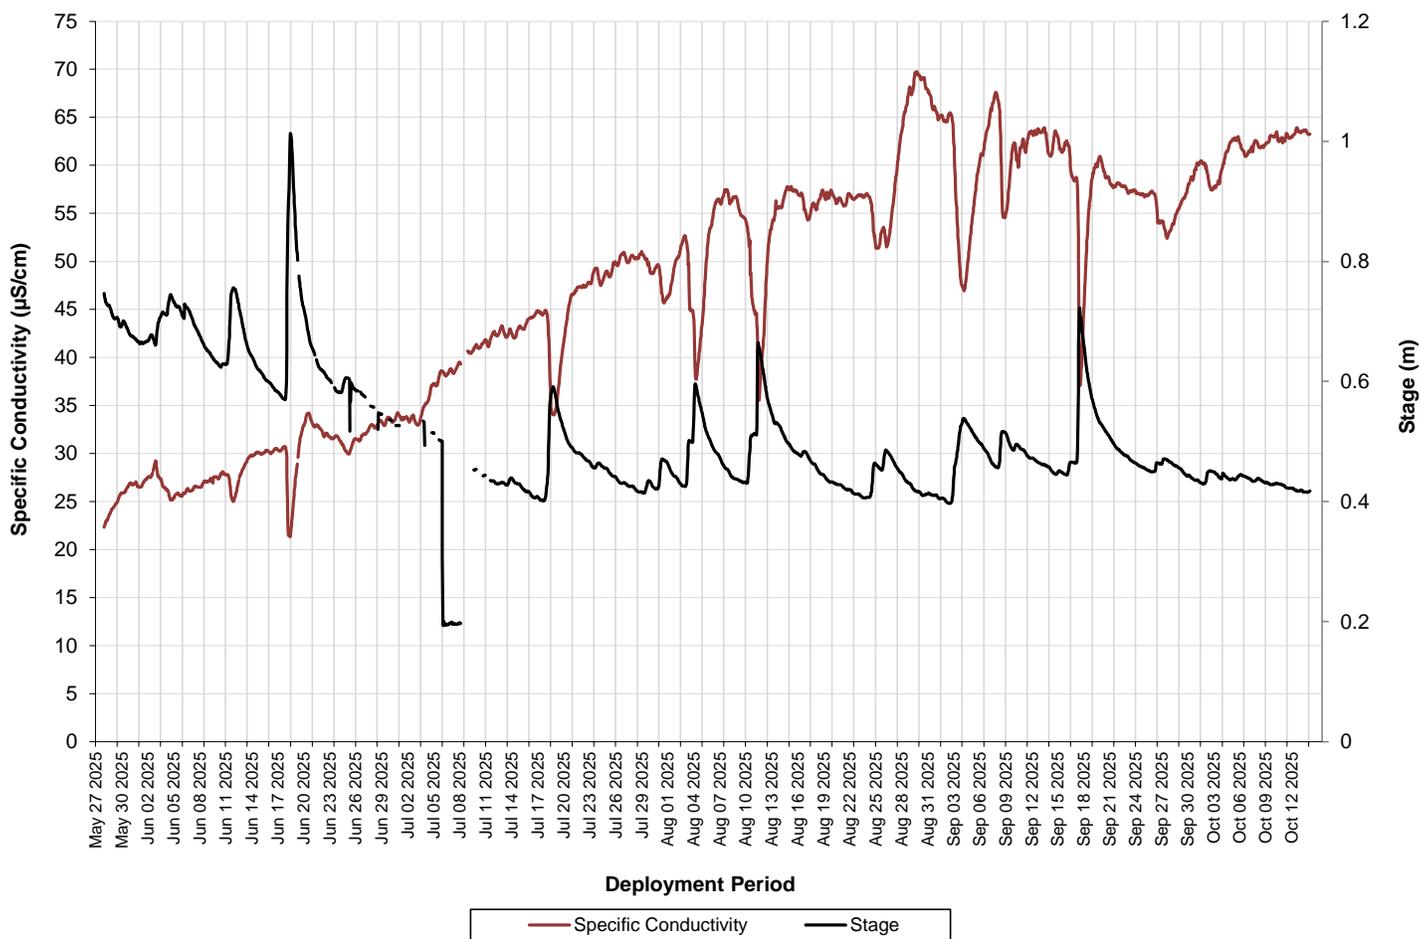


Figure 22: Specific Conductivity & Stage at Tributary to Reid Brook

Table 21: Comparisons of Minimum, Maximum and Median from the past three deployment years

Specific Conductivity	2025	2024	2023
Min	21.3	28.3	24.9
Max	69.73	59.6	54.2
Median	50.28	48.6	42.2

During the 2025 deployment season, dissolved oxygen concentration ranged from 9.06mg/L to a maximum of 13.93mg/L, with a median value of 11.32mg/L. Saturation of dissolved oxygen ranged from 94% to 102.5%, with a median value of 97.7% (Figure 23). Median values for both dissolved oxygen concentration and percent saturation were very similar to those from previous deployment seasons (Table 22).

Observed dissolved oxygen concentrations exhibited typical seasonal trends and were inversely related to water temperature. Dissolved oxygen concentrations were lowest mid-July through mid-August when water temperatures were warmest. Dissolved oxygen concentrations began to increase from mid-August onwards as water temperatures decreased (Figure 23).

Dissolved oxygen concentrations remained above the CCME's Guidelines for the Protection of Early Life Stages (9.5mg/L) for the majority of deployment; instances where dissolved oxygen levels fell below the guideline correlated closely with warmer water temperatures. Dissolved oxygen concentrations remained above the CCME's Guidelines for the Protection of Other Life Stages (6.5mg/L) for the full deployment season.

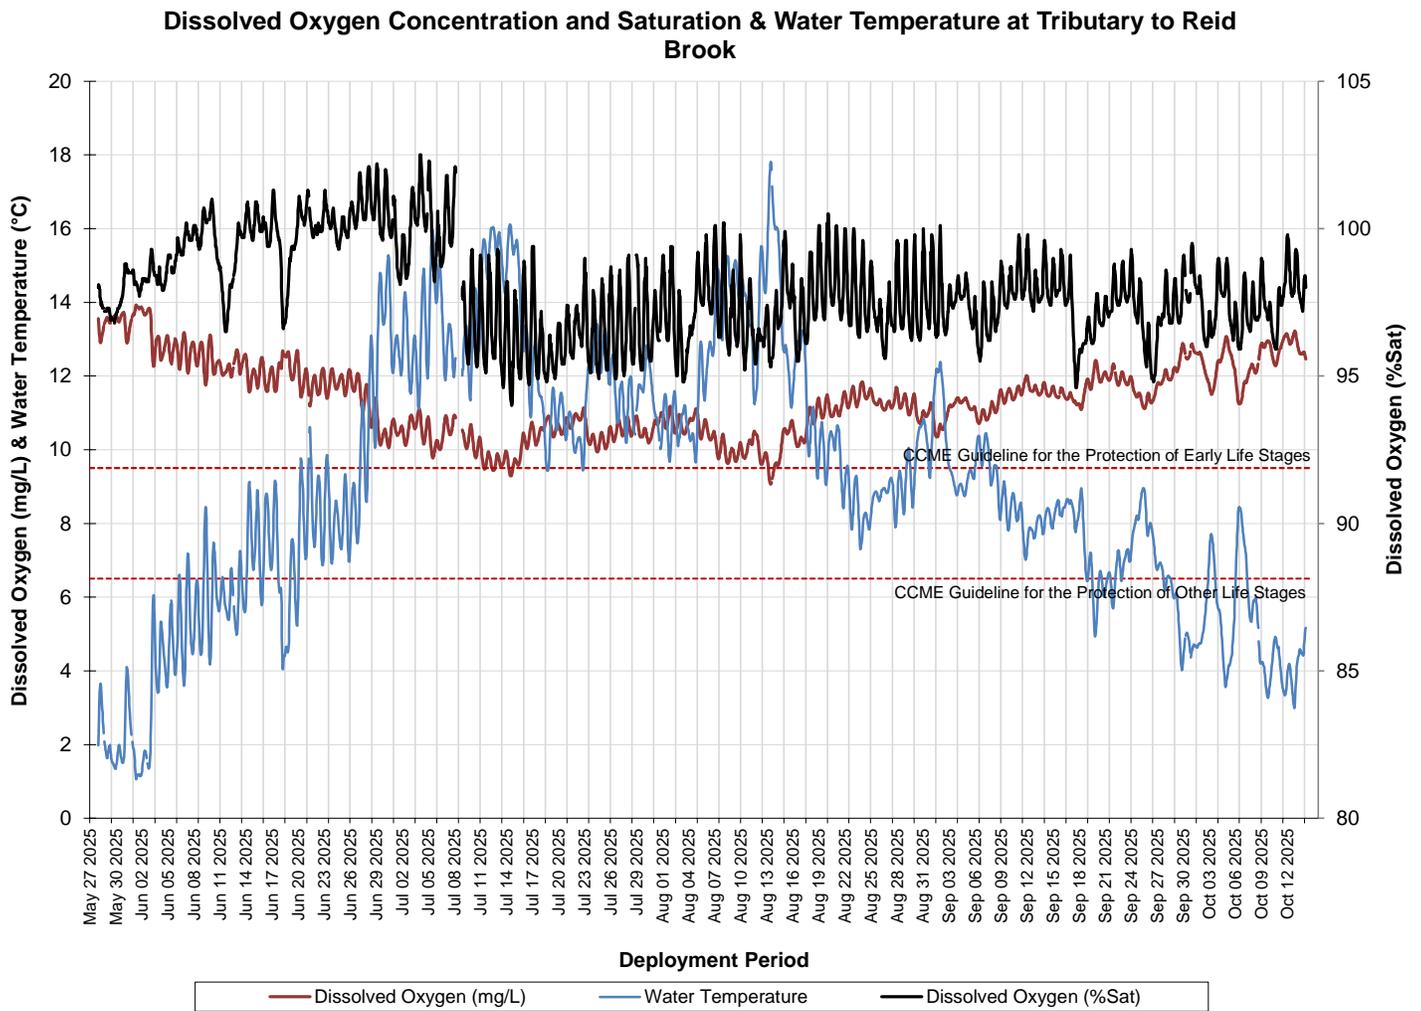


Figure 23: Dissolved Oxygen Concentration and Saturation & Water Temperature at Tributary to Reid Brook

Table 22: Comparisons of Minimum, Maximum and Median from the past three deployment years

Dissolved Oxygen (mg/L)	2025	2024	2023
Min	9.06	9.13	8.81
Max	13.93	13.23	13.41
Median	11.32	10.78	10.78

Percent Saturation (%)	2025	2024	2023
Min	94	91.3	92.7
Max	102.5	98.5	112.0
Median	97.7	94.8	96.9

During the 2025 deployment season, turbidity ranged from 0.6NTU to a maximum of 31.8NTU, with a median value of 1.7NTU (Table 23). This median represents a very low level of natural background turbidity, which is to be expected at this station and is the same as previous years (Table 23).

Over the course of the deployment season, increases in turbidity generally corresponded with increases in stage and precipitation events. This is to be expected as increased precipitation and run-off may introduce natural organic matter into the water column. Turbidity levels quickly returned to background levels (Figure 24).

Please note that the stage data on the graph below is raw data. It has not been corrected for backwater effect. WSC is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request to WSC.

Turbidity, Precipitation & Stage at Tributary to Reid Brook

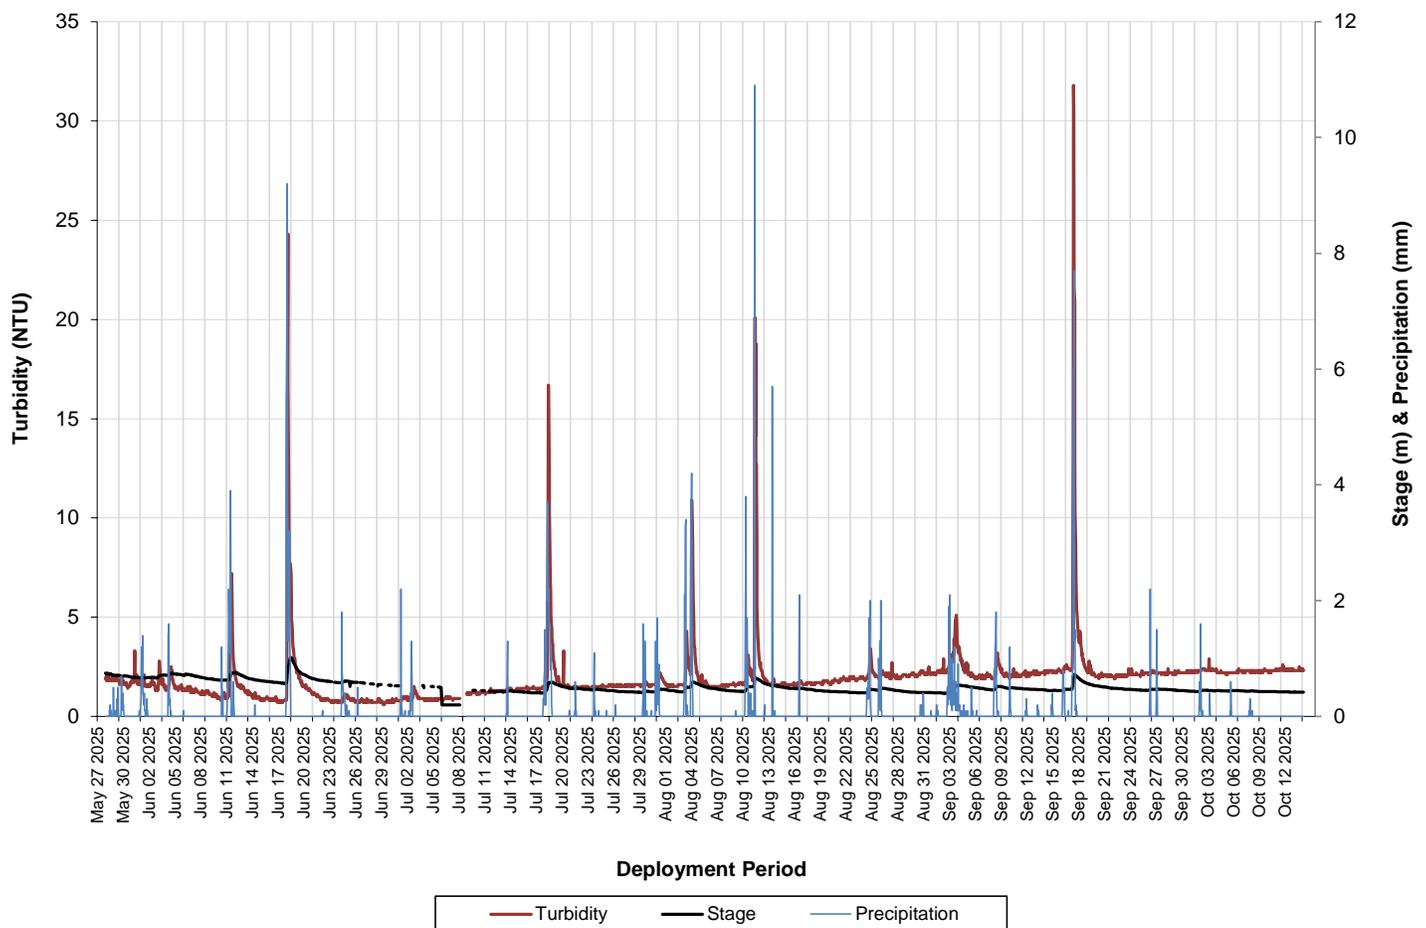


Figure 24: Turbidity, Precipitation & Stage at Tributary to Reid Brook

Table 23: Comparisons of Minimum, Maximum and Median from the past three deployment years

Turbidity	2025	2024	2023
Min	0.6	0.0	0.0
Max	31.8	36.5	61.4
Median	1.7	0.0	0.0

Multi-Station Comparison

The following section of this report focuses on comparisons between the four stations in the Voisey's Bay real-time network.

Temperature

During the 2025 deployment season, water temperatures at all four real-time stations ranged from 1.06°C at Tributary to Reid Brook to a maximum of 22.13°C at Camp Pond Brook below Camp Pond.

Water temperature trends were similar at each of the four RTWQ stations and closely resembled ambient air temperatures (Figure 25). Water temperatures at Camp Pond Brook below Camp Pond, Reid Brook below Tributary and Tributary to Reid Brook all followed a similar trend, peaking between mid-July and mid-August. Reid Brook at Outlet of Reid Pond is generally slower to respond to changes in air temperatures since it is a larger volume of water and takes longer to acclimatize.

Tributary to Reid Brook and Reid Brook below Tributary had very similar water temperature data. This is to be expected as Tributary to Reid Brook flows directly into Reid Brook below Tributary. Both are fast flowing sites with similar environmental influences. Camp Pond Brook below Camp Pond exhibits more pronounced changes in water temperature compared to the other stations, recording the greatest range of temperatures in the network (Table 24).

Water Temperature & Air Temperature at Real-Time Water Quality Monitoring Stations

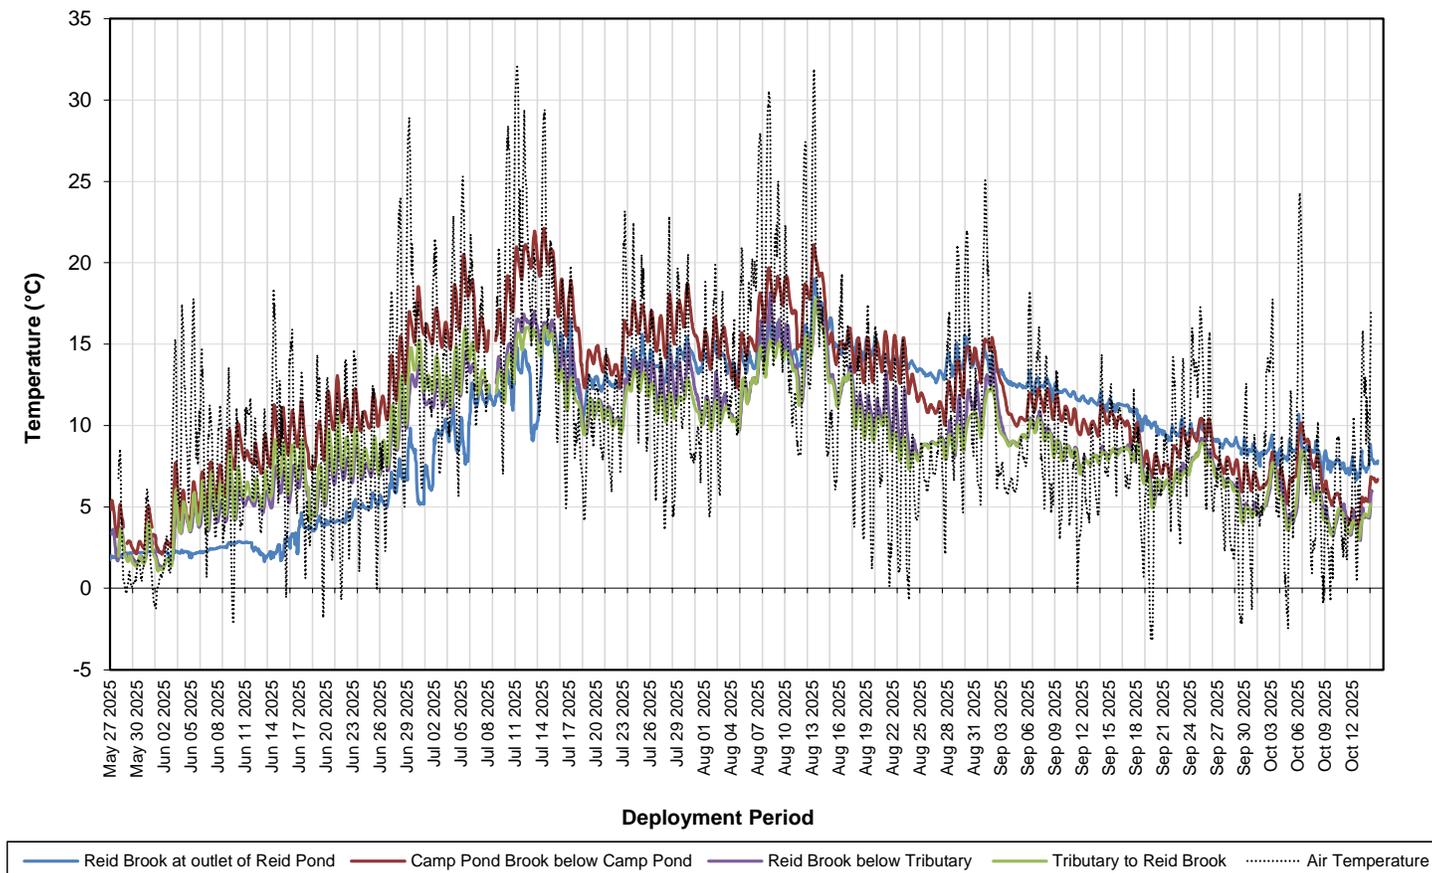


Figure 25: Water Temperature & Air Temperature at all RTWQ Stations

Table 24: Comparisons of Minimum, Maximum and Median from all RTWQ stations

Temperature (°C)	Reid Brook at Outlet of Reid Pond	Camp Pond Brook below Camp Pond	Reid Brook below Tributary	Tributary to Reid Brook
Min	1.63	2.09	1.32	1.06
Max	19.02	22.13	18.16	17.81
Median	11.24	11.37	8.88	8.92

pH

During the 2025 deployment season, median pH values at all four real-time stations ranged from 6.80 pH units at Reid Brook at outlet of Reid Pond to 7.13 pH units at Reid Brook below Tributary (Table 25).

pH data for all stations followed a somewhat similar trend. The Reid Brook at Outlet of Reid Pond station is at the outlet of a pond and has different factors influencing pH as compared to the other sites and tends to exhibit a wider range of pH values. Camp Pond Brook below Camp Pond, Reid Brook below Tributary, and Tributary to Reid Brook all showed similar pH movements across the deployment season (Figure 26).

There were several events where pH fell below the CCME's Minimum Guideline for the Protection of Aquatic Life. When compared to precipitation data (Figure 26), there is an evident change in pH levels during higher and longer precipitation events, specifically at Camp Pond Brook below Camp Pond, Reid Brook below Tributary, and Tributary to Reid Brook. Many of the fluctuations in the pH data across the real-time stations corresponded closely with precipitation events. This relationship is much less evident at Reid Brook at Outlet of Reid Pond.

pH & Precipitation at Real-Time Water Quality Monitoring Stations

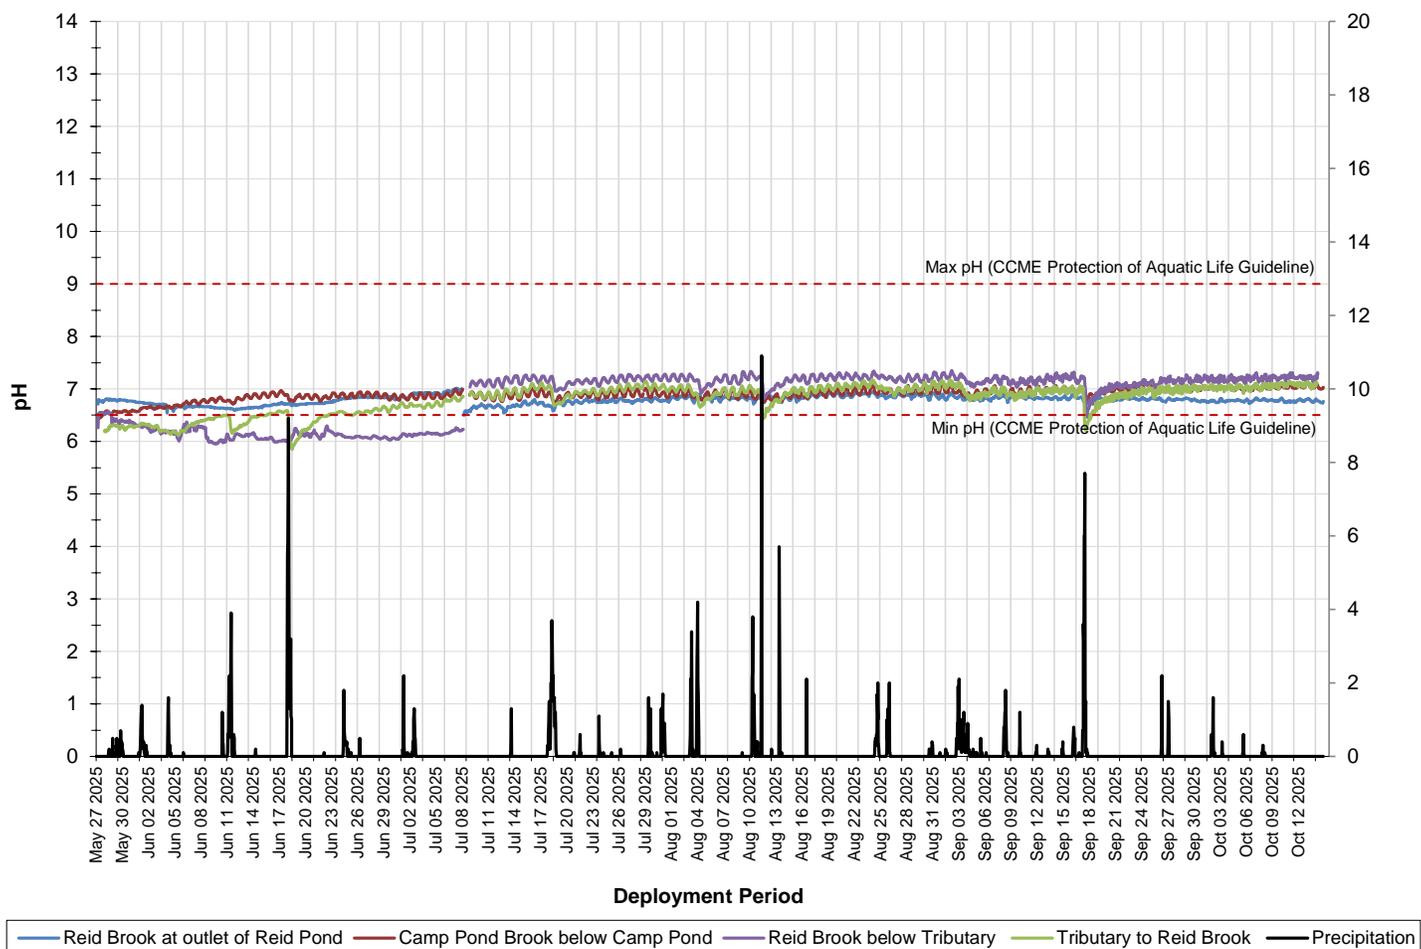


Figure 26: pH & Precipitation at all RTWQ Stations

Table 25: Comparisons of Minimum, Maximum and Median from the four real-time stations

pH (units)	Reid Brook at Outlet of Reid Pond	Camp Pond Brook below Camp Pond	Reid Brook below Tributary	Tributary to Reid Brook
Min	6.50	6.44	5.95	5.85
Max	7.01	7.14	7.35	7.18
Median	6.80	6.91	7.13	6.92

Specific Conductivity

During the 2025 deployment season, specific conductivity medians ranged from 14.40µS/cm at Reid Brook at Outlet of Reid Pond to a maximum of 50.28µS/cm at Tributary to Reid Brook (Table 26).

Reid Brook at Outlet of Reid Pond maintained stable specific conductivity levels across the deployment season with very little variation. Stable conductivity levels are to be expected at this station since it is located in an established pond environment. Reid Brook below Tributary and Tributary to Reid Brook had similar conductivity levels and followed a similar trend. Camp Pond Brook below Camp Pond displayed occasional greater and more fluctuating specific conductivity levels. This trend is typical of this station, as it is located closer to the Voisey's Bay mine site than the other stations and is therefore more susceptible to anthropogenic influences (Figure 27).

Reid Brook below Tributary, Tributary to Reid Brook and Camp Pond Brook below Camp Pond all generally displayed increasing conductivity levels across the deployment season. This is to be expected as stage levels decrease and suspended solids become more concentrated in the water column. As Reid Brook at Outlet of Reid Pond is a more stable water quality environment, conductivity data remained quite low and consistent across the deployment season.

Specific Conductivity at Real-Time Water Quality Monitoring Stations

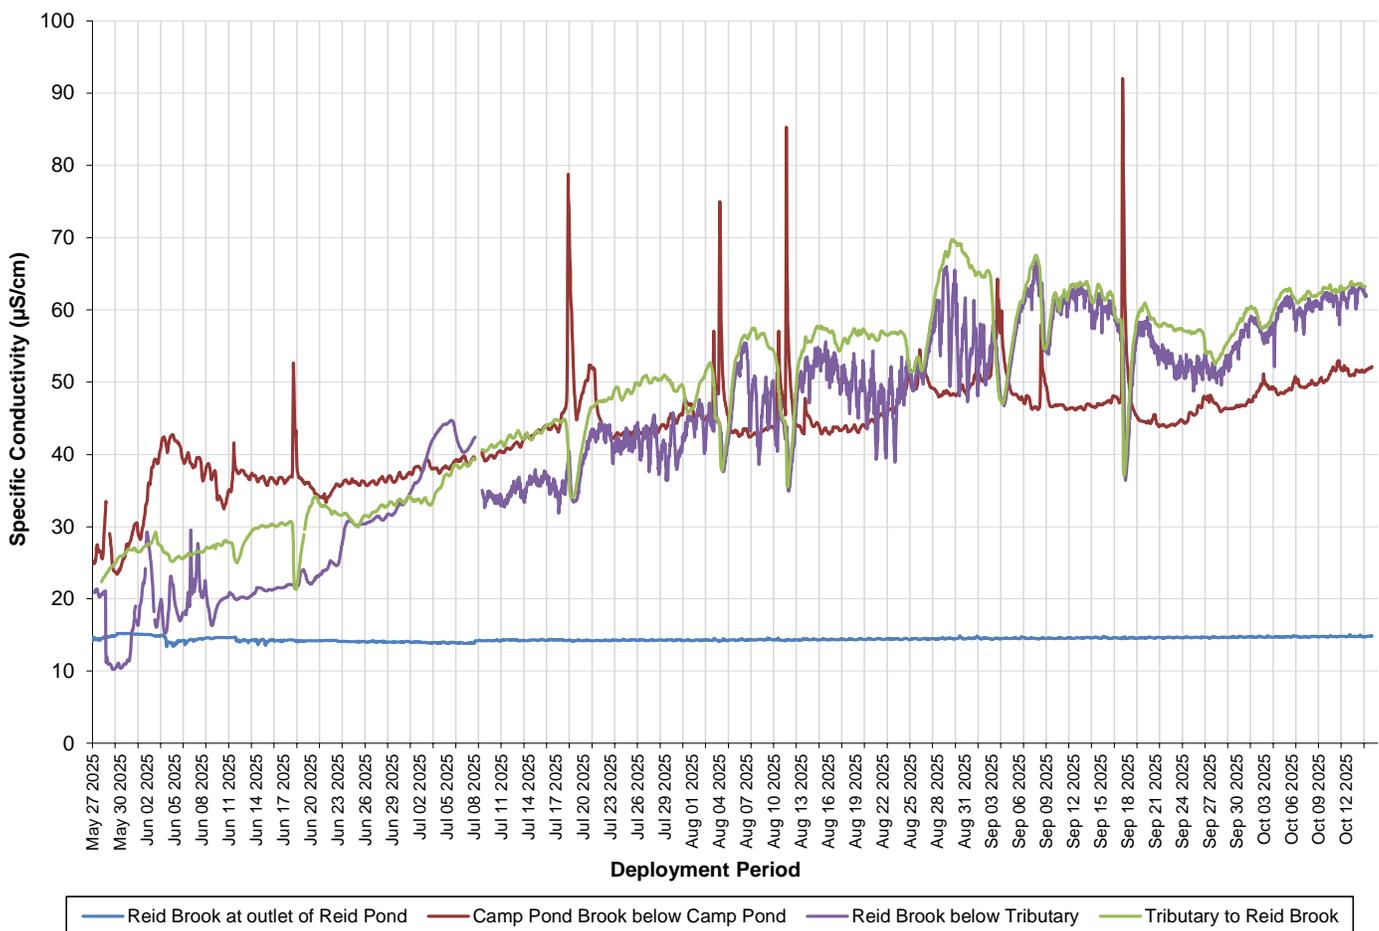


Figure 27: Specific Conductivity at all RTWQ Stations

Table 26: Comparisons of Minimum, Maximum and Median from the four real-time stations

Specific Conductivity	Reid Brook at Outlet of Reid Pond	Camp Pond Brook below Camp Pond	Reid Brook below Tributary	Tributary to Reid Brook
Min	13.35	23.40	10.25	21.30
Max	15.23	92.04	66.80	69.73
Median	14.40	44.06	44.34	50.28

Dissolved Oxygen Concentration and Saturation of Dissolved Oxygen

During the 2025 deployment season, dissolved oxygen concentration medians ranged from 10.55mg/L at Camp Pond Brook below Camp Pond to a maximum of 11.55mg/L at Reid Brook at outlet of Reid Pond (Table 27). Dissolved oxygen concentrations displayed a typical inverse relationship with both water and ambient air temperatures at all stations (Figure 28a). Dissolved oxygen levels were most stable at Reid Brook at Outlet of Reid Pond, whereas there was greater fluctuation at the other three stations. The very low values at Reid Brook below Tributary June to July were due to the instrument being buried in sand.

During the warmest period of mid-July through mid-August, dissolved oxygen levels at most stations fell, at least occasionally, below the CCME's Guideline for the Protection of Early Life Stages (9.5mg/L). Dissolved oxygen concentrations rose above the CCME's Guidelines for the Protection of Early Life Stages from mid-August onwards as water temperatures decreased. Dissolved oxygen concentrations remained above the CCME's Guideline for the Protection of Other Life Stages for the duration of deployment at all stations (Figure 28a).

The observed changes in dissolved oxygen levels are not unusual and are to be expected during warmer temperatures. As air temperatures decreased into the cooler fall season, dissolved oxygen levels began to steadily increase.

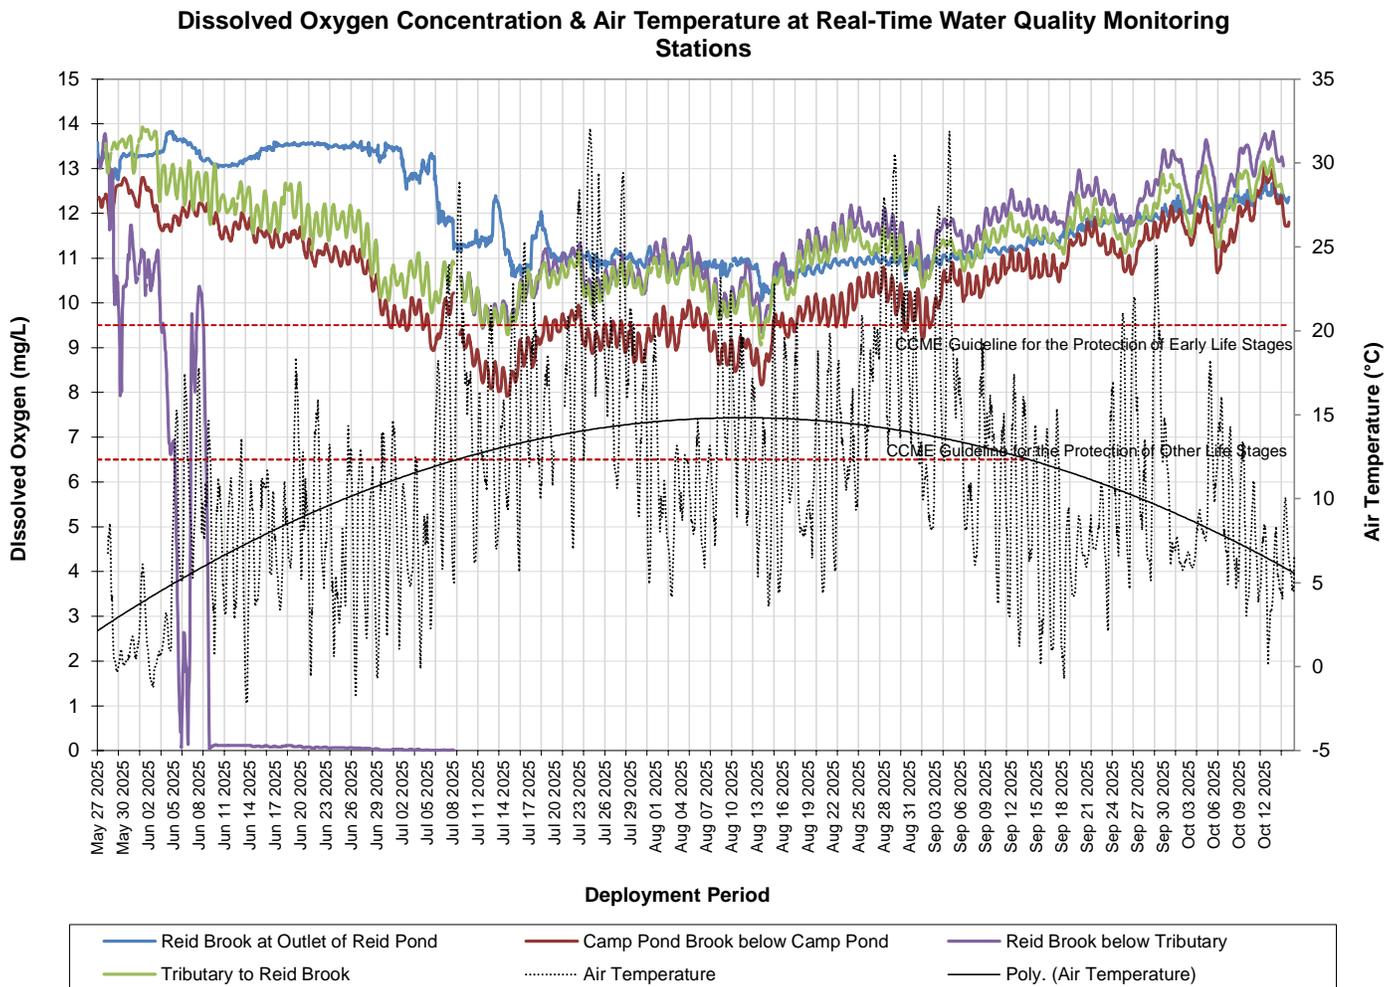


Figure 28a: Dissolved Oxygen Concentration & Air Temperature at all RTWQ Stations

Saturation of Dissolved Oxygen at Real-Time Water Quality Monitoring Stations

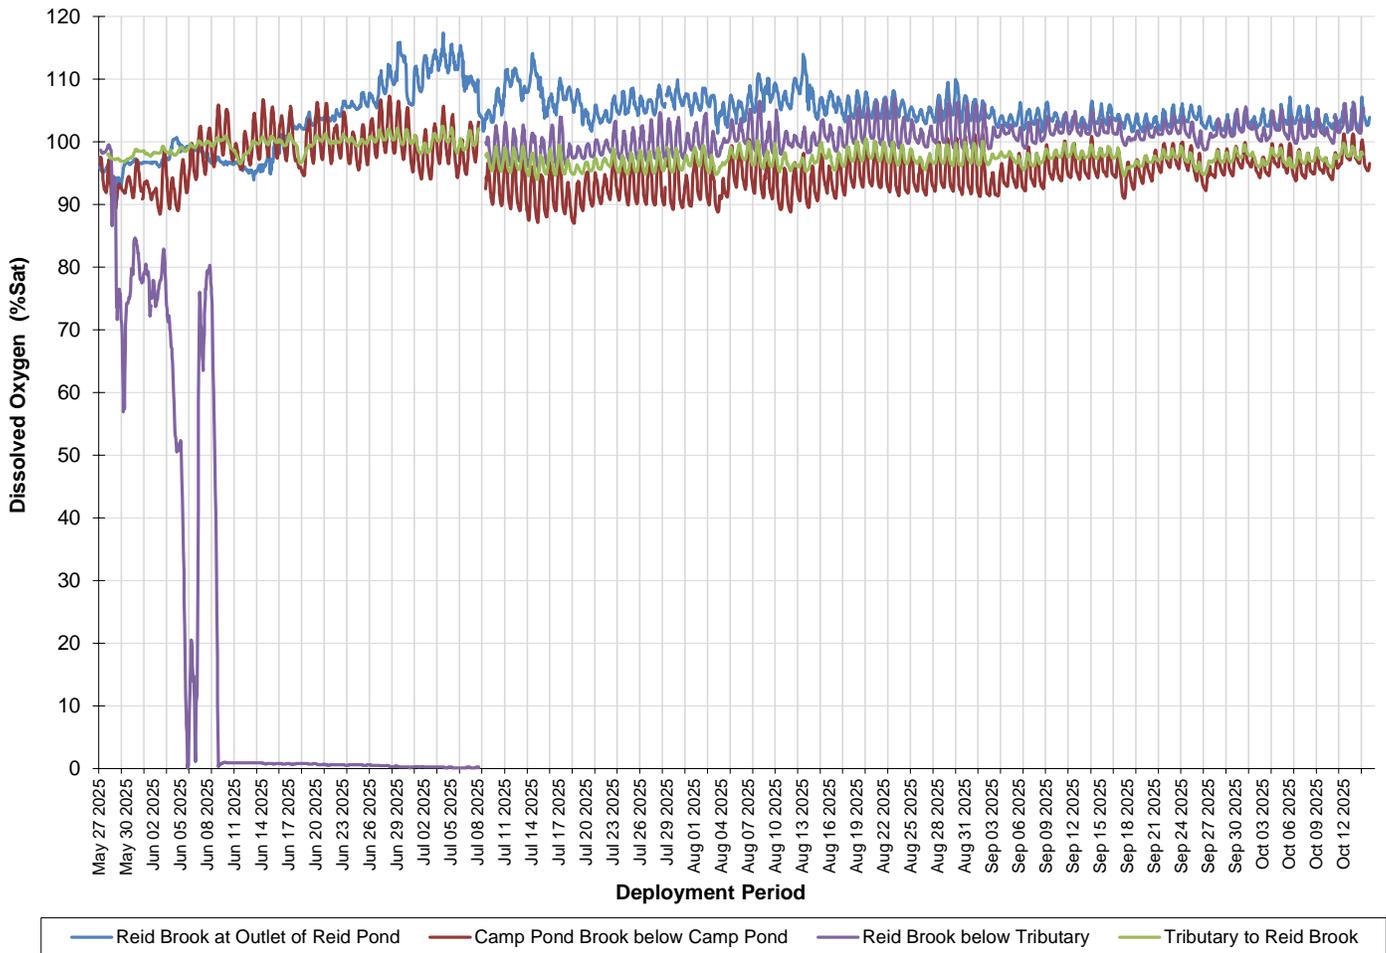


Figure 28b: Saturation of Dissolved Oxygen at all RTWQ Stations

Table 27: Comparisons of Minimum, Maximum and Median from the four real-time stations

	Dissolved Oxygen (mg/L)				Dissolved Oxygen (% Saturation)			
	Reid Brook at Outlet of Reid Pond	Camp Pond Brook below Camp Pond	Reid Brook below Tributary	Tributary to Reid Brook	Reid Brook at Outlet of Reid Pond	Camp Pond Brook below Camp Pond	Reid Brook below Tributary	Tributary to Reid Brook
Min	10.05	7.91	0.01	9.06	92.6	87	0	94
Max	13.83	13.03	13.83	13.93	117.4	107.3	106.9	102.5
Median	11.55	10.55	10.87	11.32	104.3	95.7	99.9	97.7

Turbidity

During the 2025 deployment season, turbidity ranged from 0.1NTU at Reid Brook at Outlet of Reid Pond to a maximum of 8328.1NTU also at Reid Brook at Outlet of Reid Pond (Table 28). It is not unusual to see significant variability in turbidity data, as this parameter is influenced by many factors (e.g. precipitation, runoff from surrounding environments, high water flow (bubbles), sediment build-up, and debris, such as leaf litter). Median turbidity values at all stations indicate that there is very little background turbidity at these stations, which is to be expected (Figure 29b). Reid Brook below Tributary values were higher than normal during the first deployment due to it being buried in sand.

Figure 29a displays all turbidity data for the four real-time stations, as well as precipitation data. In contrast, Figure 29b displays turbidity data on a scale of 100NTU. The use of a smaller scale allows for more accurate comparison of turbidity events between the different stations and clearly shows the relationship between precipitation events and increased turbidity levels.

Turbidity & Precipitation at Real-Time Water Quality Monitoring Stations

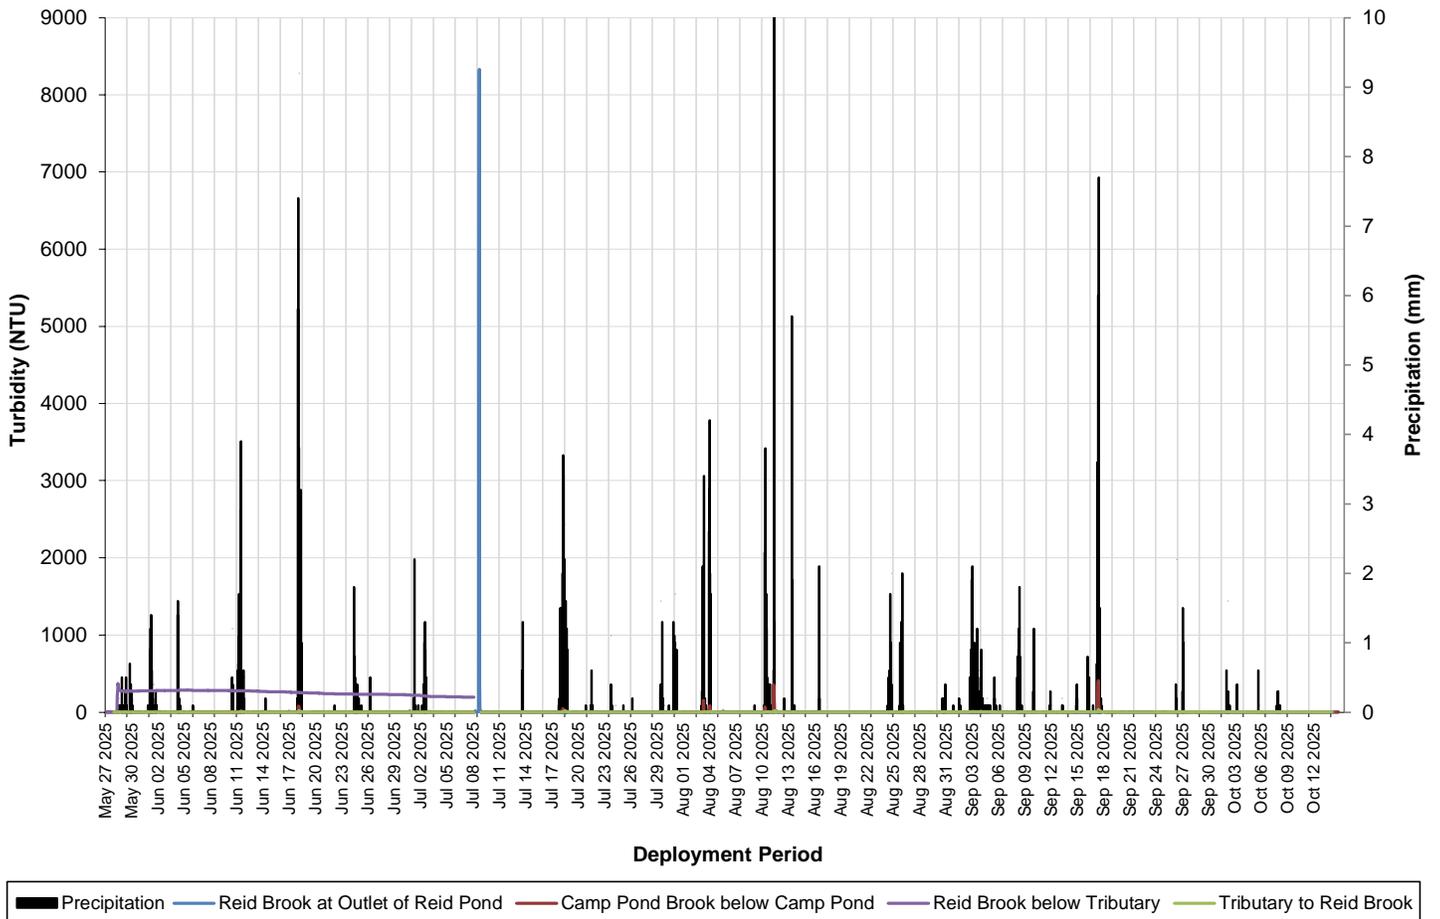


Figure 29a: Turbidity & Precipitation at all RTWQ Stations

Turbidity (100 NTU) & Precipitation at Real-Time Water Quality Monitoring Stations

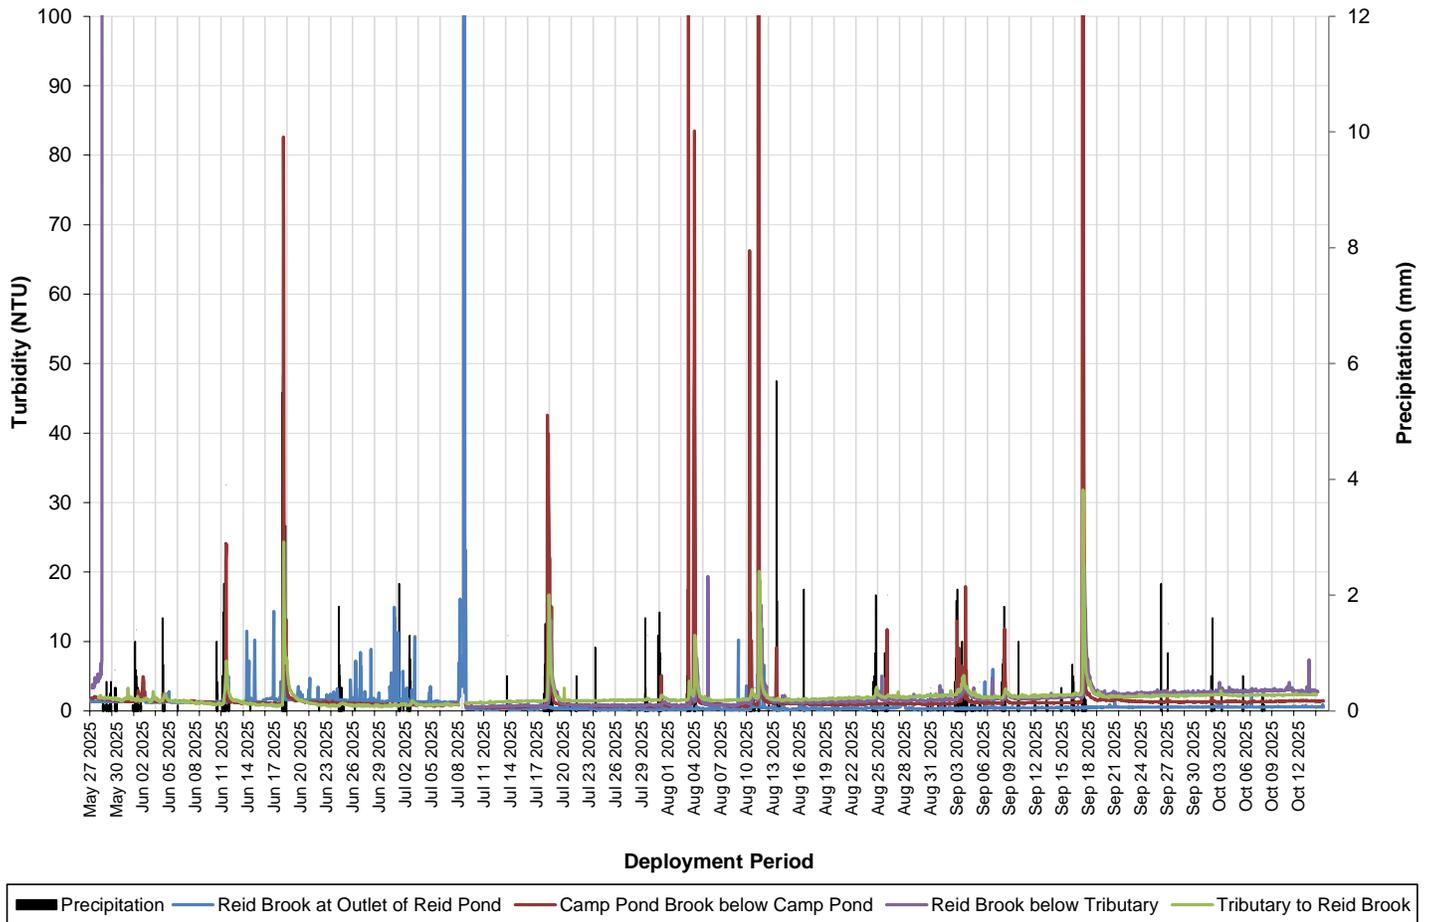


Figure 29b: Turbidity & Precipitation at all RTWQ Stations (graphed to 100 NTU)

Table 28: Comparisons of Minimum, Maximum and Median from the four real-time stations

Turbidity (NTU)	Reid Brook at Outlet of Reid Pond	Camp Pond Brook below Camp Pond	Reid Brook below Tributary	Tributary to Reid Brook
Min	0.1	0.4	0.5	0.6
Max	8328.1	409.6	372.1	31.8
Median	0.5	1.1	2.39	1.7

Stage

During the 2025 deployment season, stage levels were variable but generally decreasing over the course of deployment at all stations. Camp Pond Brook below Camp Pond exhibited the least variation in stage level but did react to high precipitation events (Figure 30).

There is an obvious relationship between precipitation and stage. Tributary to Reid Brook, Reid Brook below Tributary, and Reid Brook at Outlet of Reid Pond had obvious responses to precipitation events. Precipitation events had slightly less influence at Camp Pond Brook below Camp Pond as this station is in close proximity to the lake, but the relationship is still evident (Figure 30).

Please be advised that WSC is responsible for the QA/QC of water quantity data. Corrected data can be obtained upon request. Stage data is included in this report to highlight the relationship with water quality parameters.

Stage & Precipitation at Real-Time Water Quality Monitoring Stations

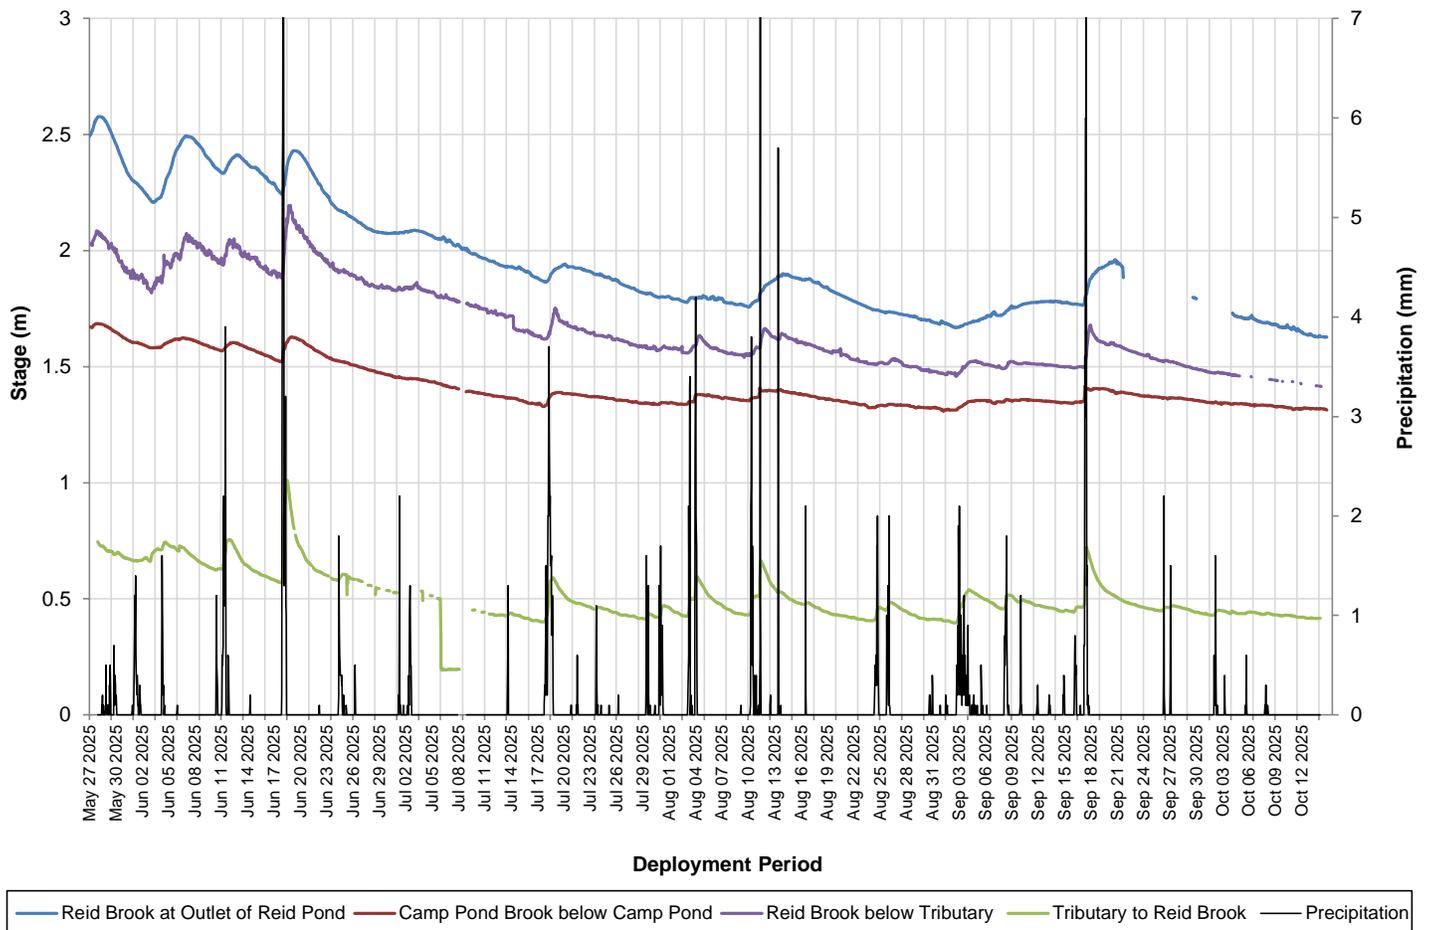


Figure 30: Stage & Precipitation at all RTWQ Stations

Table 29: Comparisons of Minimum, Maximum and Median from the four real-time stations

Stage (m)	Reid Brook at Outlet of Reid Pond	Camp Pond Brook below Camp Pond	Reid Brook below Tributary	Tributary to Reid Brook
Min	1.626	1.309	1.304	0.194
Max	2.577	1.686	2.194	1.013
Median	1.879	1.368	1.611	0.467
Difference (Max-Min)	0.951	0.377	0.890	0.819

Conclusions

The 2025 deployment season ran from May 27 until October 15 and consisted of two deployment periods. The first deployment occurred about a month earlier than previous years as conditions were favourable for deployment in May. This extra deployment time may skew data slightly when comparing it to previous years.

This marks the first year with newly upgraded water quality instrumentation at all four monitoring stations. These were installed during the initial deployment in May.

The first deployment at Reid Brook below Tributary resulted in the instrument being buried during the spring freshet. Other stations incurred issues with transmission and hydrometric equipment during the year.

The majority of water quality events at the four RTWQ stations can be explained by precipitation events, spring thaw influences, and/or changes in air temperature as the seasons moved from spring to summer to fall.

Water temperature and dissolved oxygen were directly influenced by typical seasonal trends, increasing or decreasing with warming or cooling air temperatures. pH levels were generally maintained throughout deployment, except during high stage events or precipitation events when pH values decreased for a short period of time.

Three RTWQ stations had specific conductivity levels that increased across the deployment season; Reid Brook at Outlet of Reid Pond was the exception with relatively stable conductivity levels, which are attributed to the stable pond environment nearby.

Turbidity data showed significant variation across the network; however, the majority of turbidity increases were associated with precipitation events occurring at the same time. Observed turbidity events were generally short in duration and readings typically returned to background levels.

Equipment at all four monitoring stations performed well in 2025. Sedimentation continues to occasionally bury equipment, causing erroneous data. Helicopter access is also a recurring issue, limiting the timing and frequency of maintenance visits. In addition, helicopter pilots have expressed concern regarding current landing conditions at the stations. Vegetation removal and maintenance work may be necessary.

Path Forward

The success of the real-time water monitoring network is largely due to environmental staff maintaining and monitoring the Voisey's Bay RTWQ network. This network has been improving since 2003 and continues to advance annually in background knowledge and awareness of the area's characteristics. Data collected within this network is essential for identifying the difference between natural and anthropogenic events. As this agreement progresses into the 2026 deployment period for the Voisey's Bay stations, the following is a list of planned activities to be carried out. This list also includes some multi-year activities planned in the previous year that are still in progress.

- WSC staff will perform regular site visits to ensure water quantity instrumentation is functioning correctly, calibrated and providing accurate measurements.
- WRMD will continue to work in partnership with Vale Environment staff to operate the RTWQ network in Voisey's Bay.
- If necessary, changes or improvements to deployment techniques will be adapted to each specific site, ensuring secure and suitable conditions for RTWQ. This includes issues with helicopter landing sites and pilot concerns.
- WRMD will work with Vale Environment staff to reassess the network design (station location) and plan for any necessary or desired changes in 2026 or in future seasons.
- Open communication lines will continue to be maintained between WRMD, ECCC and Vale employees involved with the agreement to respond to emerging issues on a proactive basis.
- Vale will receive deployment reports outlining the events that occurred in the previous deployment period and a 2026 annual report summarizing the events of the entire deployment season.
- WRMD will continue to work on Automatic Data Retrieval System to incorporate new capabilities when applicable. This will include implementation of the RTWQ email Early Alert system.
- WRMD will continue to work on the creation of value-added products using the RTWQ data, remote sensing and water quality indices.
- 2026 deployments will recommence in the Spring.