

Areas of Potential Arsenic Concentration in Well Water


Areas where high arsenic is found in lake sediments are more likely to have arsenic in drilled wells that encounter bedrock.

Legend


Public Water Supply Wells

- between 0.010 and 0.025 mg/L
- greater than 0.025 mg/L

Areas of High Arsenic in Lake Sediments



mg/L (milligrams per litre)
ppm (parts per million)

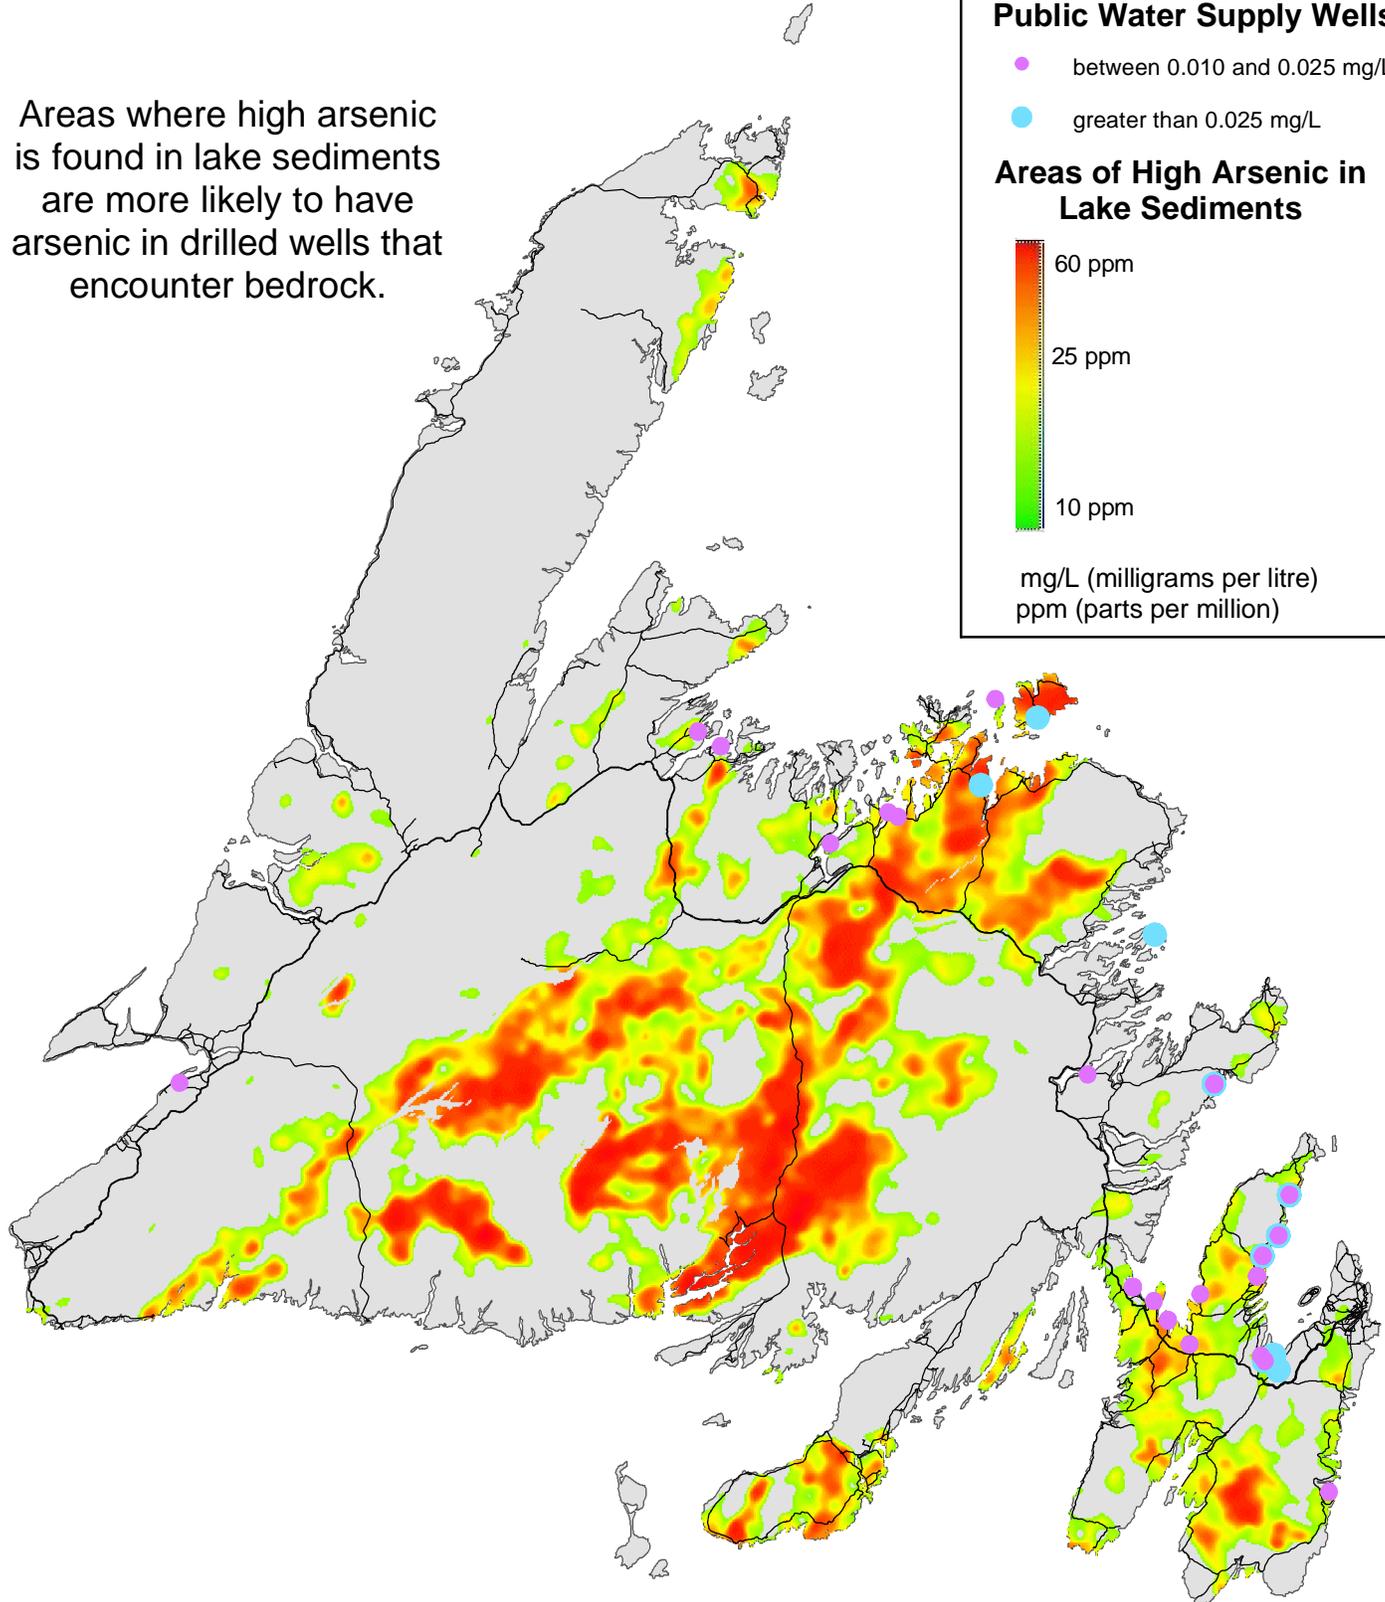

Government of Newfoundland & Labrador
Department of Environment
Department of Mines and Energy

0 25 50 100 150 Kilometers