

Real-Time Water Quality Deployment Report

Flora Creek below TLH

June 13 to
July 18, 2017



Government of Newfoundland & Labrador
Department of Municipal Affairs and
Environment
Water Resources Management Division

Contents

General	4
Quality Assurance and Quality Control.....	4
Data Interpretation	6
Flora Creek below TLH	6
Conclusions	13
Appendix 1	14

General

- The Water Resources Management Division, in partnership with Tacora Resources Inc. – Wabush Mines, maintains one real-time water quality and water quantity station at Flora Creek.
- This station is situated downstream of the former Wabush Mines tailings disposal area, in Flora Lake.
- Water Resources Management Division staff monitors the real-time web pages regularly.
- On June 13, 2017, a real-time water quality monitoring instrument was deployed at the station Flora Creek below TLH. The instrument was deployed for a period of 35 days. The instrument was removed on July 18th, 2017. This was the first deployment period for this season.

Quality Assurance and Quality Control

- As part of the Quality Assurance and Quality Control protocol (QA/QC), an assessment of the reliability of data recorded by an instrument is made at the beginning and end of the deployment period. The procedure is based on the approach used by the United States Geological Survey.
 - At deployment and removal, a QA/QC Sonde is temporarily deployed along side the Field Sonde. Values for temperature, pH, conductivity, dissolved oxygen and turbidity are compared between the two instruments. Based on the degree of difference between parameters recorded by the Field Sonde and QA/QC Sonde at deployment and at removal, a qualitative statement is made on the data quality (Table 1).

Table 1: Ranking classifications for deployment and removal

Parameter	Rank				
	Excellent	Good	Fair	Marginal	Poor
Temperature (°C)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	<+/-1
pH (unit)	<=+/-0.2	>+/-0.2 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Sp. Conductance (µS/cm)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Sp. Conductance > 35 µS/cm (%)	<=+/-3	>+/-3 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20
Dissolved Oxygen (mg/L) (% Sat)	<=+/-0.3	>+/-0.3 to 0.5	>+/-0.5 to 0.8	>+/-0.8 to 1	>+/-1
Turbidity <40 NTU (NTU)	<=+/-2	>+/-2 to 5	>+/-5 to 8	>+/-8 to 10	>+/-10
Turbidity > 40 NTU (%)	<=+/-5	>+/-5 to 10	>+/-10 to 15	>+/-15 to 20	>+/-20

- It should be noted that the temperature sensor on any sonde is the most important. All other parameters can be broken down into three groups: temperature dependant, temperature compensated and temperature independent. Because the temperature sensor is not isolated from the rest of the sonde the entire sonde must be at the same temperature before the sensor will stabilize. The values may take some time to climb to the appropriate reading; if a reading is taken too soon it may not accurately portray the water body.

- Deployment and removal comparison rankings for the station on Flora Creek deployed between June 13 and July 18, 2017 is summarized in Table 2.

Table 2: Comparison rankings for Flora Creek below TLH station June 13 – July 18, 2017.

Station	Date	Action	Comparison Ranking				
			Temperature	pH	Conductivity	Dissolved Oxygen	Turbidity
Flora Creek below TLH	June 13, 2017	Deployment	Excellent	Poor	Excellent	Excellent	Excellent
	July 18, 2017	Removal	Excellent	Good	Excellent	Good	Excellent

- At deployment, all parameters besides pH ranked ‘excellent’. pH ranked ‘poor’, the field instrument read a value of 7.06 while the QA/QC instrument read a value of 4.86. This reading could be due to a sensor malfunction with the QA/QC instrument, as a pH reading of this value would not be expected at this station.
- At removal, all parameters ranked either ‘excellent’ or ‘good’.

Data Interpretation

- The following graphs and discussion illustrate water quality-related events from June 13 to July 18 at the station Flora Creek below TLH.
- With the exception of water quantity data (stage), all data used in the preparation of the graphs and subsequent discussion adhere to this stringent QA/QC protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request.

Flora Creek below TLH

- Water temperature ranged from 9.74 to 21.33°C during this deployment period (Figure 1).
- Water temperature generally increased throughout the deployment period, corresponding with increasing ambient air temperature (Figure 2).

**Water Temperature : Flora Creek below TLH
June 13 to July 18, 2017**

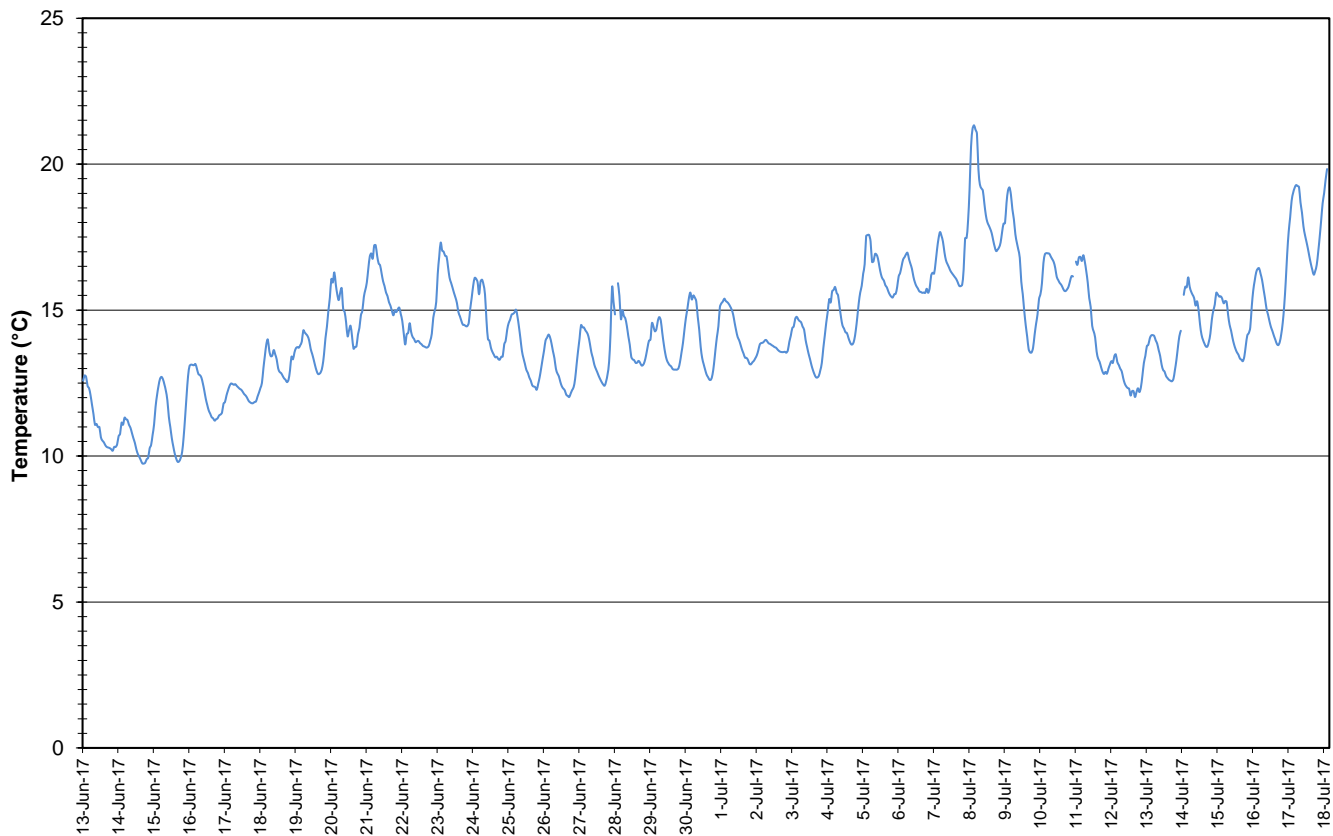


Figure 1: Water temperature - Flora Creek below TLH

Average Daily Air and Water Temperature: Flora Creek
June 13 to July 18, 2017

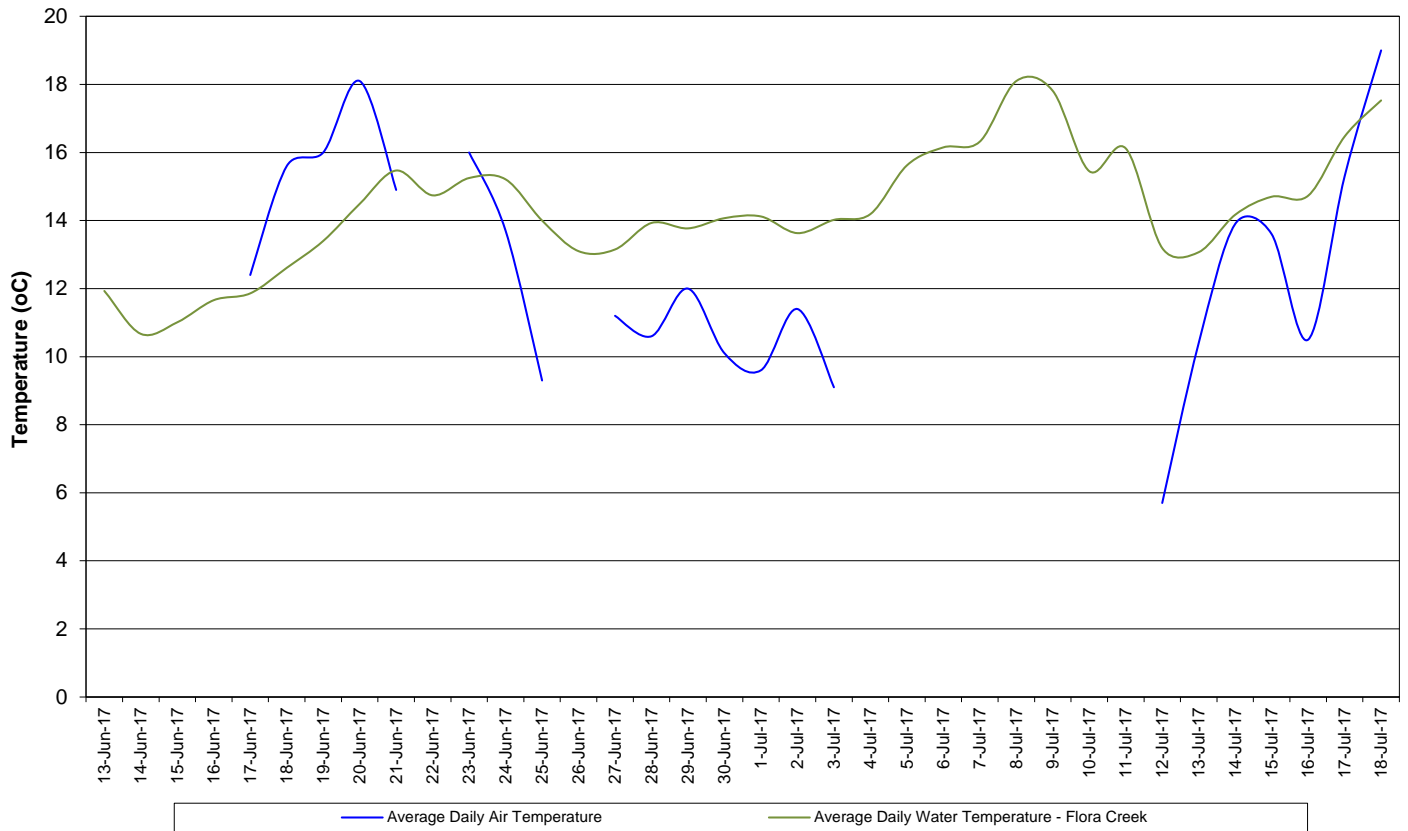


Figure 2: Average daily air and water temperatures - Flora Creek below TLH

Flora Creek below TLH, Newfoundland and Labrador

- pH ranged between 7.52 and 8.08 pH units throughout the deployment period, with a median value of 7.73 units (Figure 3).
- All values during the deployment are within the CCME Guidelines for the Protection of Aquatic Life (between 6.5 and 9 pH units). pH fluctuates slightly during the day and night.

**Water pH : Flora Creek below TLH
June 13 to July 18, 2017**

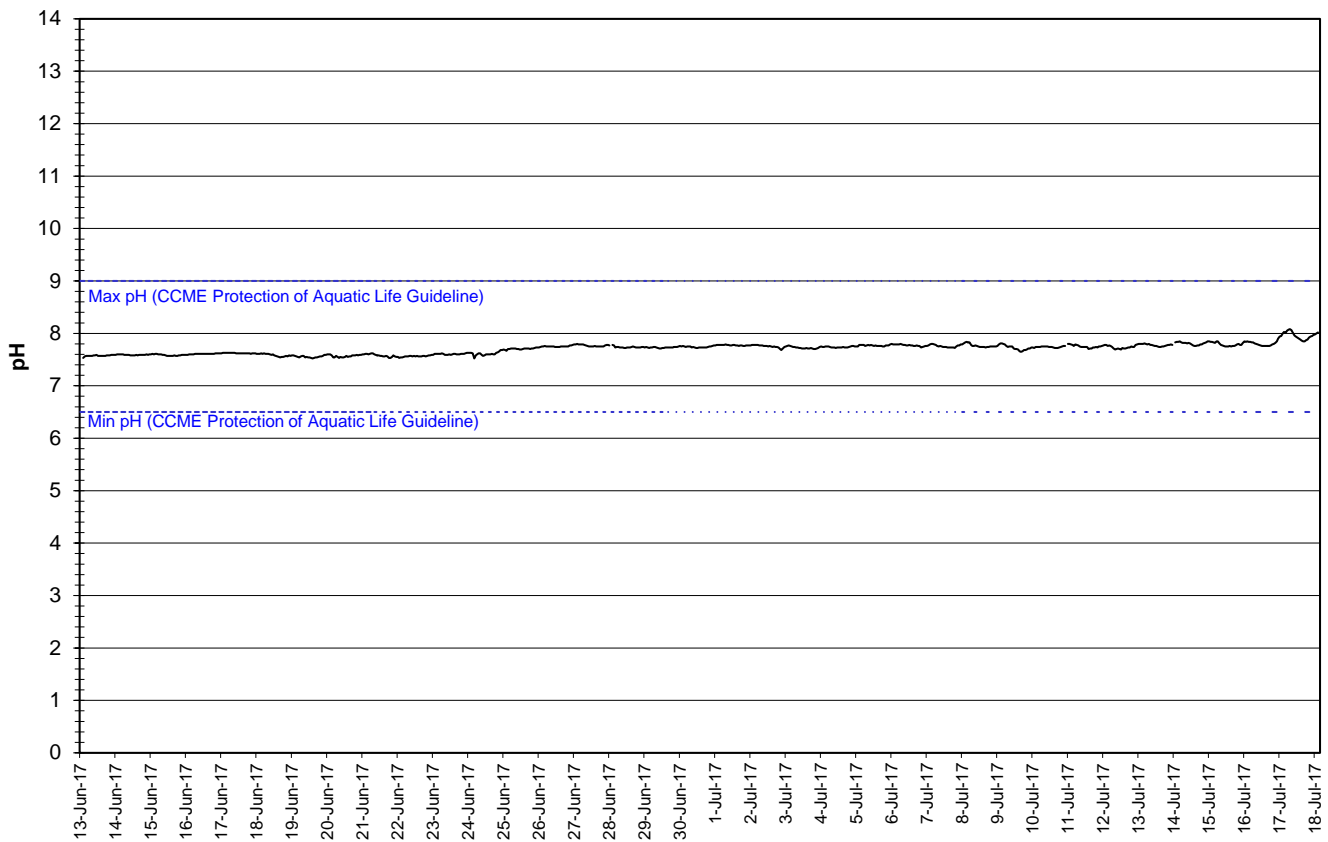


Figure 3: pH - Flora Creek below TLH

- Specific conductivity ranged from 60.9 to 64.6 $\mu\text{S}/\text{cm}$ (Figure 4).
- Specific conductivity increased slightly over the course of this deployment period .
- With the exception of water quantity data (stage), all data used in the preparation of the graphs and subsequent discussion adhere to this stringent QA/QC protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request.

**Specific Conductivity of Water and Stage Level : Flora Creek below TLH
June 13 to July 18, 2017**

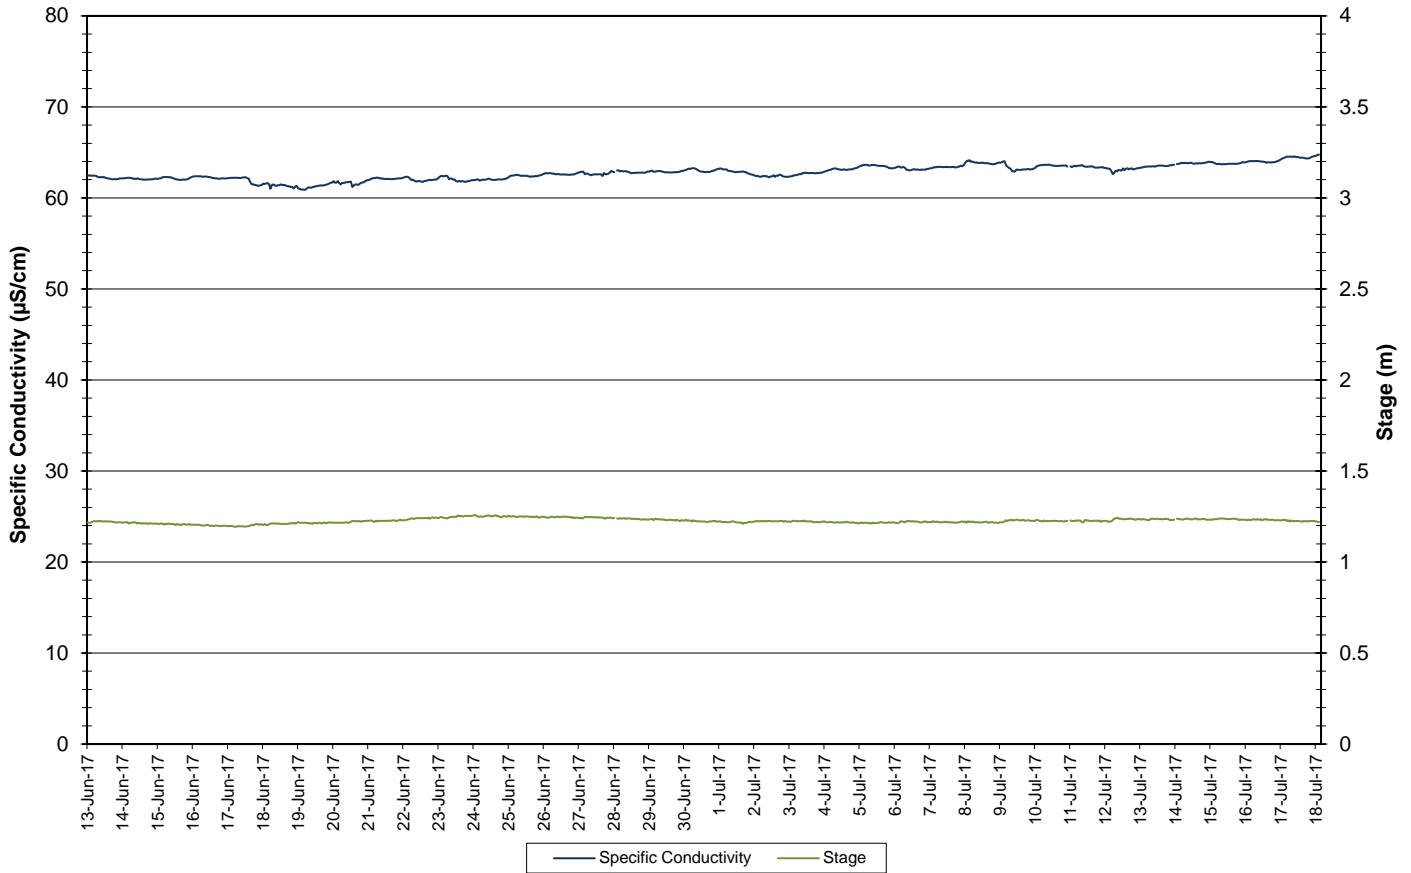


Figure 4: Specific conductivity and stage level - Flora Creek below TLH

- The saturation of dissolved oxygen ranged from 90.0 to 105.9% and a range of 9.03 to 10.53 mg/l was found in the concentration of dissolved oxygen with a median value of 9.68 mg/l (Figure 5).
- All values were above the minimum CCME Guideline for the Protection of Other Life Stage Cold Water Biota of 6.5 mg/l. Most values were above the minimum CCME Guideline for the Protection of Early Life Stage Cold Water Biota value of 9.5 mg/l. The guidelines are indicated in blue on Figure 5.
- Dissolved oxygen content fluctuates diurnally, displaying the inverse relationship to water temperature. DO decreases slightly during the later portion of the deployment period; this is due to an increase in water temperature at this time.

Dissolved Oxygen Concentration and Saturation : Flora Creek below TLH
June 13 to July 18, 2017

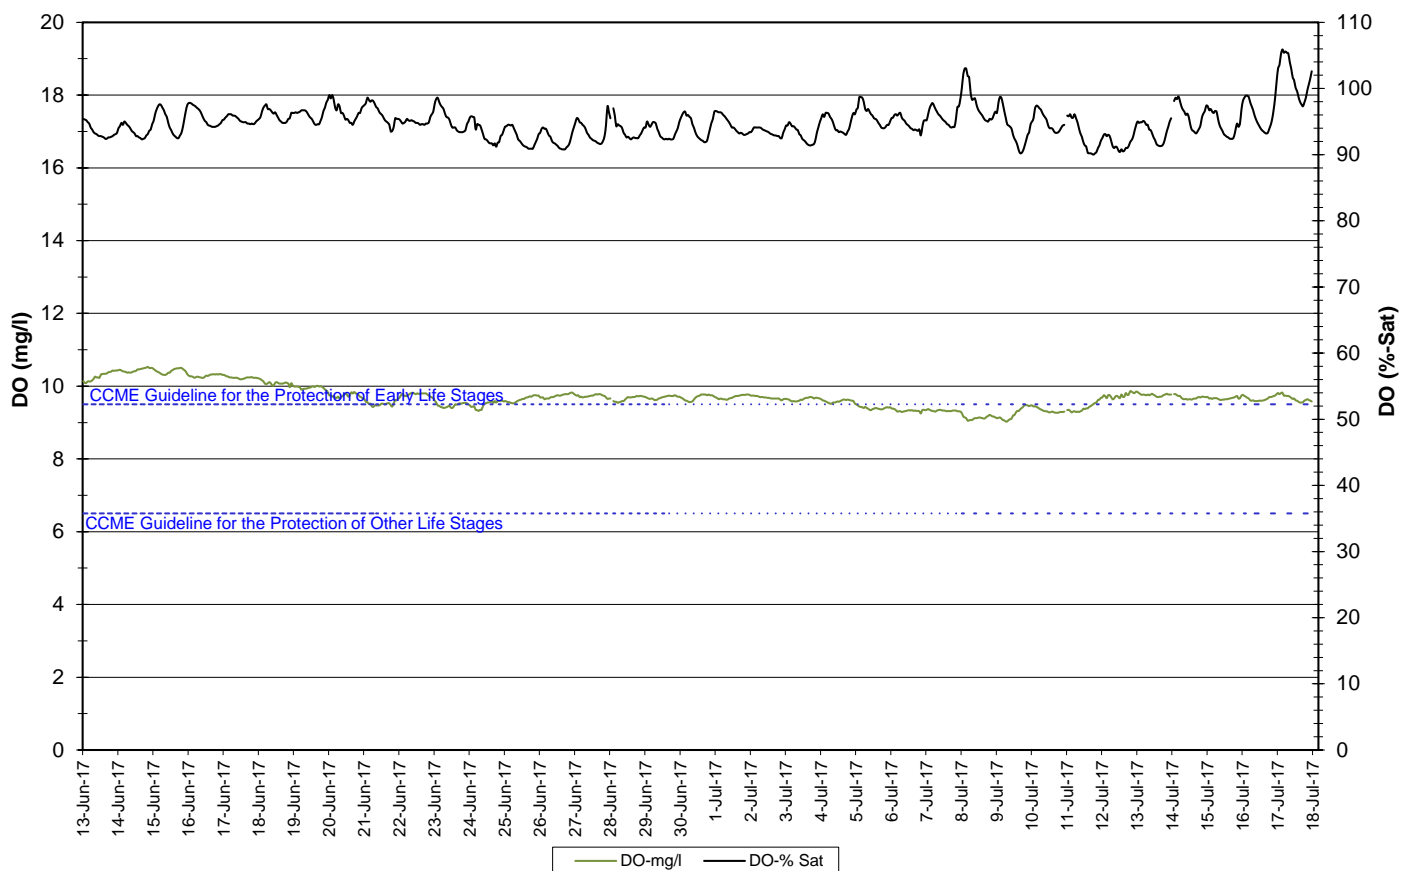


Figure 5: Dissolved oxygen and percent saturation - Flora Creek below TLH

- Turbidity values range from 35.4 NTU to 572.4 NTU, the highest readings being recorded at the beginning of the deployment period. Turbidity gradually decreases over the course of the deployment period (Figure 6).
- This site has very turbid water at times. It is likely that the high turbidity in June can be attributed to late snow melt/spring freshet. This trend has been noticed since the station was commissioned.

**Water Turbidity : Flora Creek below TLH
June 13 to July 18, 2017**

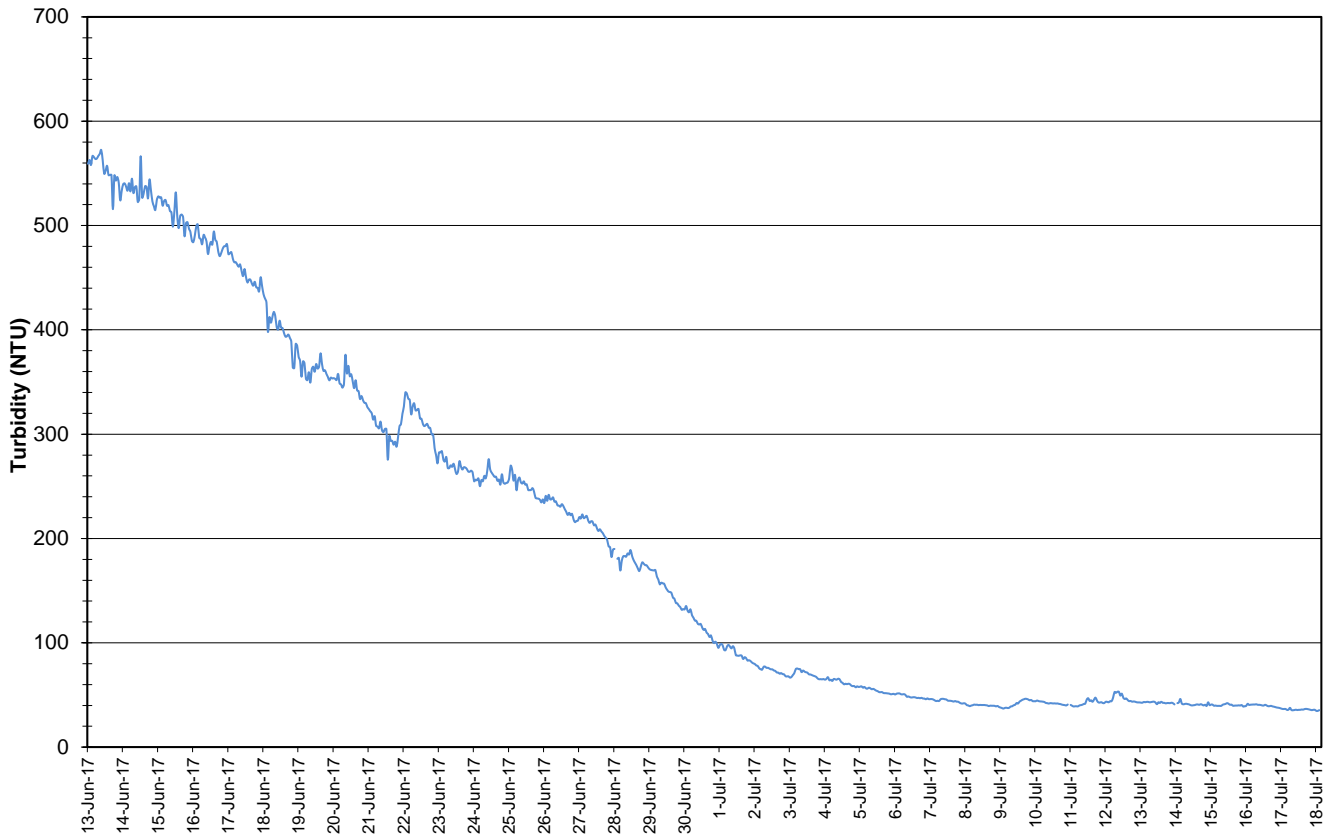


Figure 6: Turbidity - Flora Creek below TLH

- Precipitation and stage during the deployment period is graphed below (Figure 7). Stage was relatively stable over the course of this deployment period, with varying precipitation levels.
- With the exception of water quantity data (stage), all data used in the preparation of the graphs and subsequent discussion below adhere to this stringent QA/QC protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request.

**Daily Precipitation : Flora Creek below TLH
June 13 to July 18, 2017**

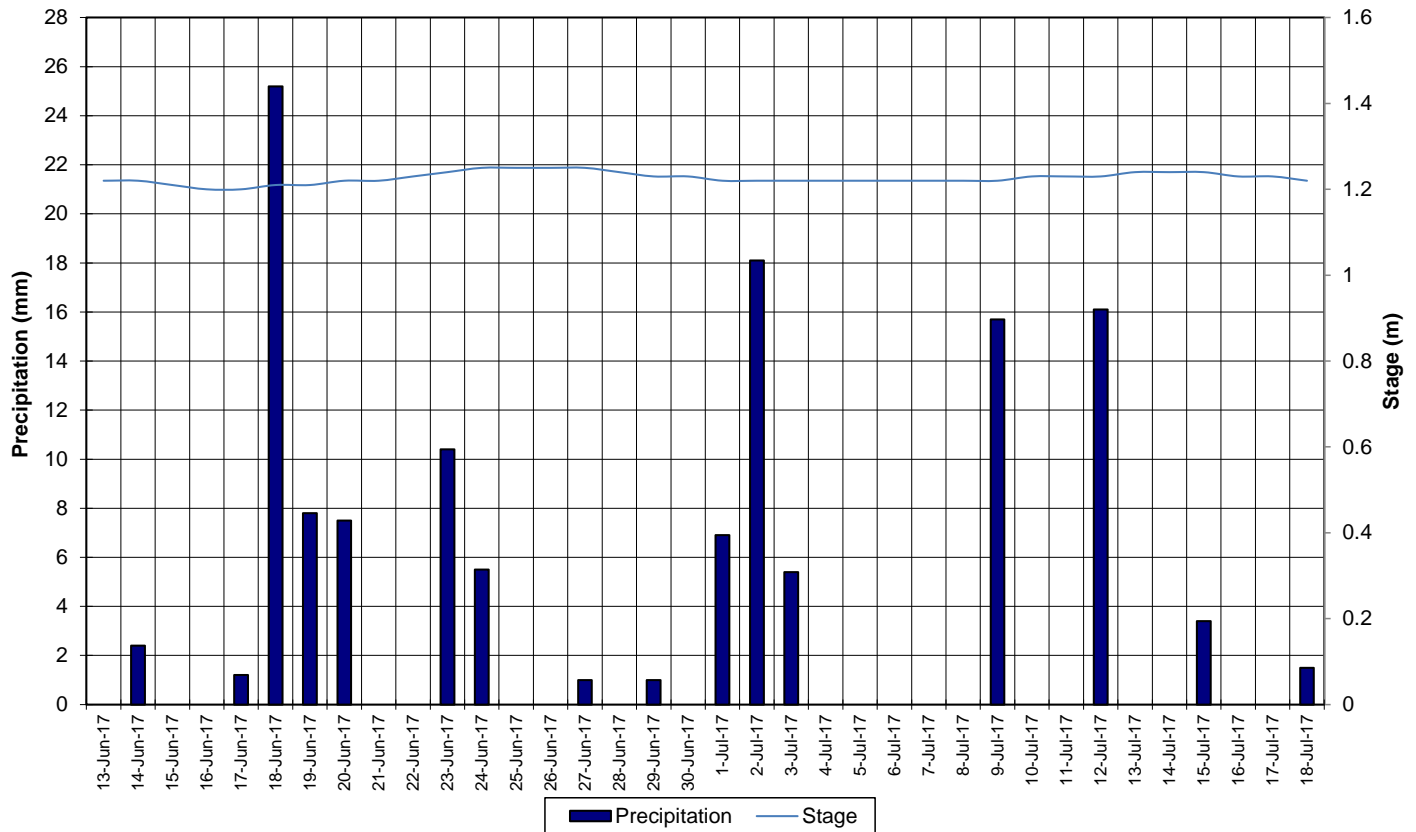


Figure 7: Precipitation and Stage – Flora Creek below TLH

Conclusions

- An instrument at the water quality monitoring station on the Flora Creek below TLH station was deployed on June 13 and removed on July 18, 2017. This was the first deployment period for this season.
- In most cases, weather related events or increases/decreases in water level could be used to explain the fluctuations. Most values recorded were within ranges as suggested by the CCME Guidelines for the Protection of Aquatic Life for pH and dissolved oxygen.
- Water temperature increased during the deployment period. Water temperature corresponded with air temperature. The temperature typically ranged between 9.74 and 21.33°C.
- pH values were all within the recommended CCME Guidelines for the Protection of Aquatic Life. pH ranged between 7.52 and 8.08.
- Specific conductivity ranged from 60.9 to 64.6 µs/cm.
- Dissolved oxygen values were above the minimum CCME Guideline for the Protection of Aquatic Life for Cold Water Biota at Other Life Stages of 6.5 mg/l and most values were above the CCME Guideline for the Protection of Aquatic Life for Cold Water Biota at Early Life Stages of 9.5 mg/l.
- Turbidity values decreased significantly over the deployment period.
- Stage was relatively stable during the deployment period.
- With the exception of water quantity data (stage), all data used in the preparation of the graphs and subsequent discussion adhere to this stringent QA/QC protocol. Water Survey of Canada is responsible for QA/QC of water quantity data. Corrected data can be obtained upon request.

Prepared by:
Maria Murphy
Department of Municipal Affairs and Environment
Water Resources Management Division
Phone: 709.896.7981
Fax: 709.896.9566

Appendix 1

Average Daily Air Temperature and Daily Precipitation: Wabush Airport June 13 to July 18, 2017

