

PIPE INVERT AT OR BELOW ORIGINAL GROUND

PIPE INVERT ABOVE ORIGINAL GROUND


CLEARANCE TABLE	
PIPE INSIDE DIAMETER mm	CLEARANCE mm
900 OR LESS	300
OVER 900	500

LEGEND:

D - INSIDE DIAMETER

NOTES:

- 1 HEIGHT OF FILL IS MEASURED FROM THE FINISHED SURFACE TO TOP OF PIPE.
- 2 THE PIPE BED SHALL BE COMPACTED AND SHAPED TO RECEIVE THE BOTTOM OF THE PIPE.
- 3 EMBEDMENT MATERIAL SHALL BE WRAPPED IN NON-WOVEN GEOTEXTILE WHEN SPECIFIED.
- 4 GRANULAR MATERIAL PLACED IN THE HAUNCH AREA SHALL BE COMPACTED PRIOR TO PLACING AND COMPACTING THE REMAINDER OF THE EMBEDMENT MATERIAL.
- 5 ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SHOWN.

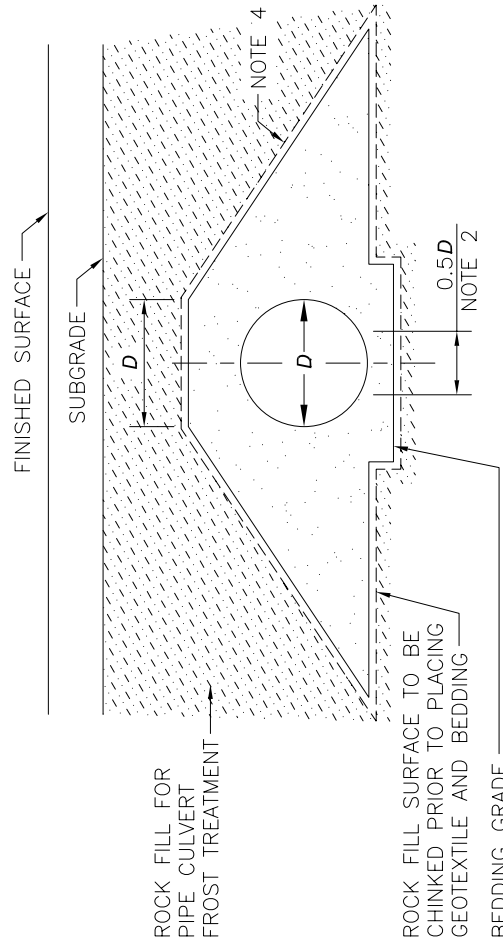

PIPE EMBEDMENT WITH ROCK FILL UNDER AND OVER THE PIPE