


| PIPE DIA | ENDWALL DIMENSIONS | | | | | | | |
|----------|--------------------|------|------|------|-----|-----|------|------|
| | A | B | C | D | E | F | G | H |
| 600 | 1050 | 2400 | 2725 | 1400 | 300 | 75 | 1525 | 2350 |
| 675 | 1125 | 2400 | 2725 | 1475 | 300 | 75 | 1600 | 2425 |
| 750 | 1200 | 2400 | 2725 | 1550 | 300 | 75 | 1675 | 2500 |
| 825 | 1275 | 2400 | 2725 | 1625 | 300 | 75 | 1755 | 2575 |
| 900 | 1350 | 2400 | 2725 | 1700 | 300 | 75 | 1825 | 2650 |
| 975 | 1425 | 2400 | 2725 | 1775 | 375 | 150 | 1975 | 2725 |
| 1050 | 1500 | 3000 | 3400 | 1850 | 375 | 150 | 2050 | 3100 |
| 1200 | 1650 | 3000 | 3400 | 2000 | 375 | 150 | 2200 | 3250 |
| 1350 | 1800 | 3000 | 3400 | 2150 | 375 | 150 | 2350 | 3400 |
| 1500 | 1950 | 3000 | 3400 | 2300 | 375 | 150 | 2500 | 3550 |
| 1650 | 2100 | 3000 | 3400 | 2450 | 375 | 150 | 2650 | 3700 |
| 1800 | 2250 | 3000 | 3400 | 2600 | 375 | 150 | 2800 | 3850 |
| 2400 | 3000 | 3000 | 3400 | 3350 | 375 | 150 | 3550 | 4600 |

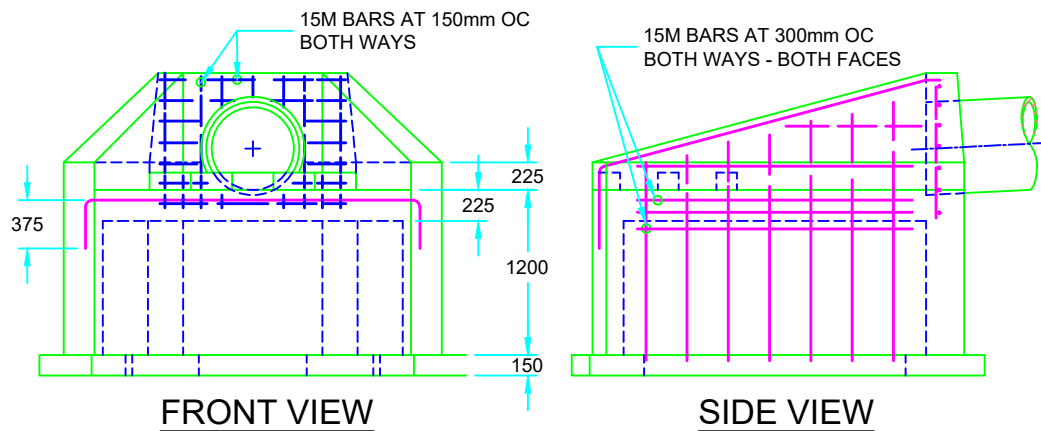

NOTES:

1. POURED CONCRETE CHUTE BLOCKS 300x200x100mm HIGH.
2. CLASS OF CONCRETE: 30MPa.
3. COVER TO REINFORCING BARS: 75mm ± 20mm.
4. GRANULAR BACKFILL TO BE PLACED TO 300mm MIN THICKNESS ON ALL SIDES.
5. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.

MASTER SPECIFICATIONS

CONCRETE HEADWALL FOR SEWER OR CULVERT PIPE

DRAWING NUMBER 04060

DATE: MARCH 2015

SCALE: 1:50