


SIZE OF DROP PIPE	
SEWER ID	DROP PIPE ID
200	200
250	200
300	250
375	300

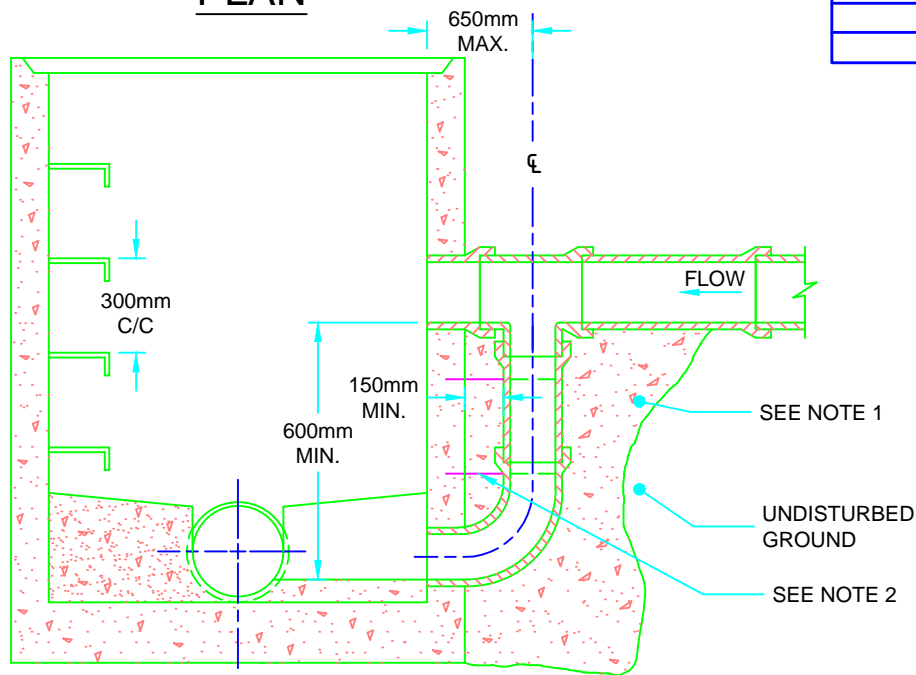

SECTION A-A

NOTES:

1. CONCRETE SHALL BE PLACED TO UNDISTURBED GROUND AND THE OUTSIDE FACE OF THE MAINTENANCE HOLE, BUT THERE SHALL BE A MINIMUM OF 150mm OF 15MPa CONCRETE AROUND THE DROP PIPE.
2. CONCRETE SHALL BE SECURED TO THE MAINTENANCE HOLE WITH 450mm LONG, 13mm DIAMETER THREADED RODS AND DRILLED EXPANSION ANCHORS DOWN EITHER SIDE OF THE DROP PIPE AT 300mm CENTRES.
3. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SHOWN.

**MASTER
SPECIFICATIONS**

**CAST-IN-PLACE MAINTENANCE
HOLE DROP STRUCTURE TEE**

DRAWING NUMBER 04300

DATE: MARCH 2016

SCALE: N.T.S.